
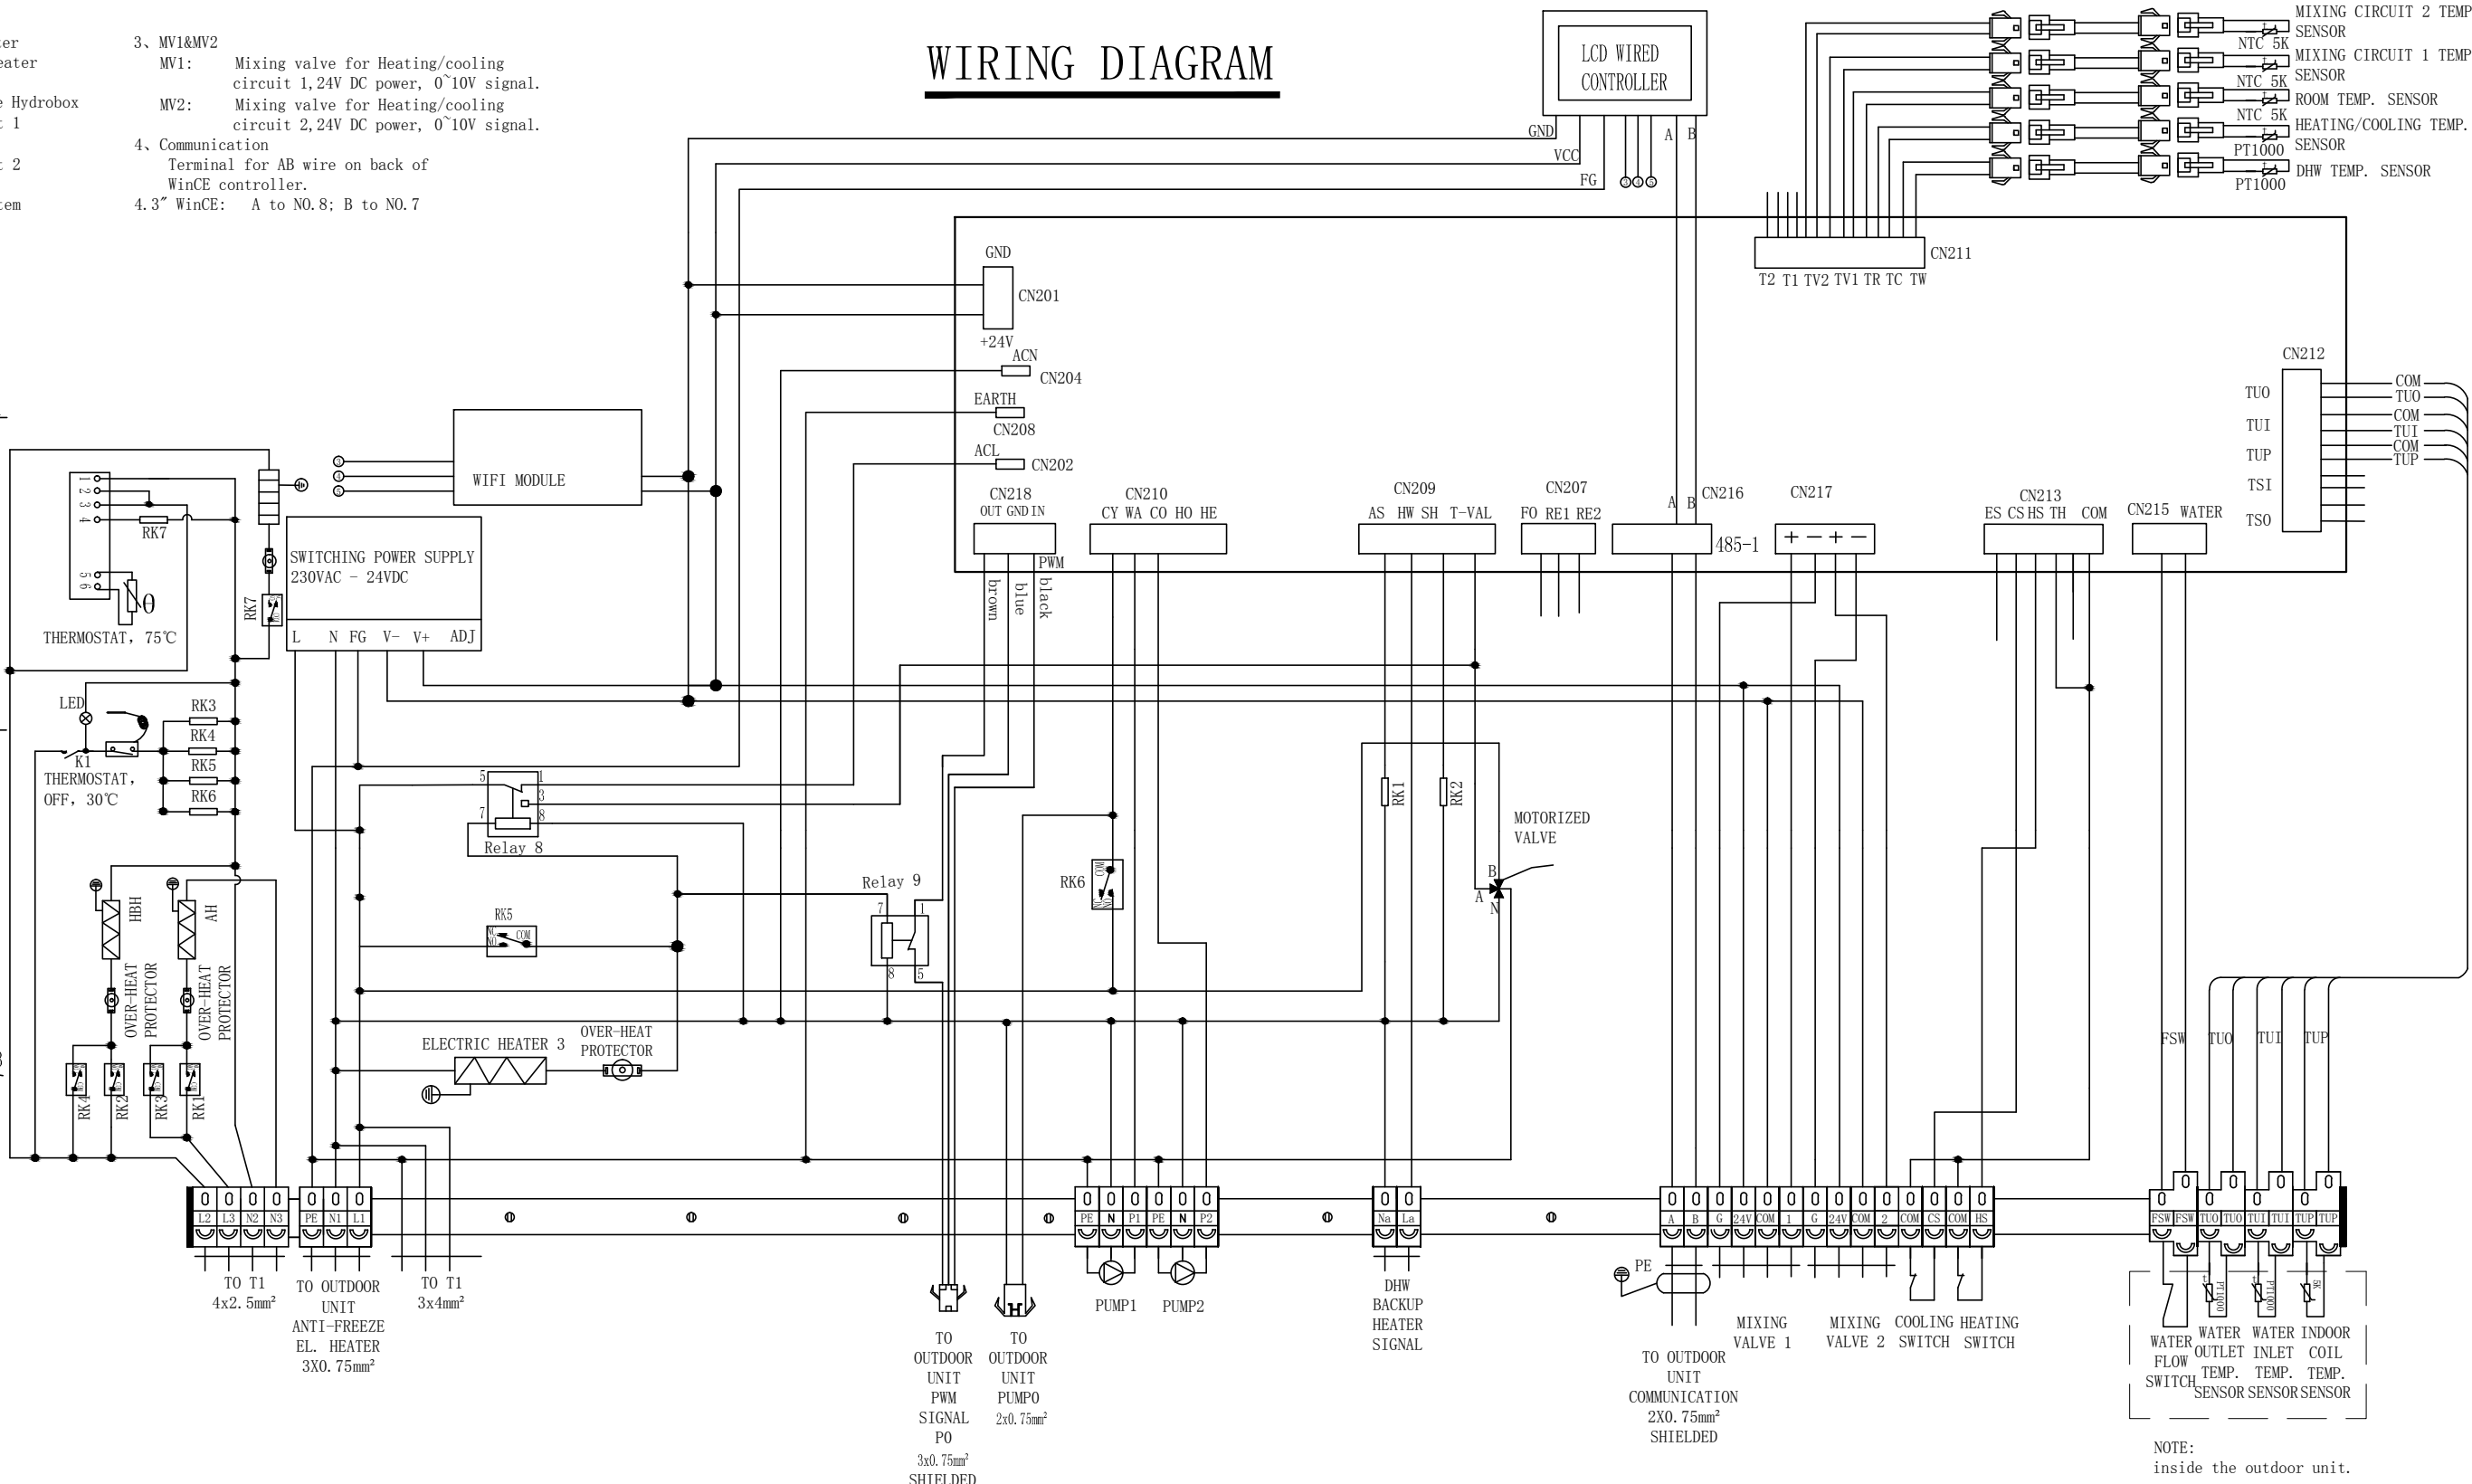
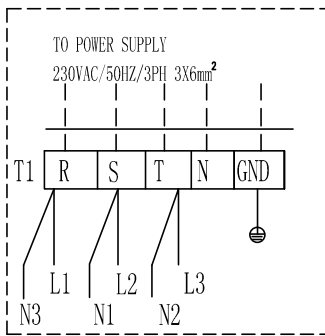
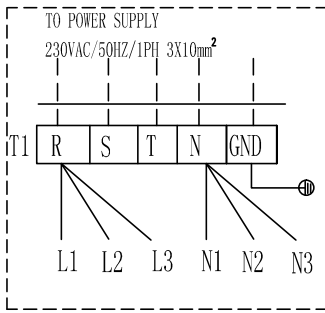


WIRING DIAGRAM

- 1, AH: Auxiliary Electrical Heater
- HWTBH: Hot Water Tank Back-up Heater
- HBH: Heating Back-up Heater
- 2, PUMP P0: Circulation pump inside Hydrobox
- PUMP P1: Heating/Cooling Circuit 1 Circulation Pump
- PUMP P2: Heating/Cooling Circuit 2 Circulation Pump
- PUMP P3: Sanitary Hot Water System Circulation Pump

- 3, MV1&MV2
- MV1: Mixing valve for Heating/cooling circuit 1, 24V DC power, 0~10V signal.
- MV2: Mixing valve for Heating/cooling circuit 2, 24V DC power, 0~10V signal.
- 4, Communication
- Terminal for AB wire on back of WinCE controller.
- 4.3" WinCE: A to NO.8; B to NO.7

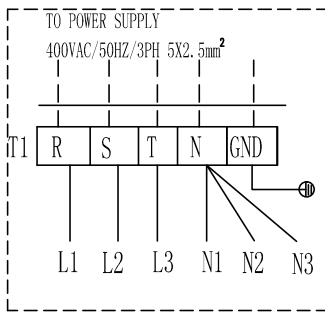

NOTE:
inside the outdoor unit.