


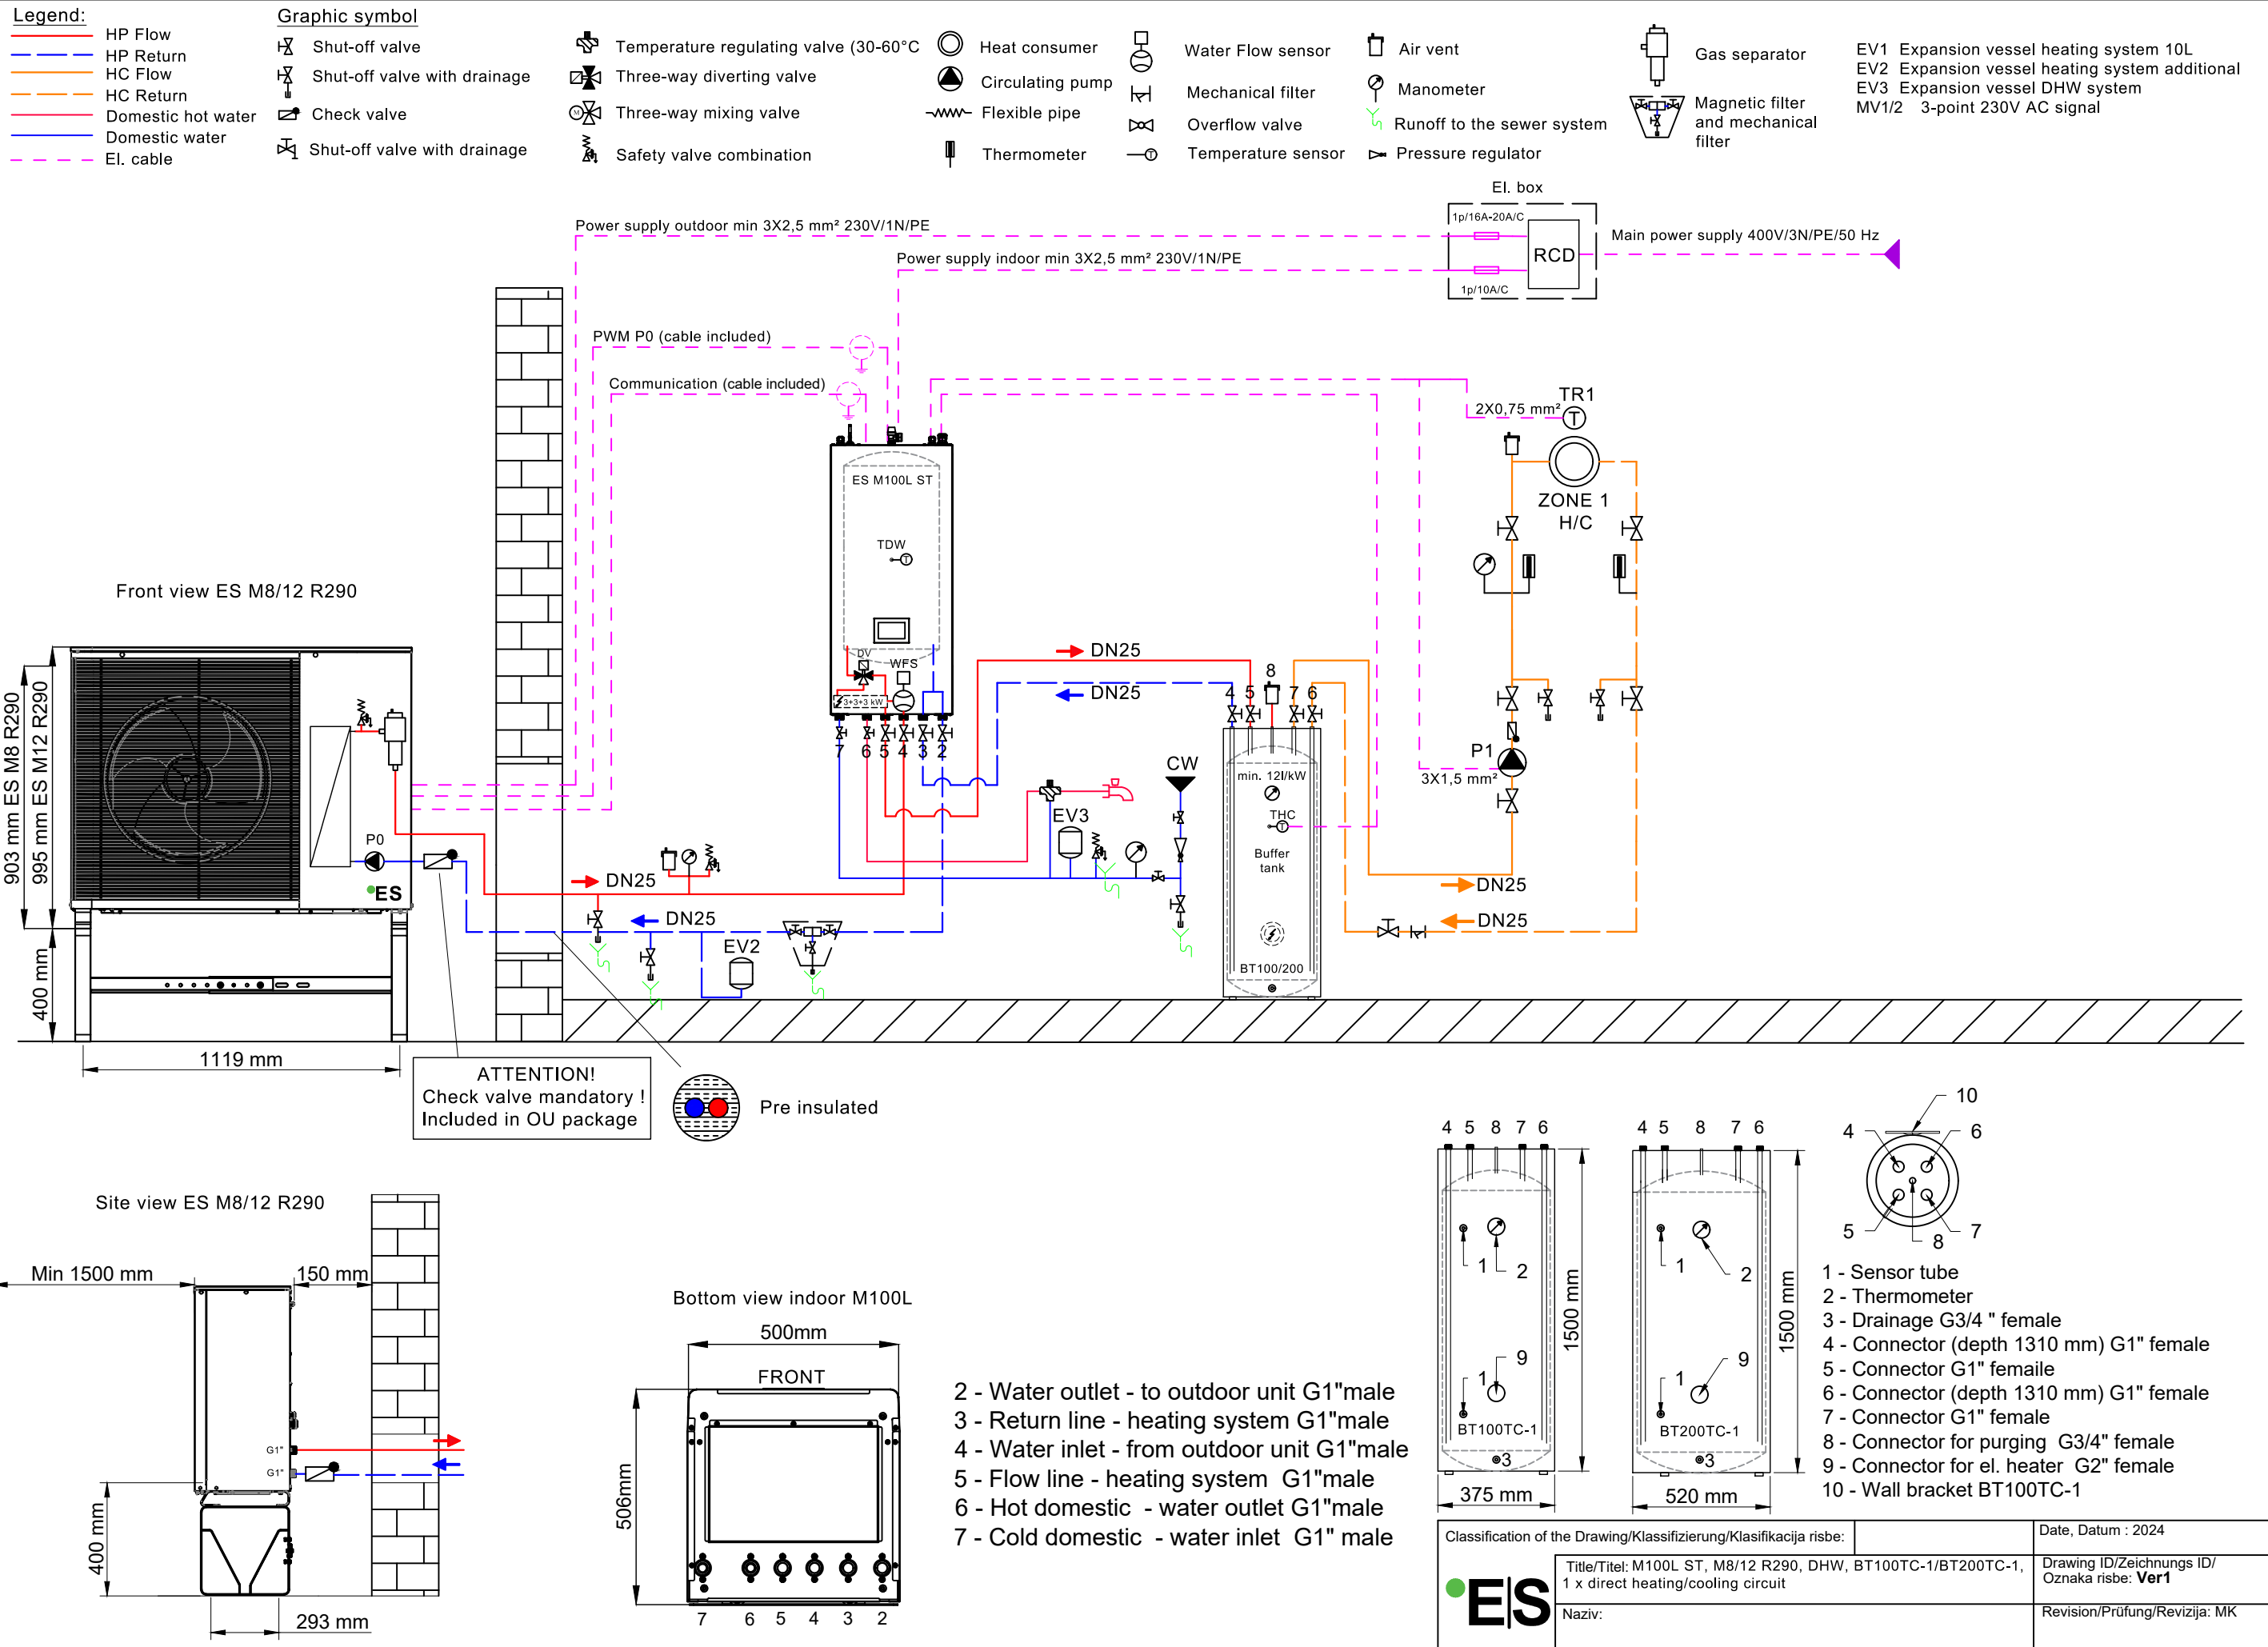



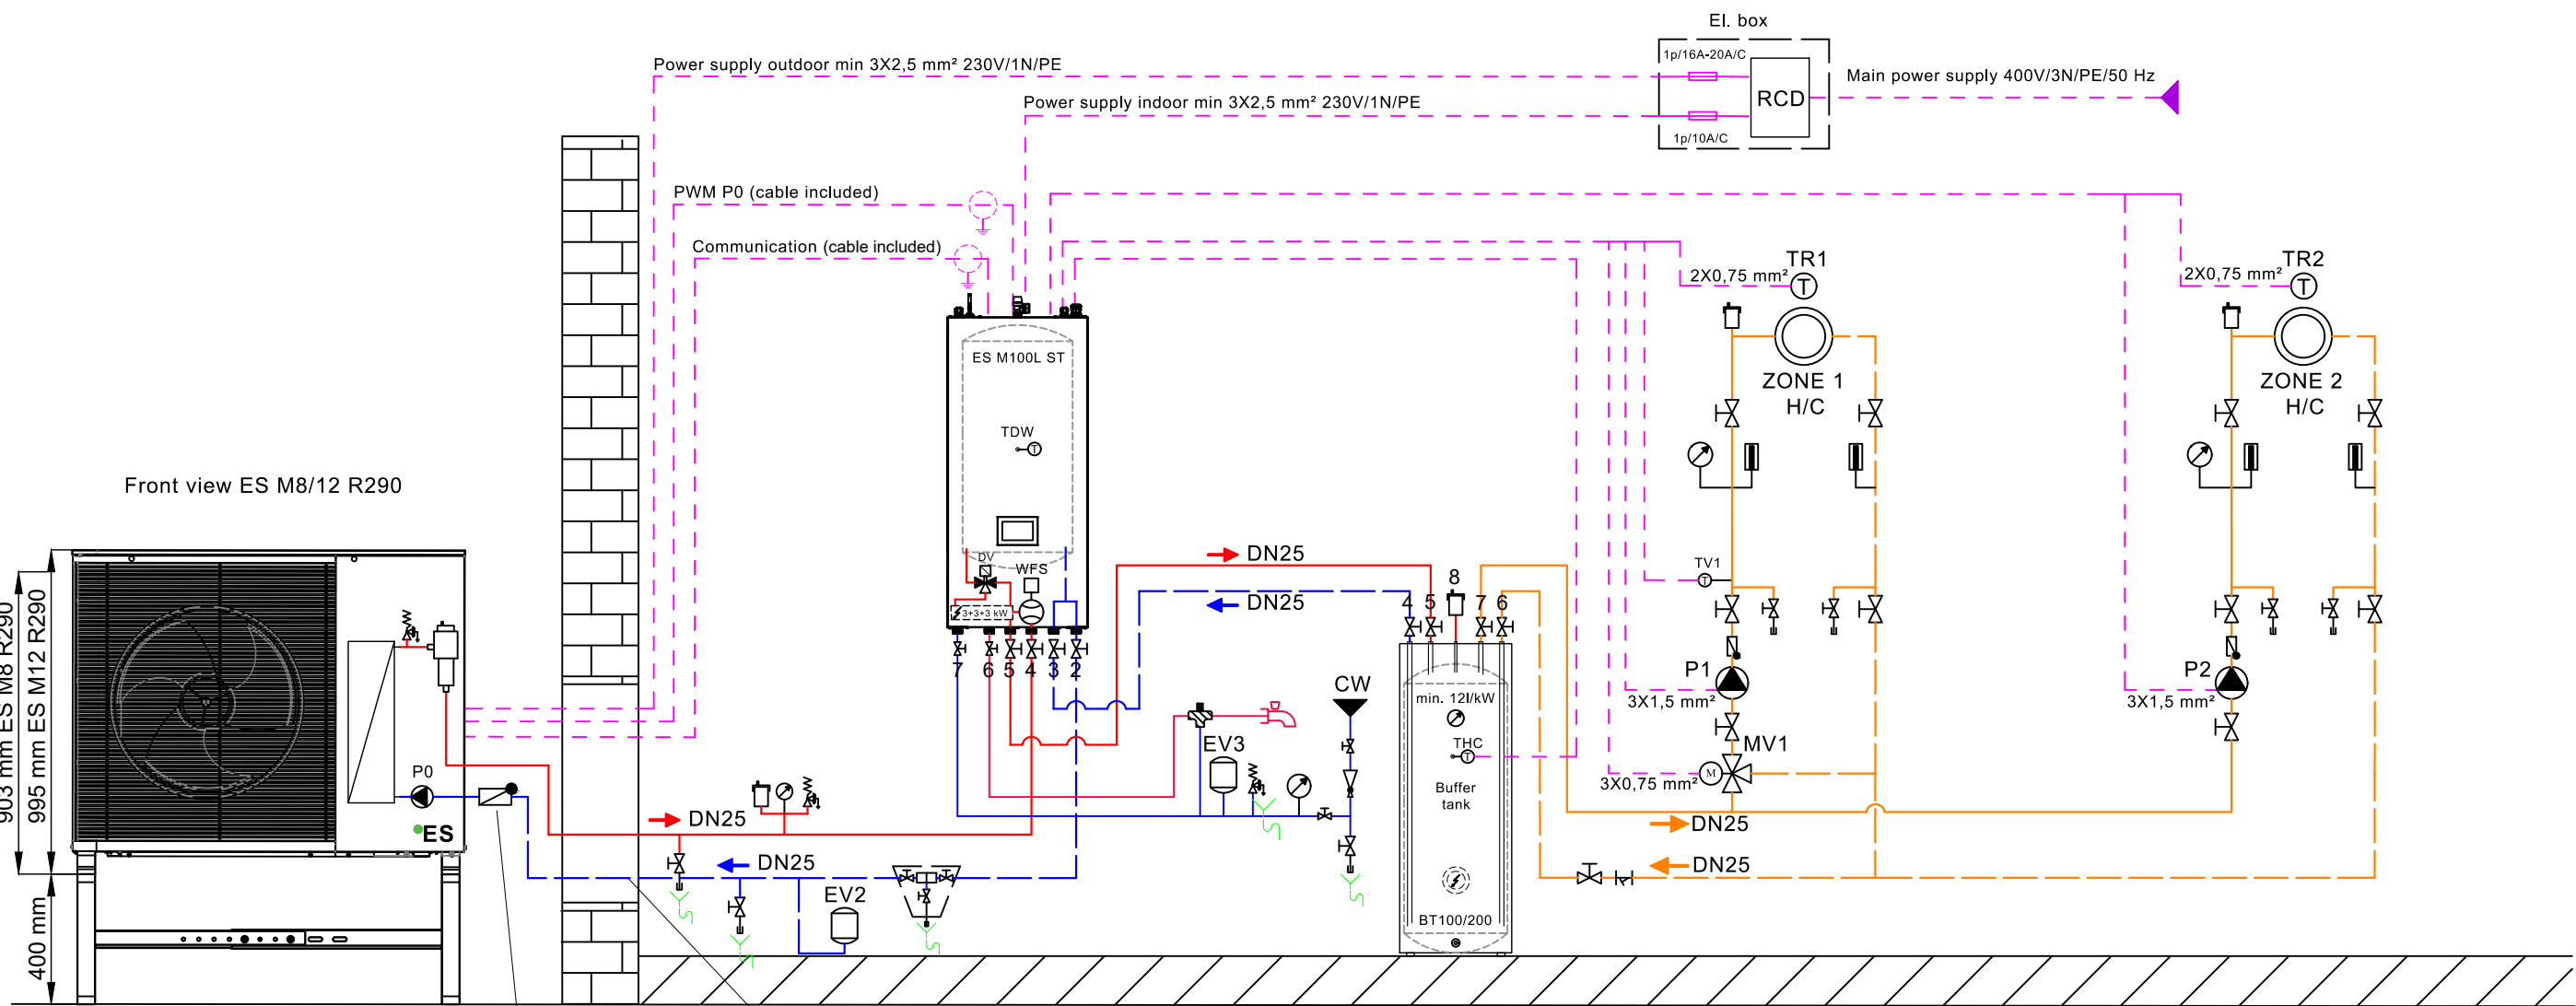


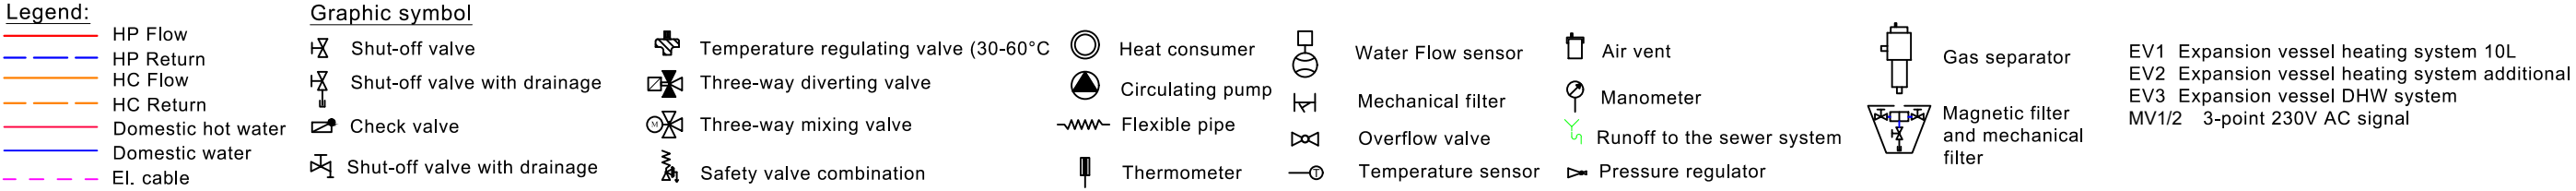

Front view ES M8/12 R290

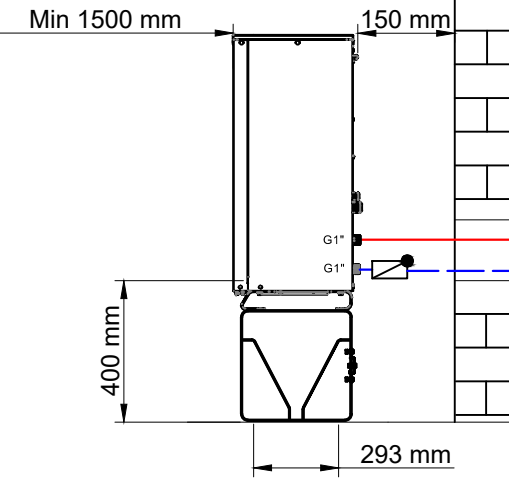


Site view ES M8/12 R290

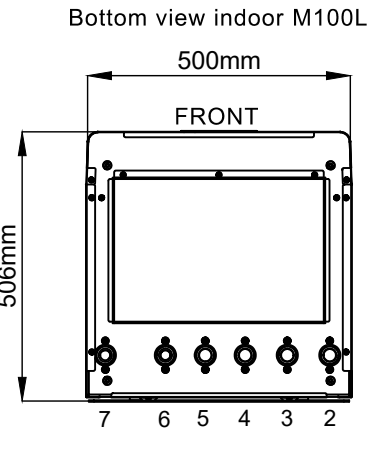



Bottom view indoor M100L


- 2 - Water outlet - to outdoor unit G1"male
- 3 - Return line - heating system G1"male
- 4 - Water inlet - from outdoor unit G1"male
- 5 - Flow line - heating system G1"male
- 6 - Hot domestic - water outlet G1"male
- 7 - Cold domestic - water inlet G1" male

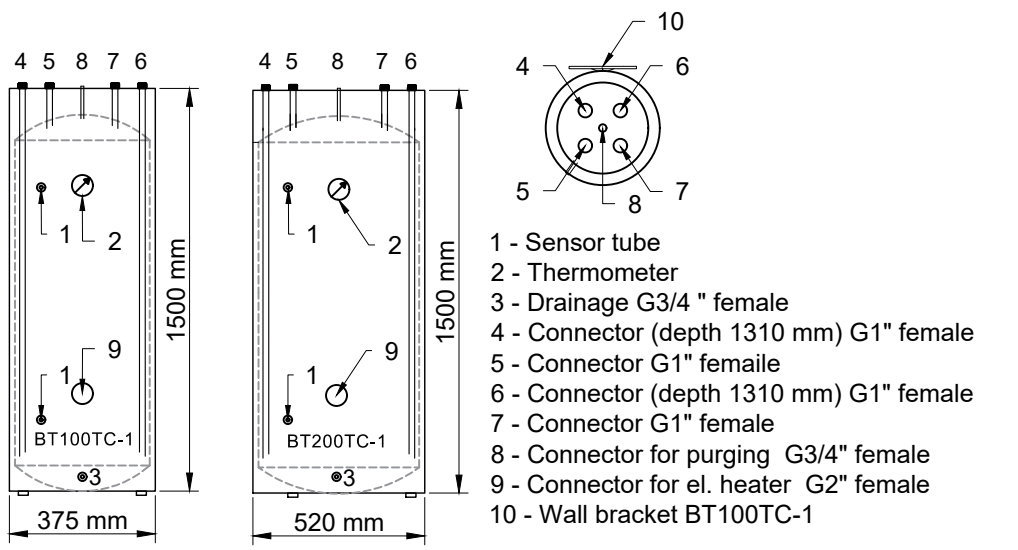



Classification of the Drawing/Klassifizierung/Klasifikacija risbe:	Date, Datum : 2024
ES Title/Title: M100L ST, M8/12 R290, DHW, BT100TC-1/BT200TC-1, 1 x mixing heating/cooling circuit, 1 x direct heating/cooling circuit Naziv:	Drawing ID/Zeichnungs ID/ Oznaka risbe: Ver1 Revision/Prüfung/Revizija: MK

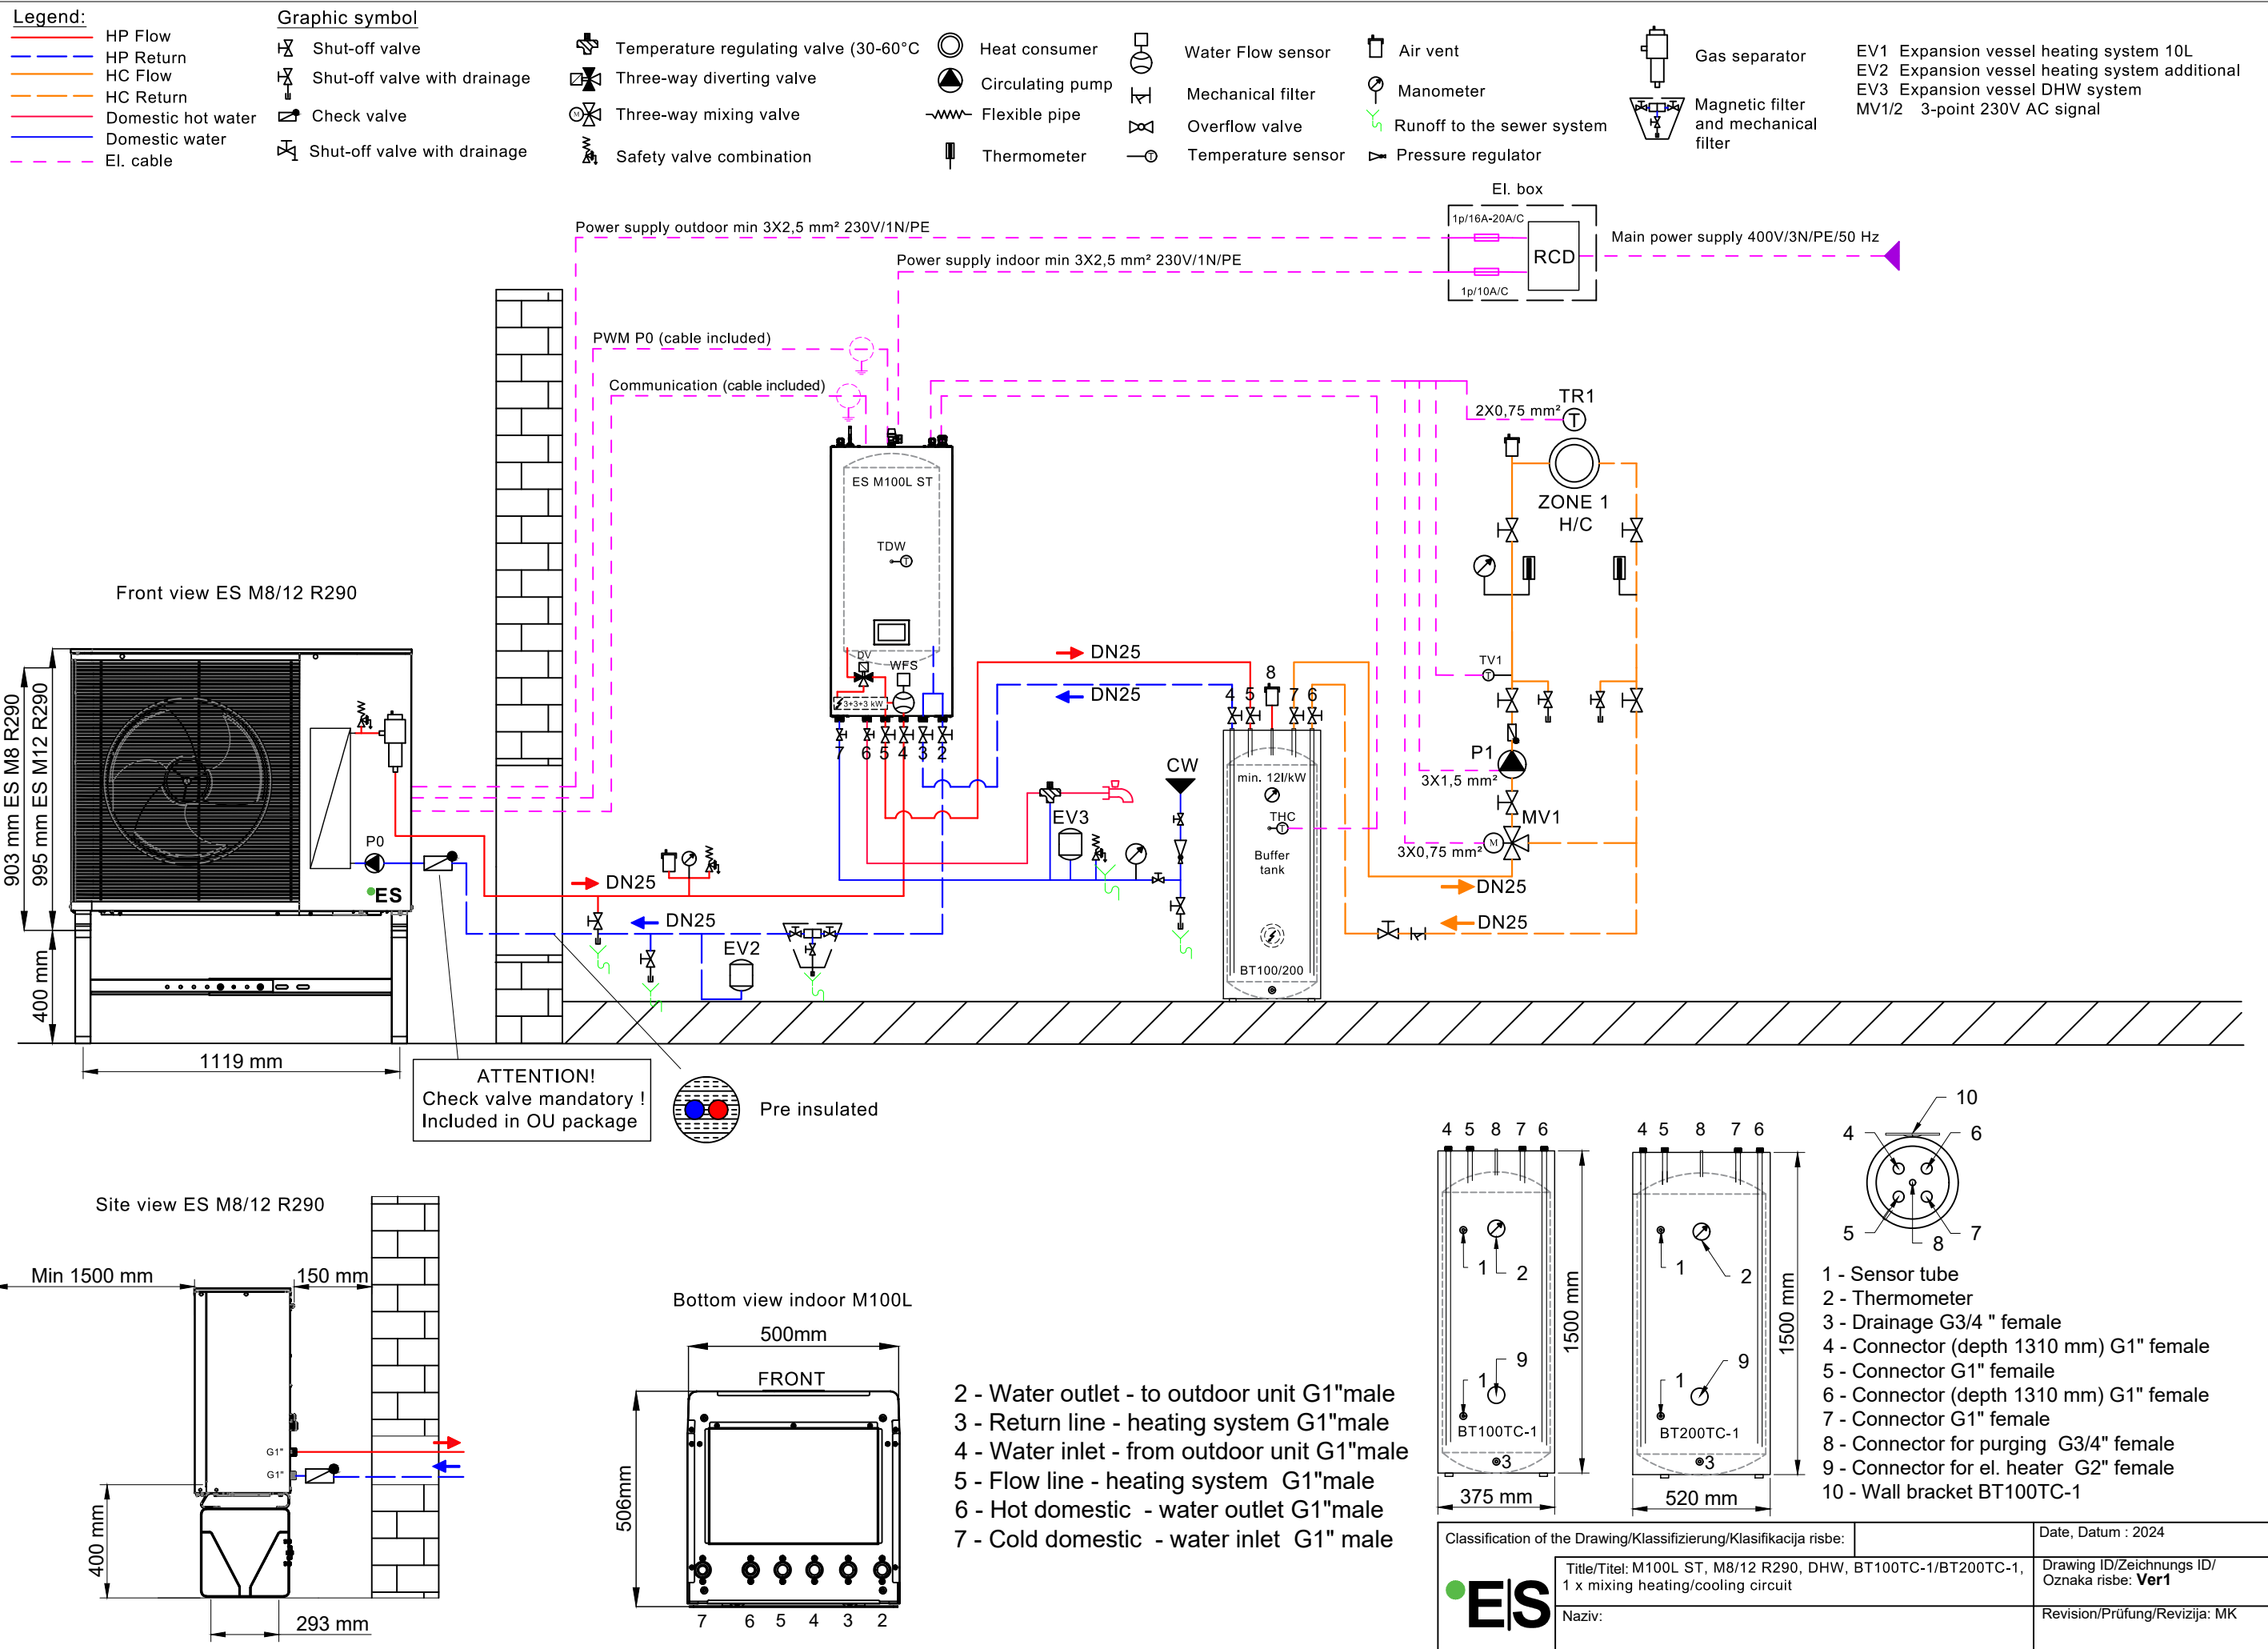


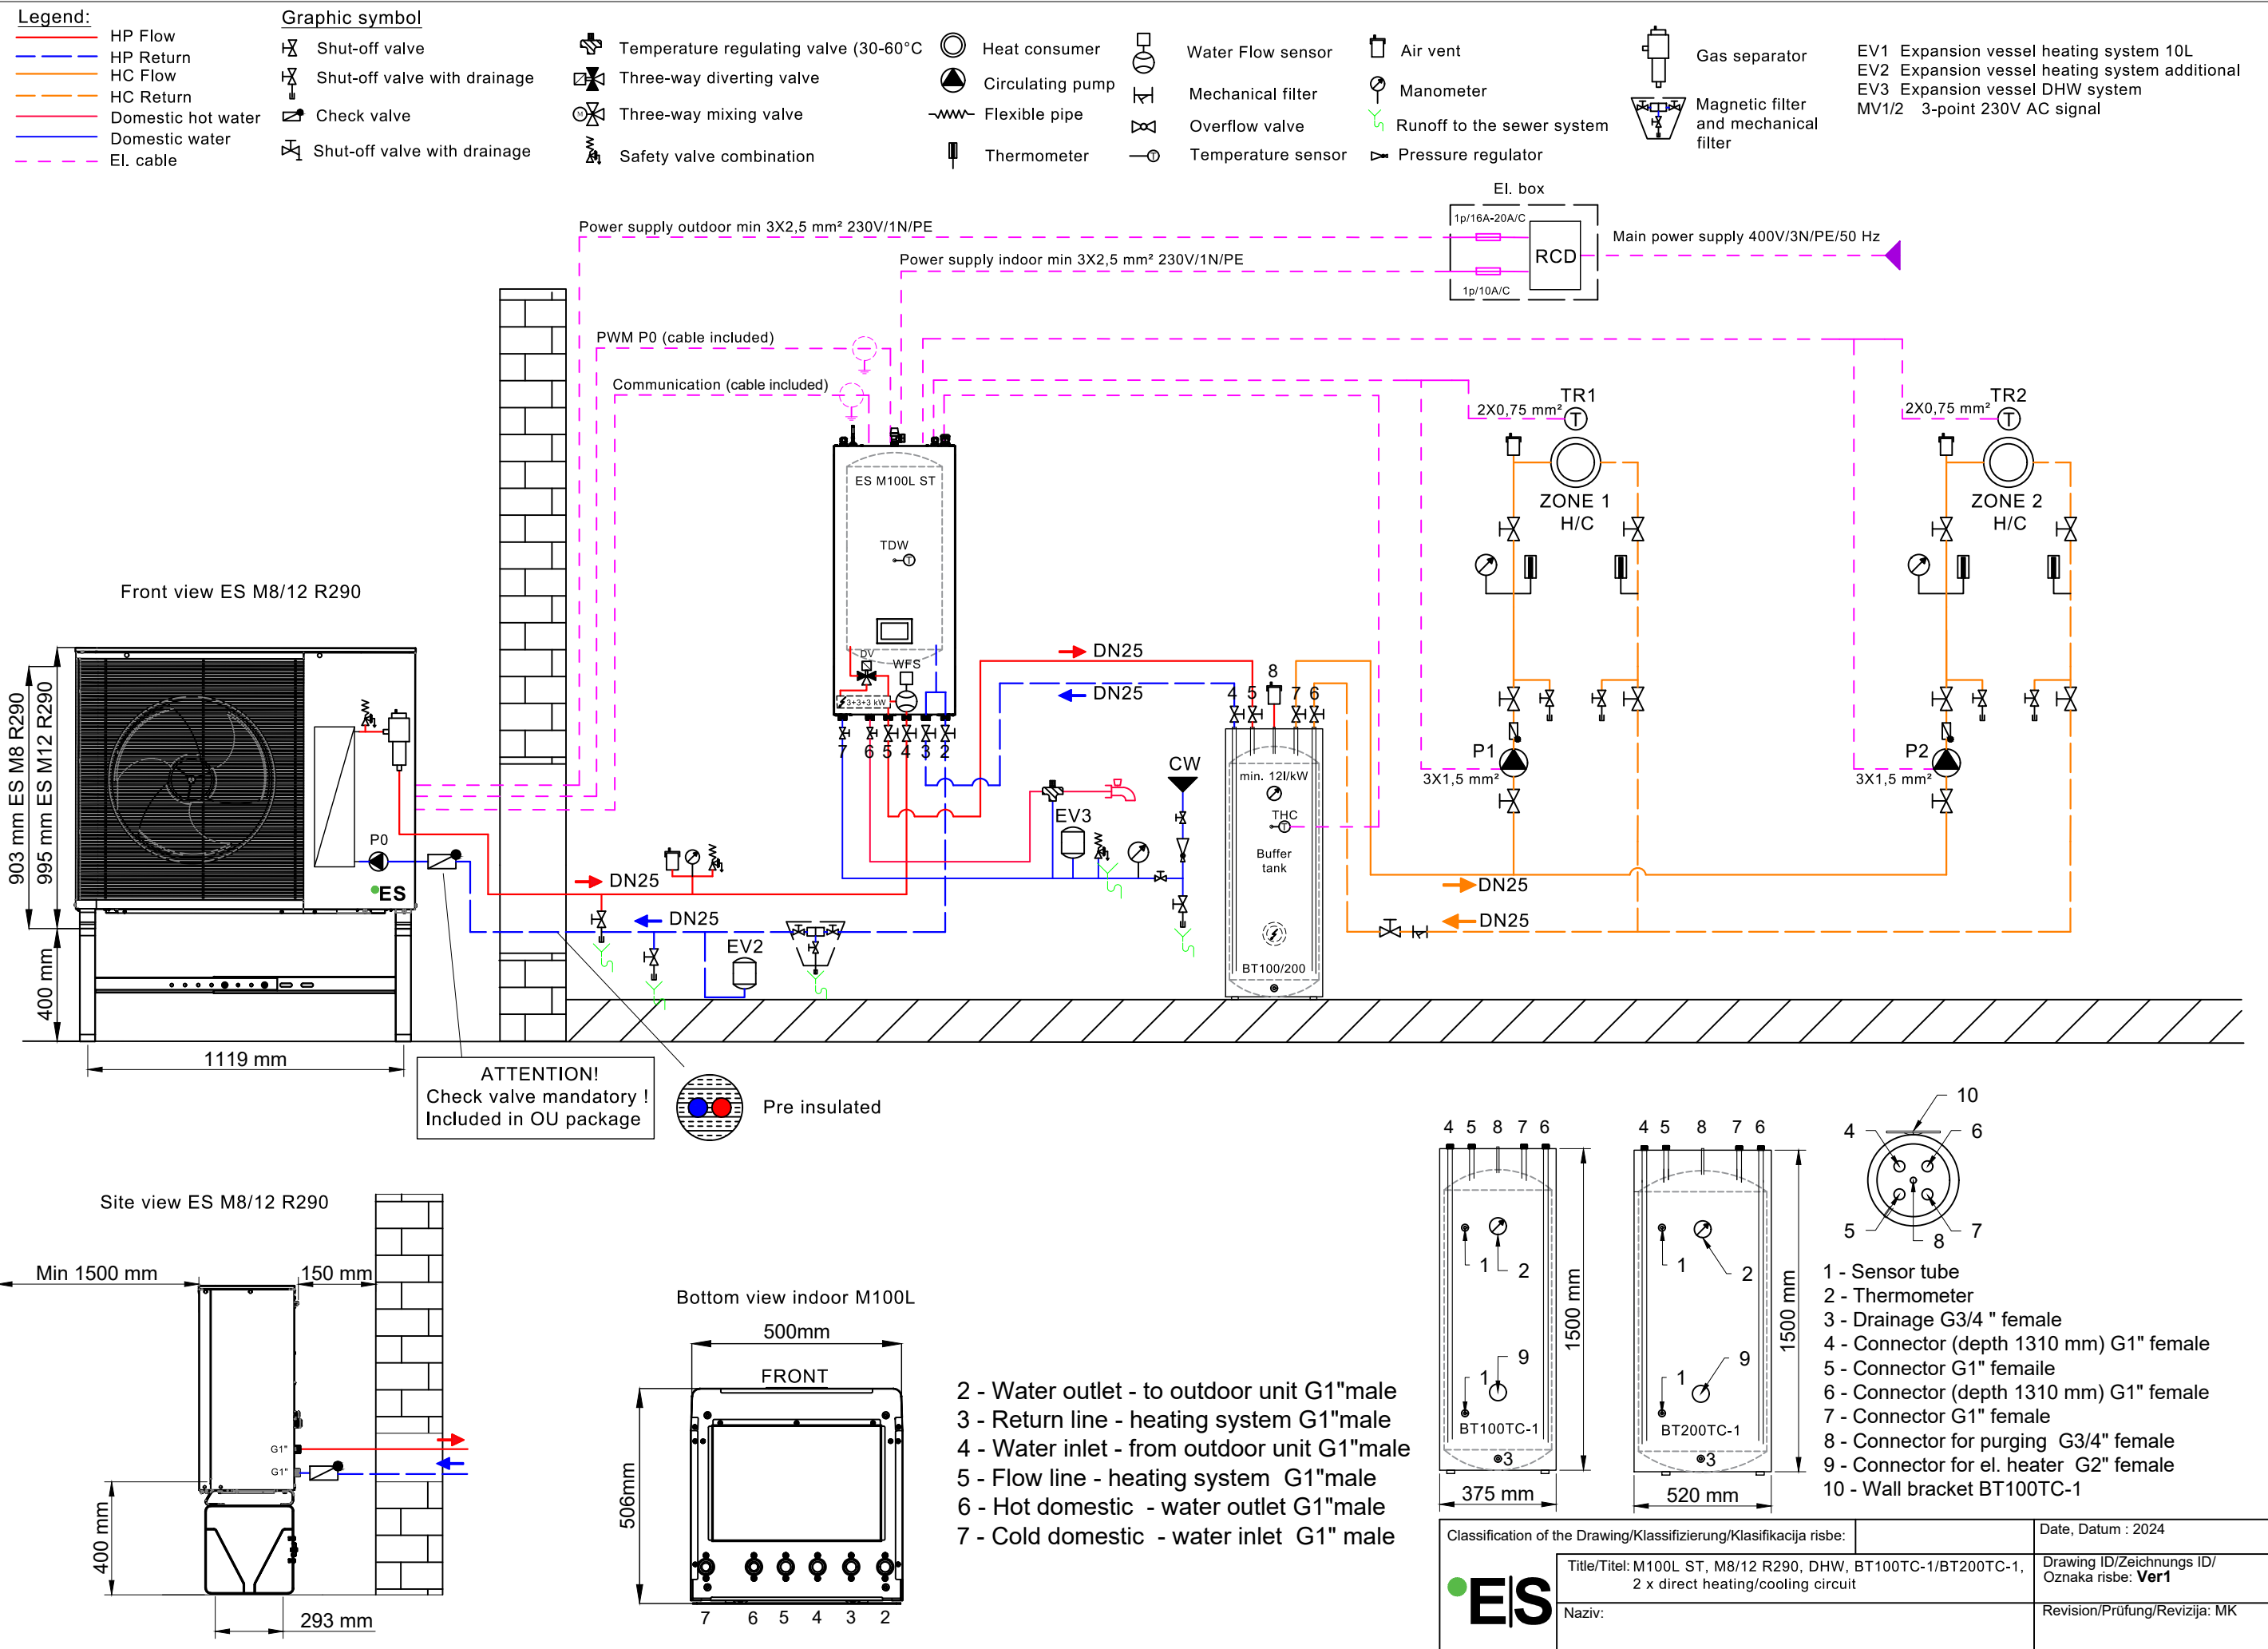


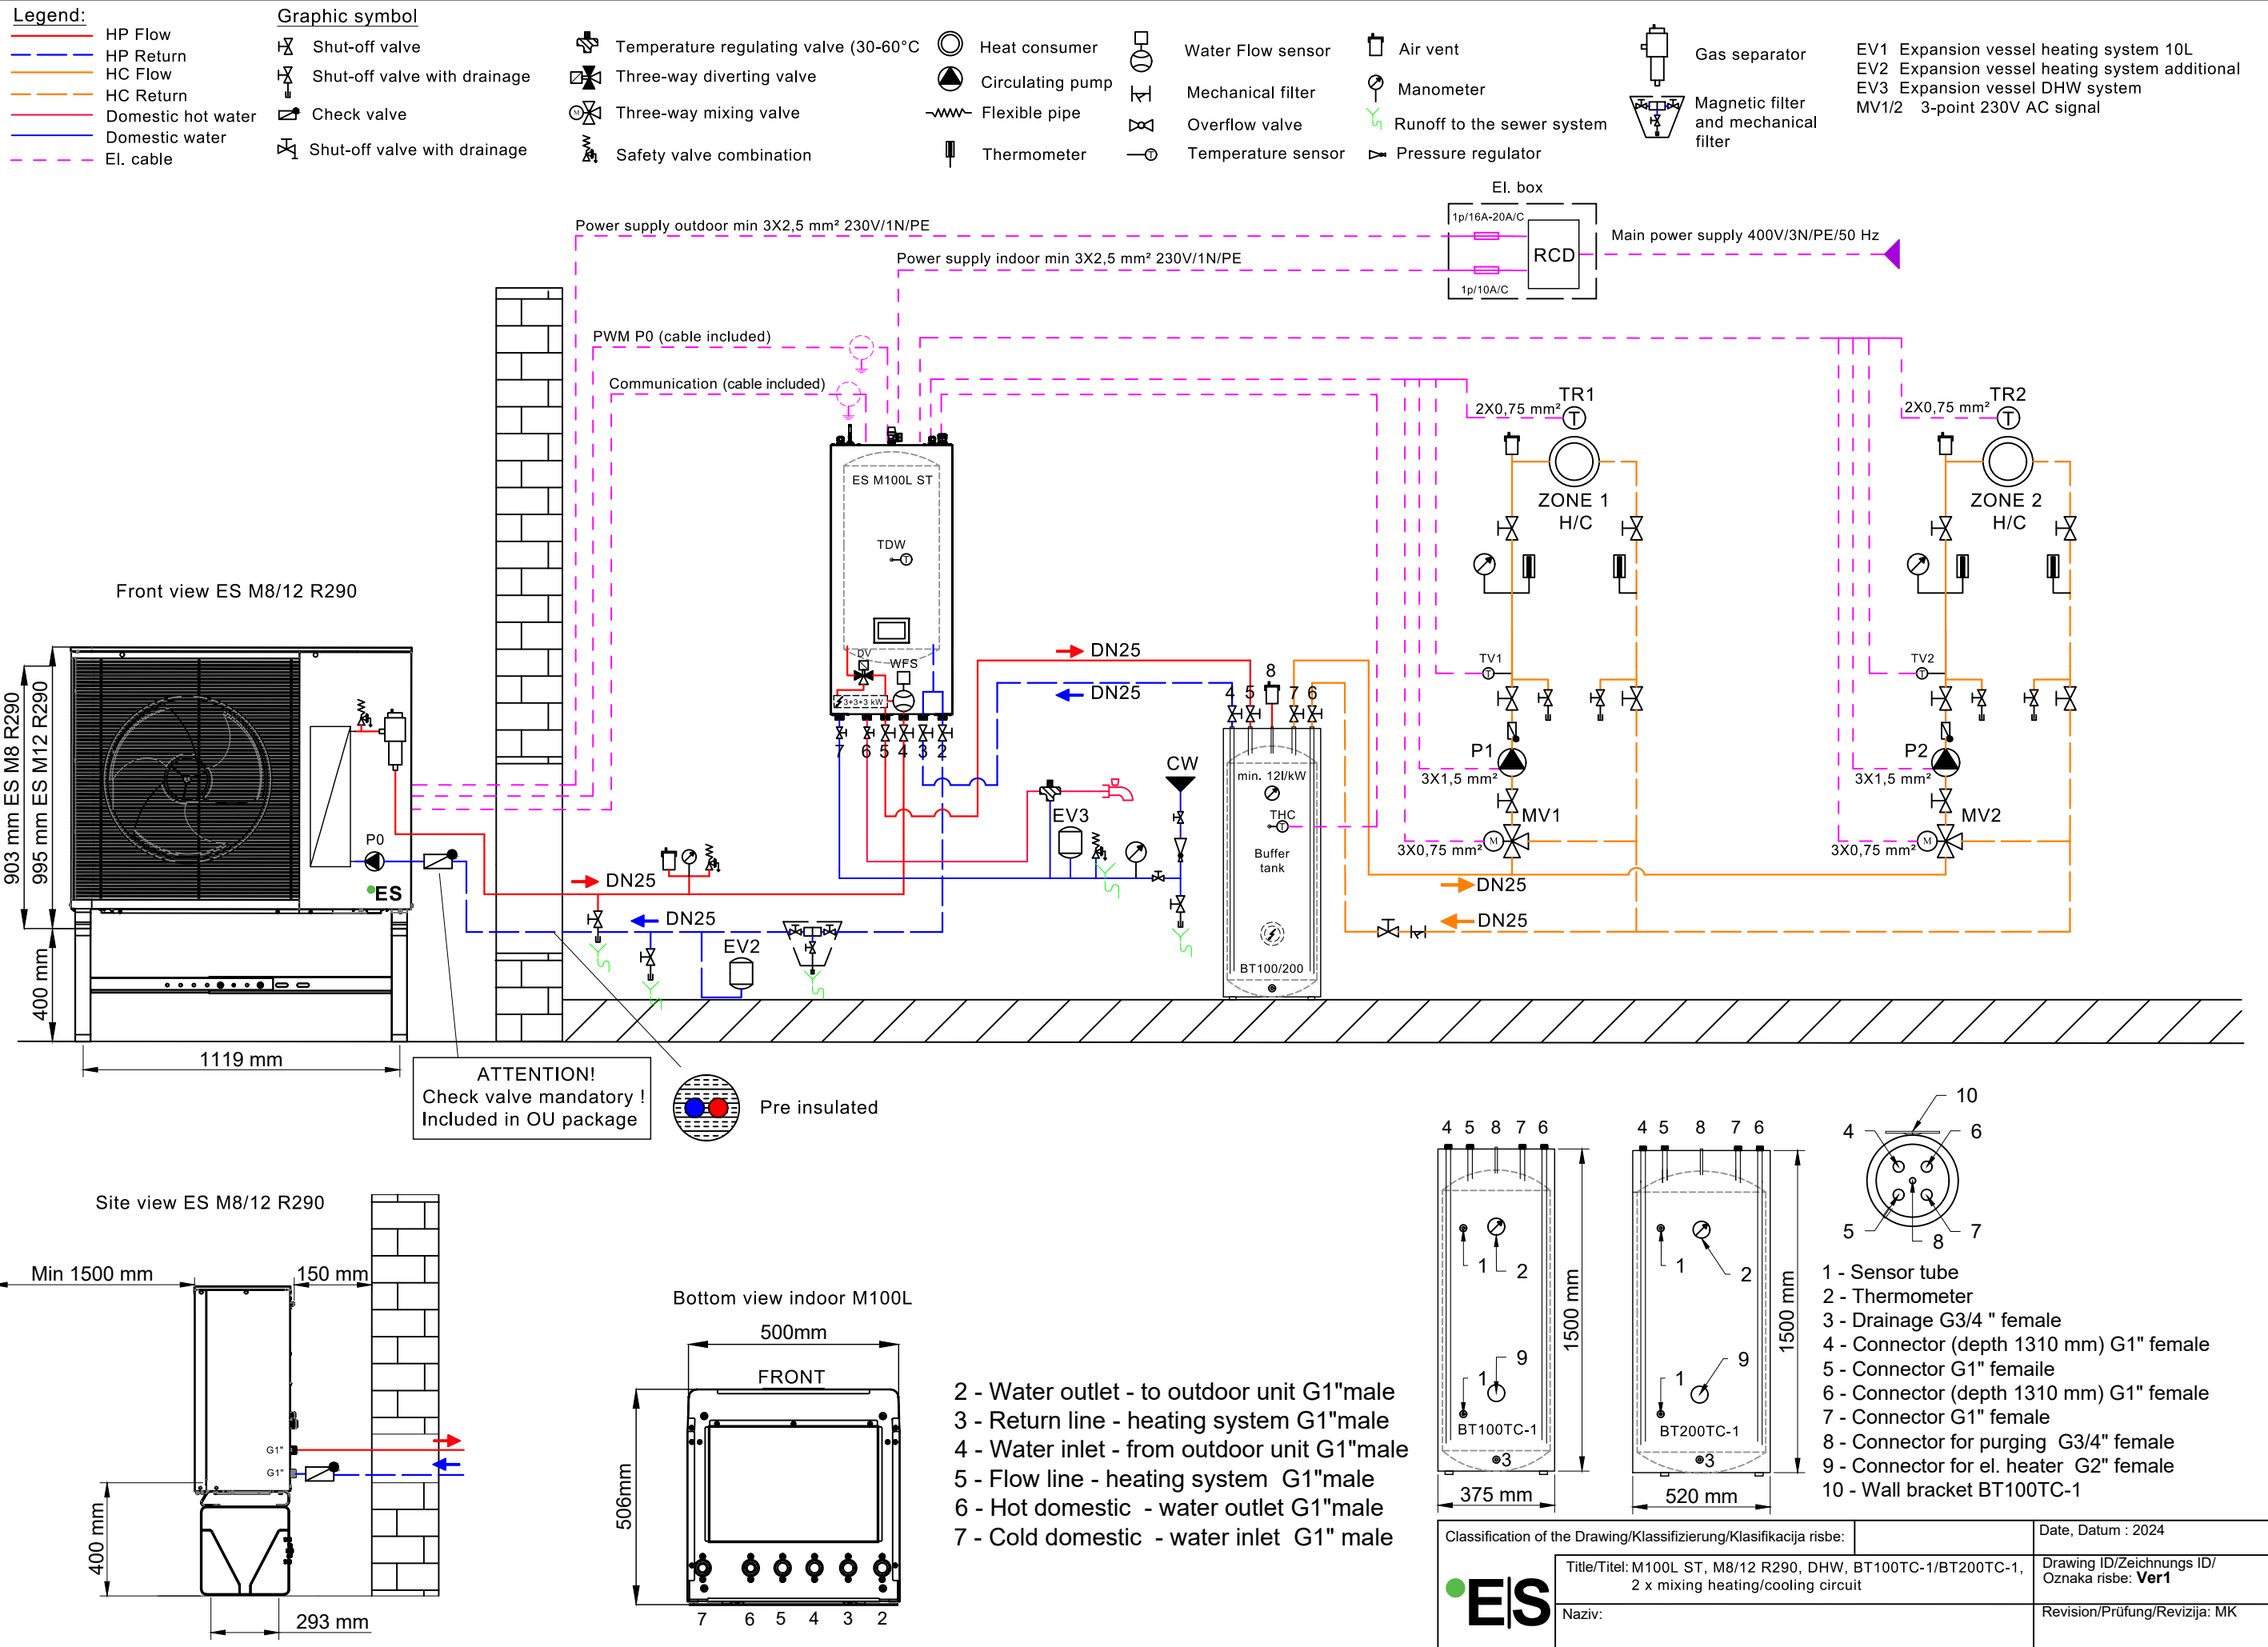


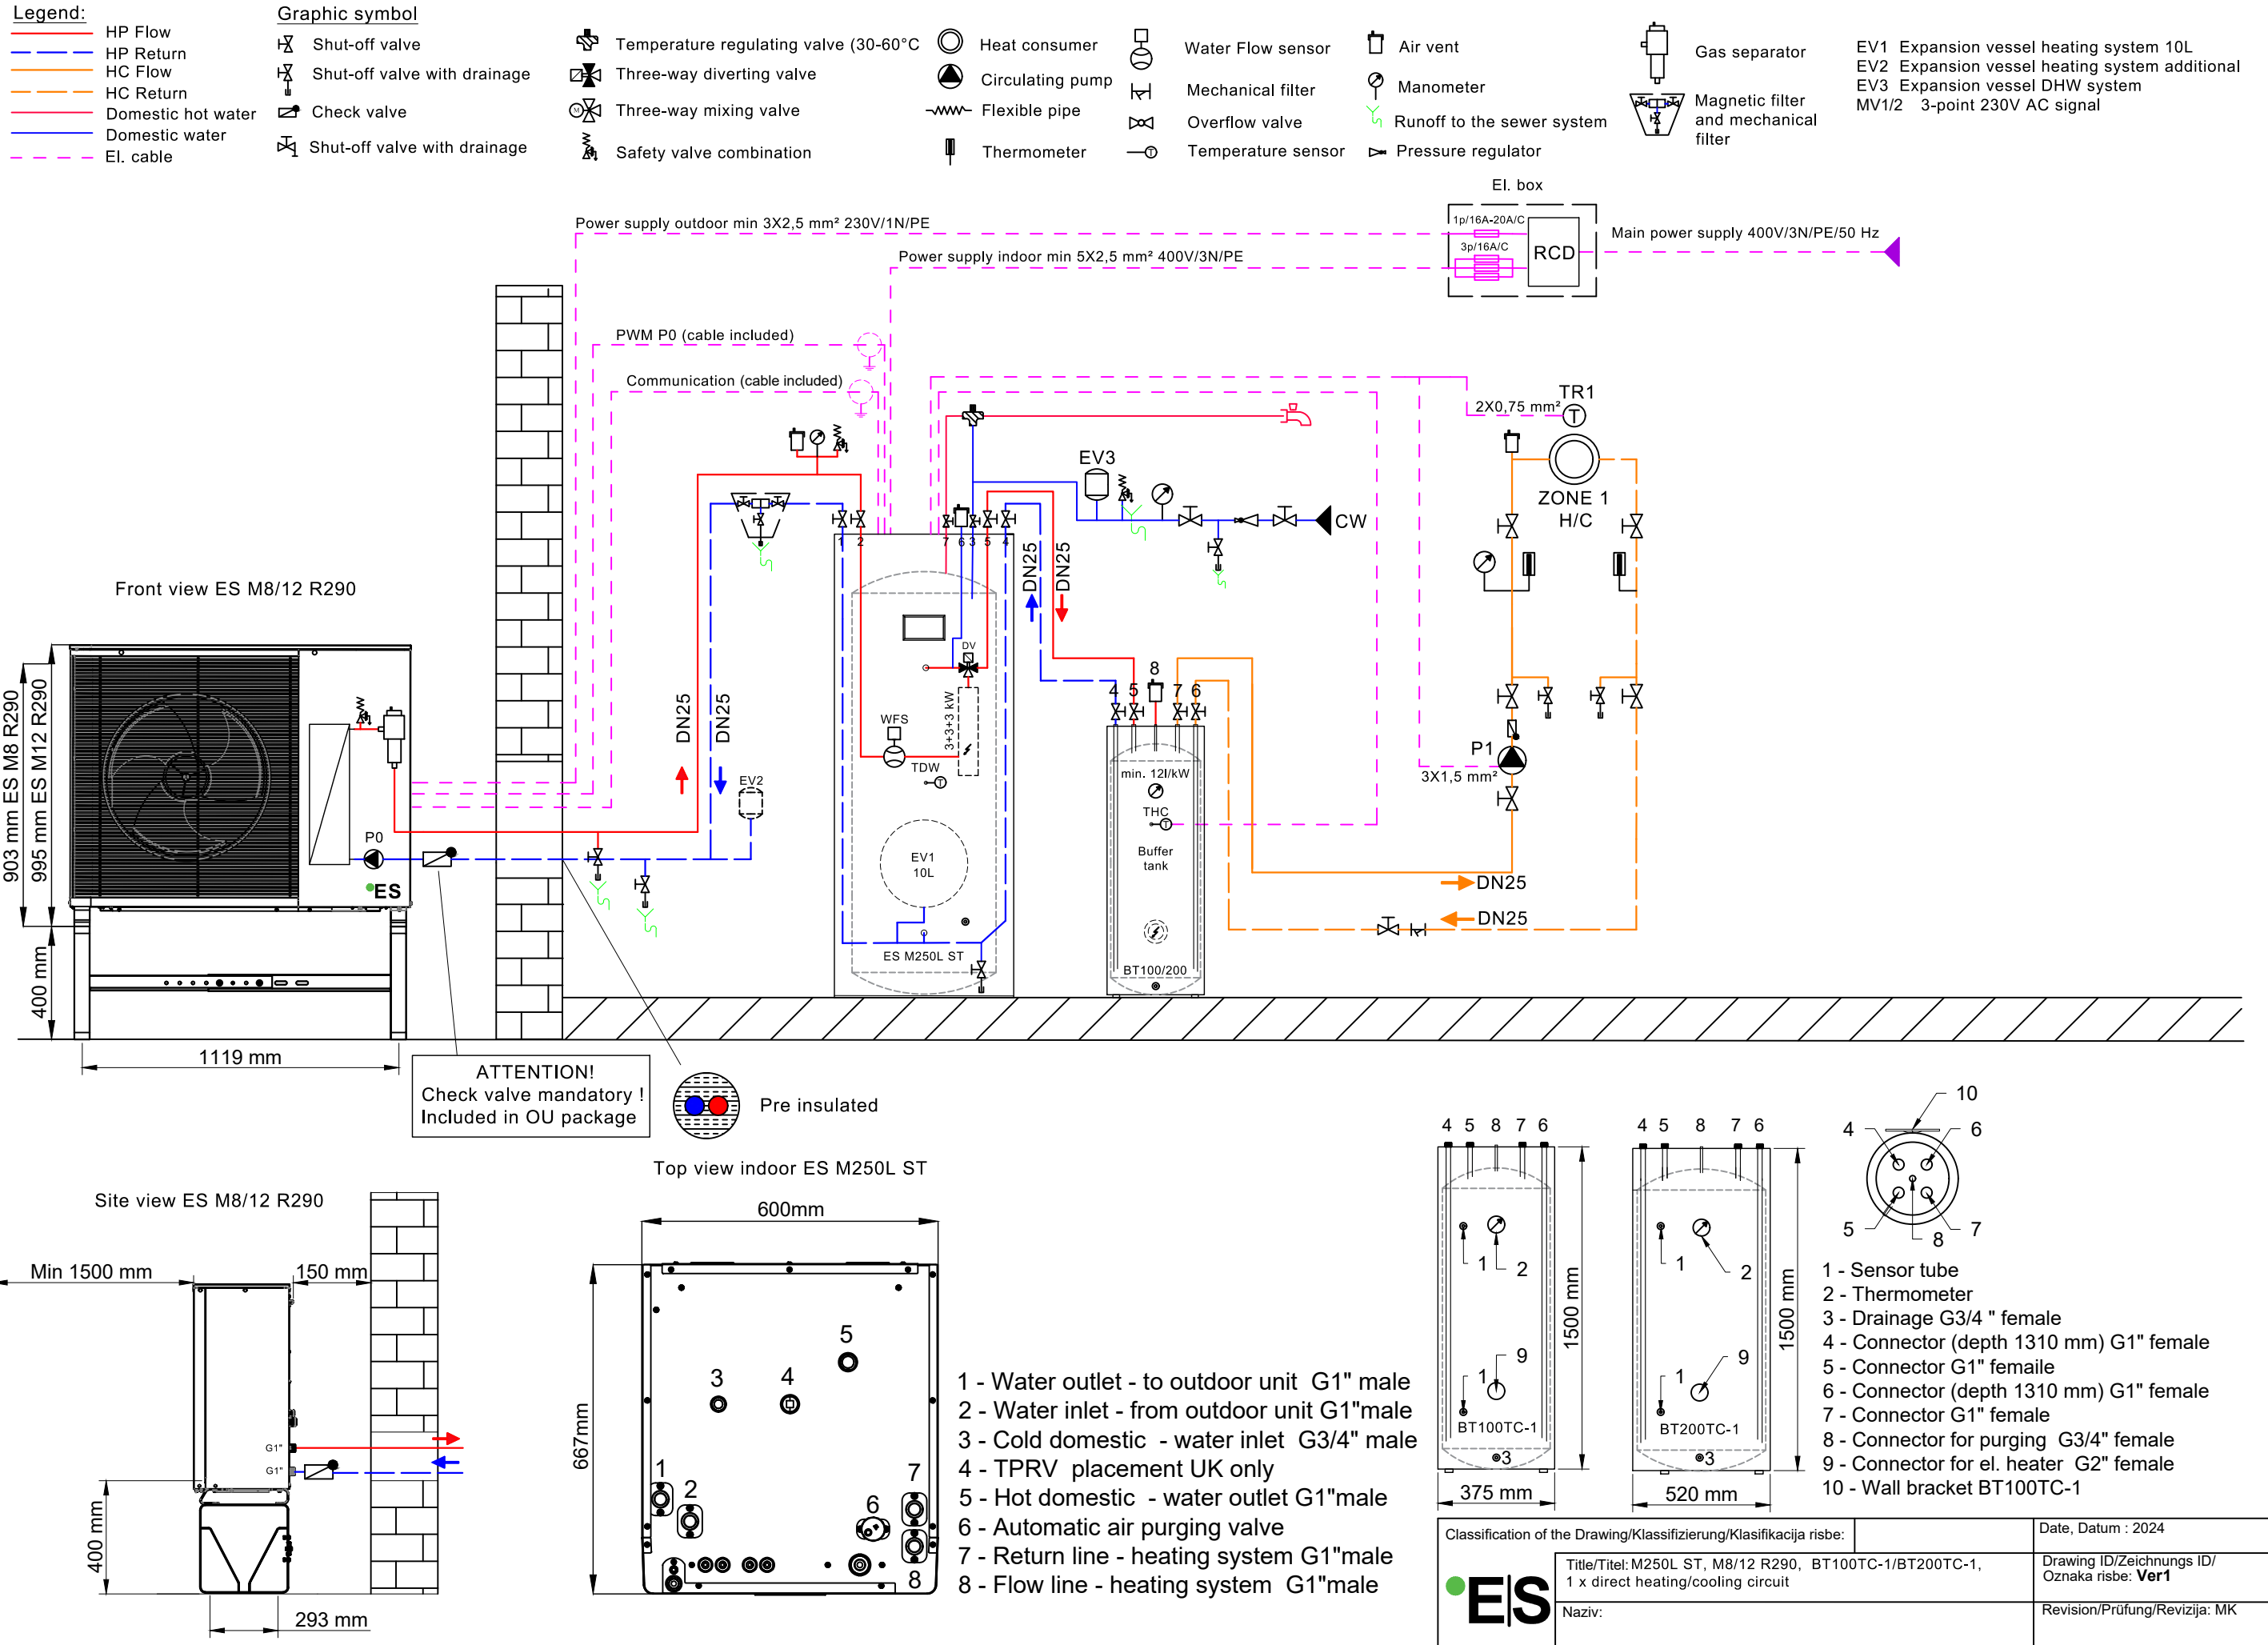


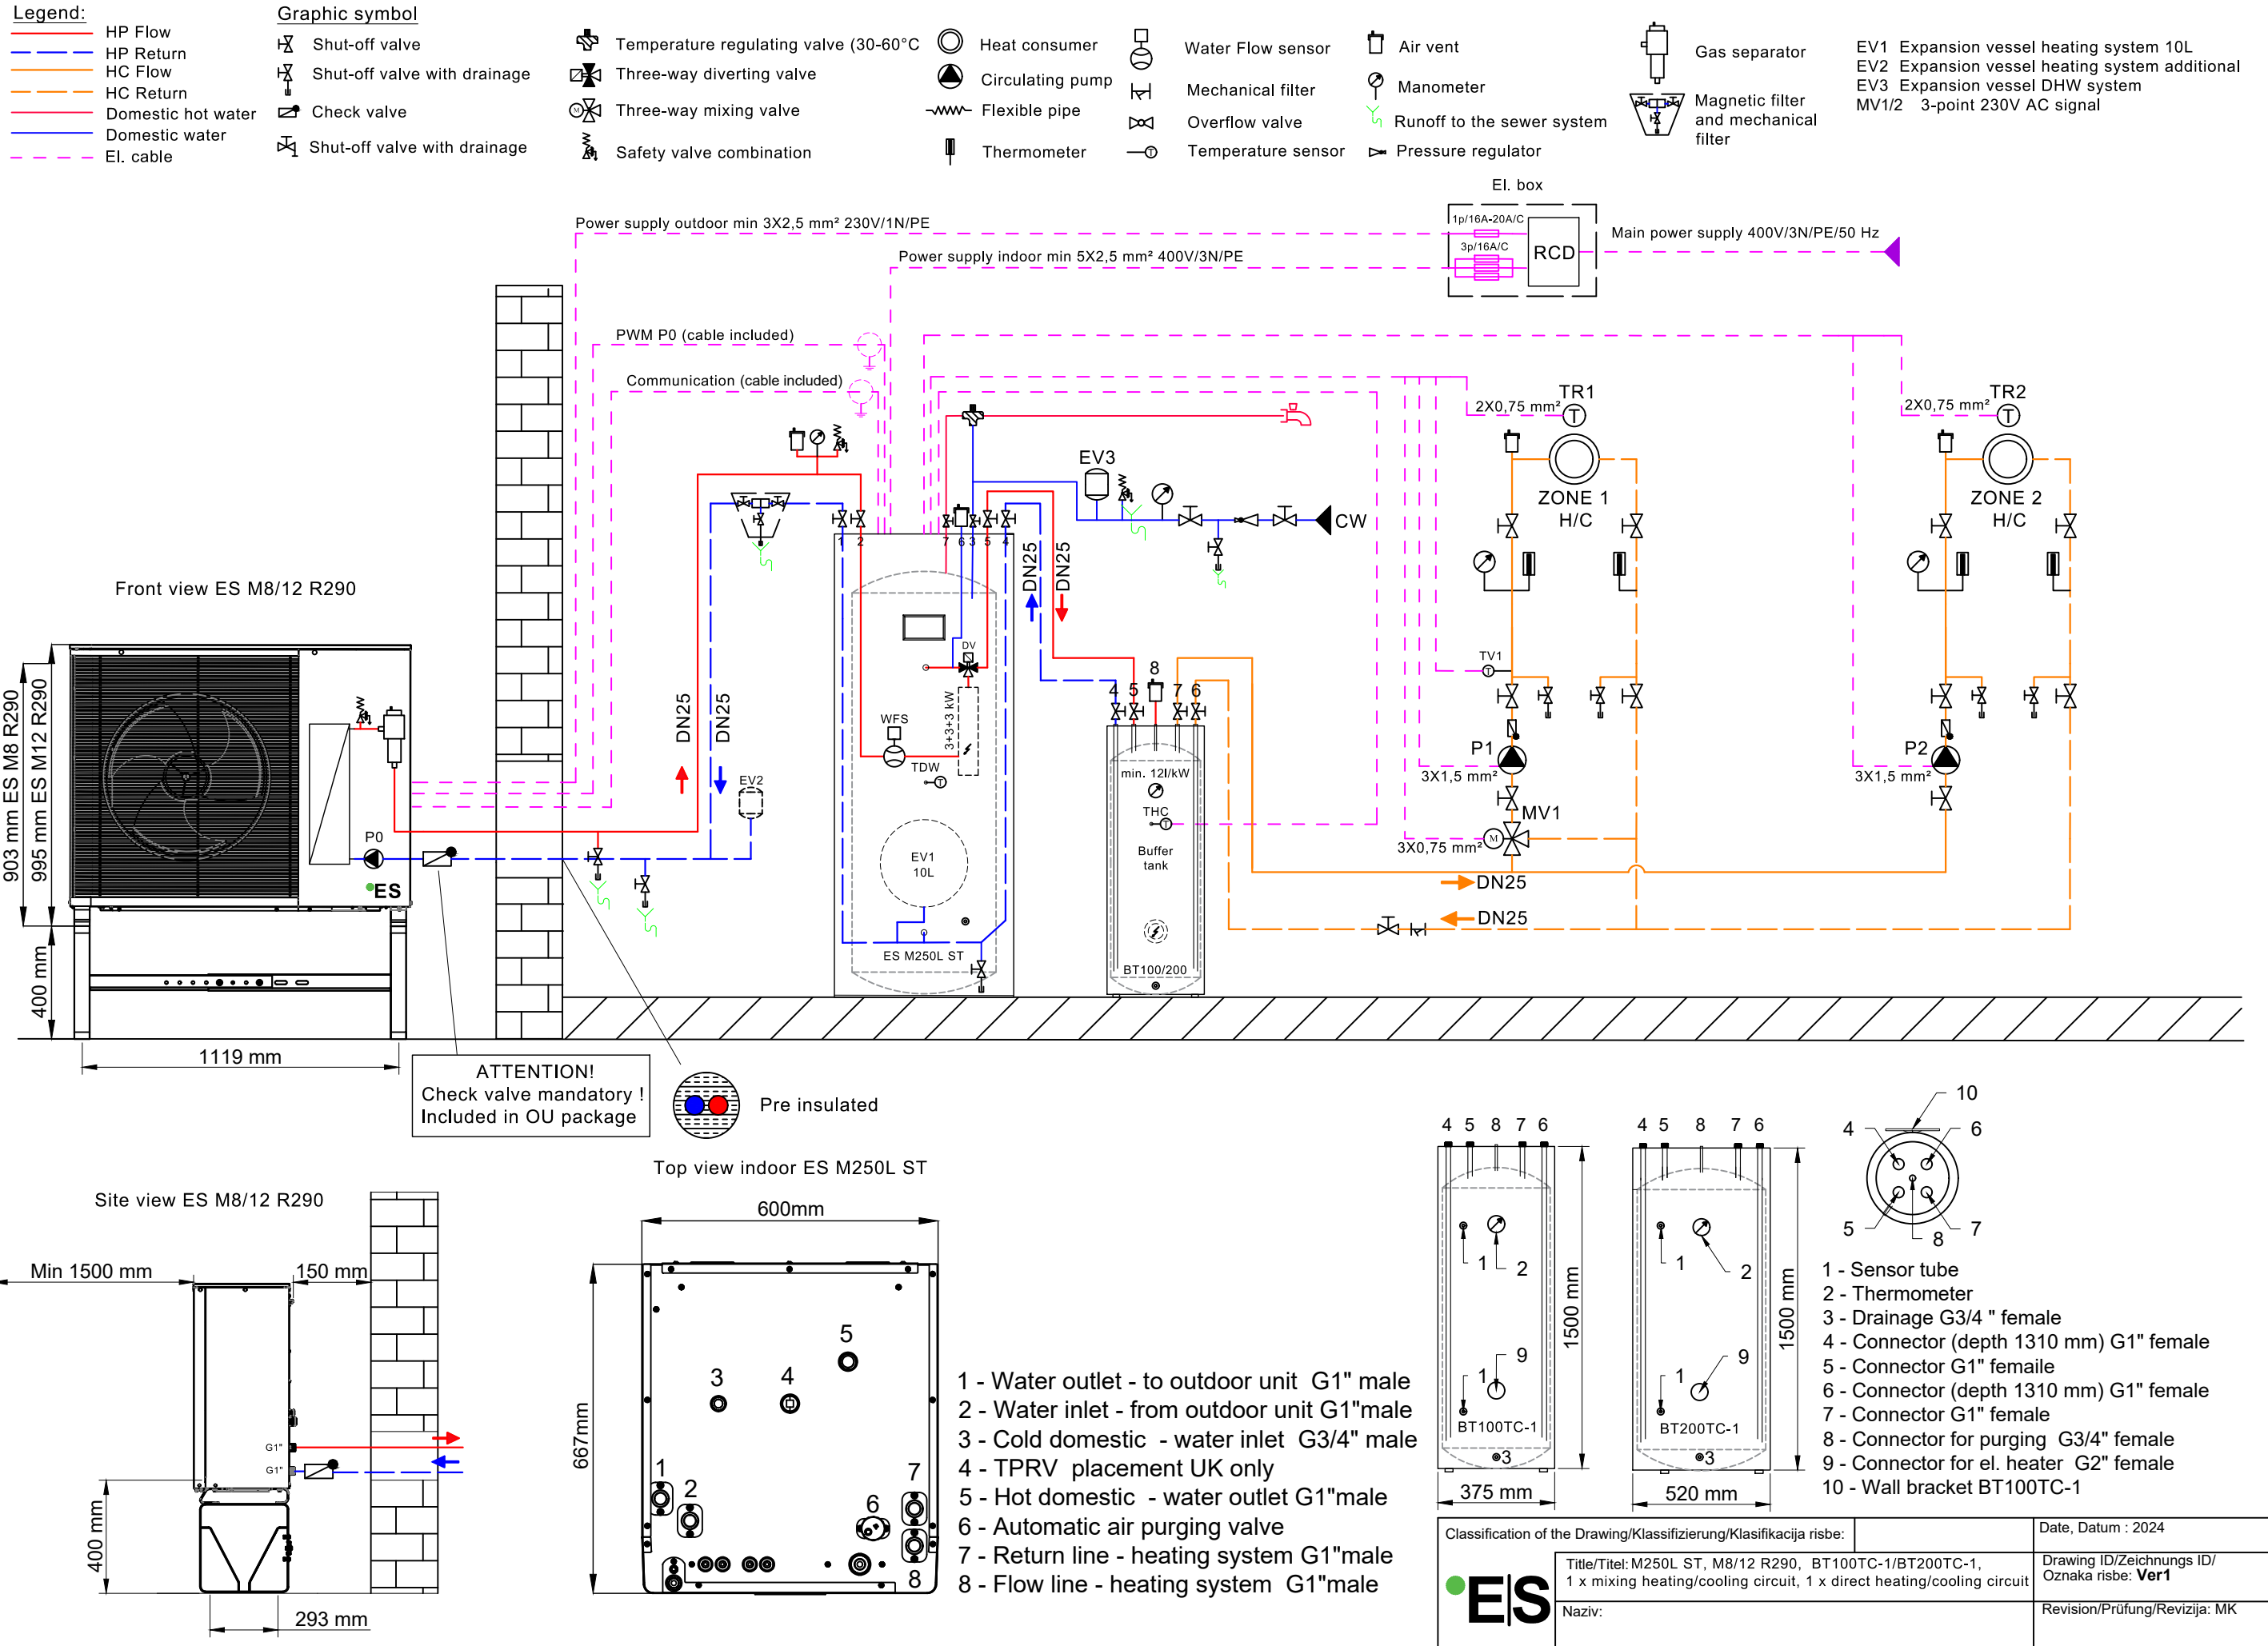


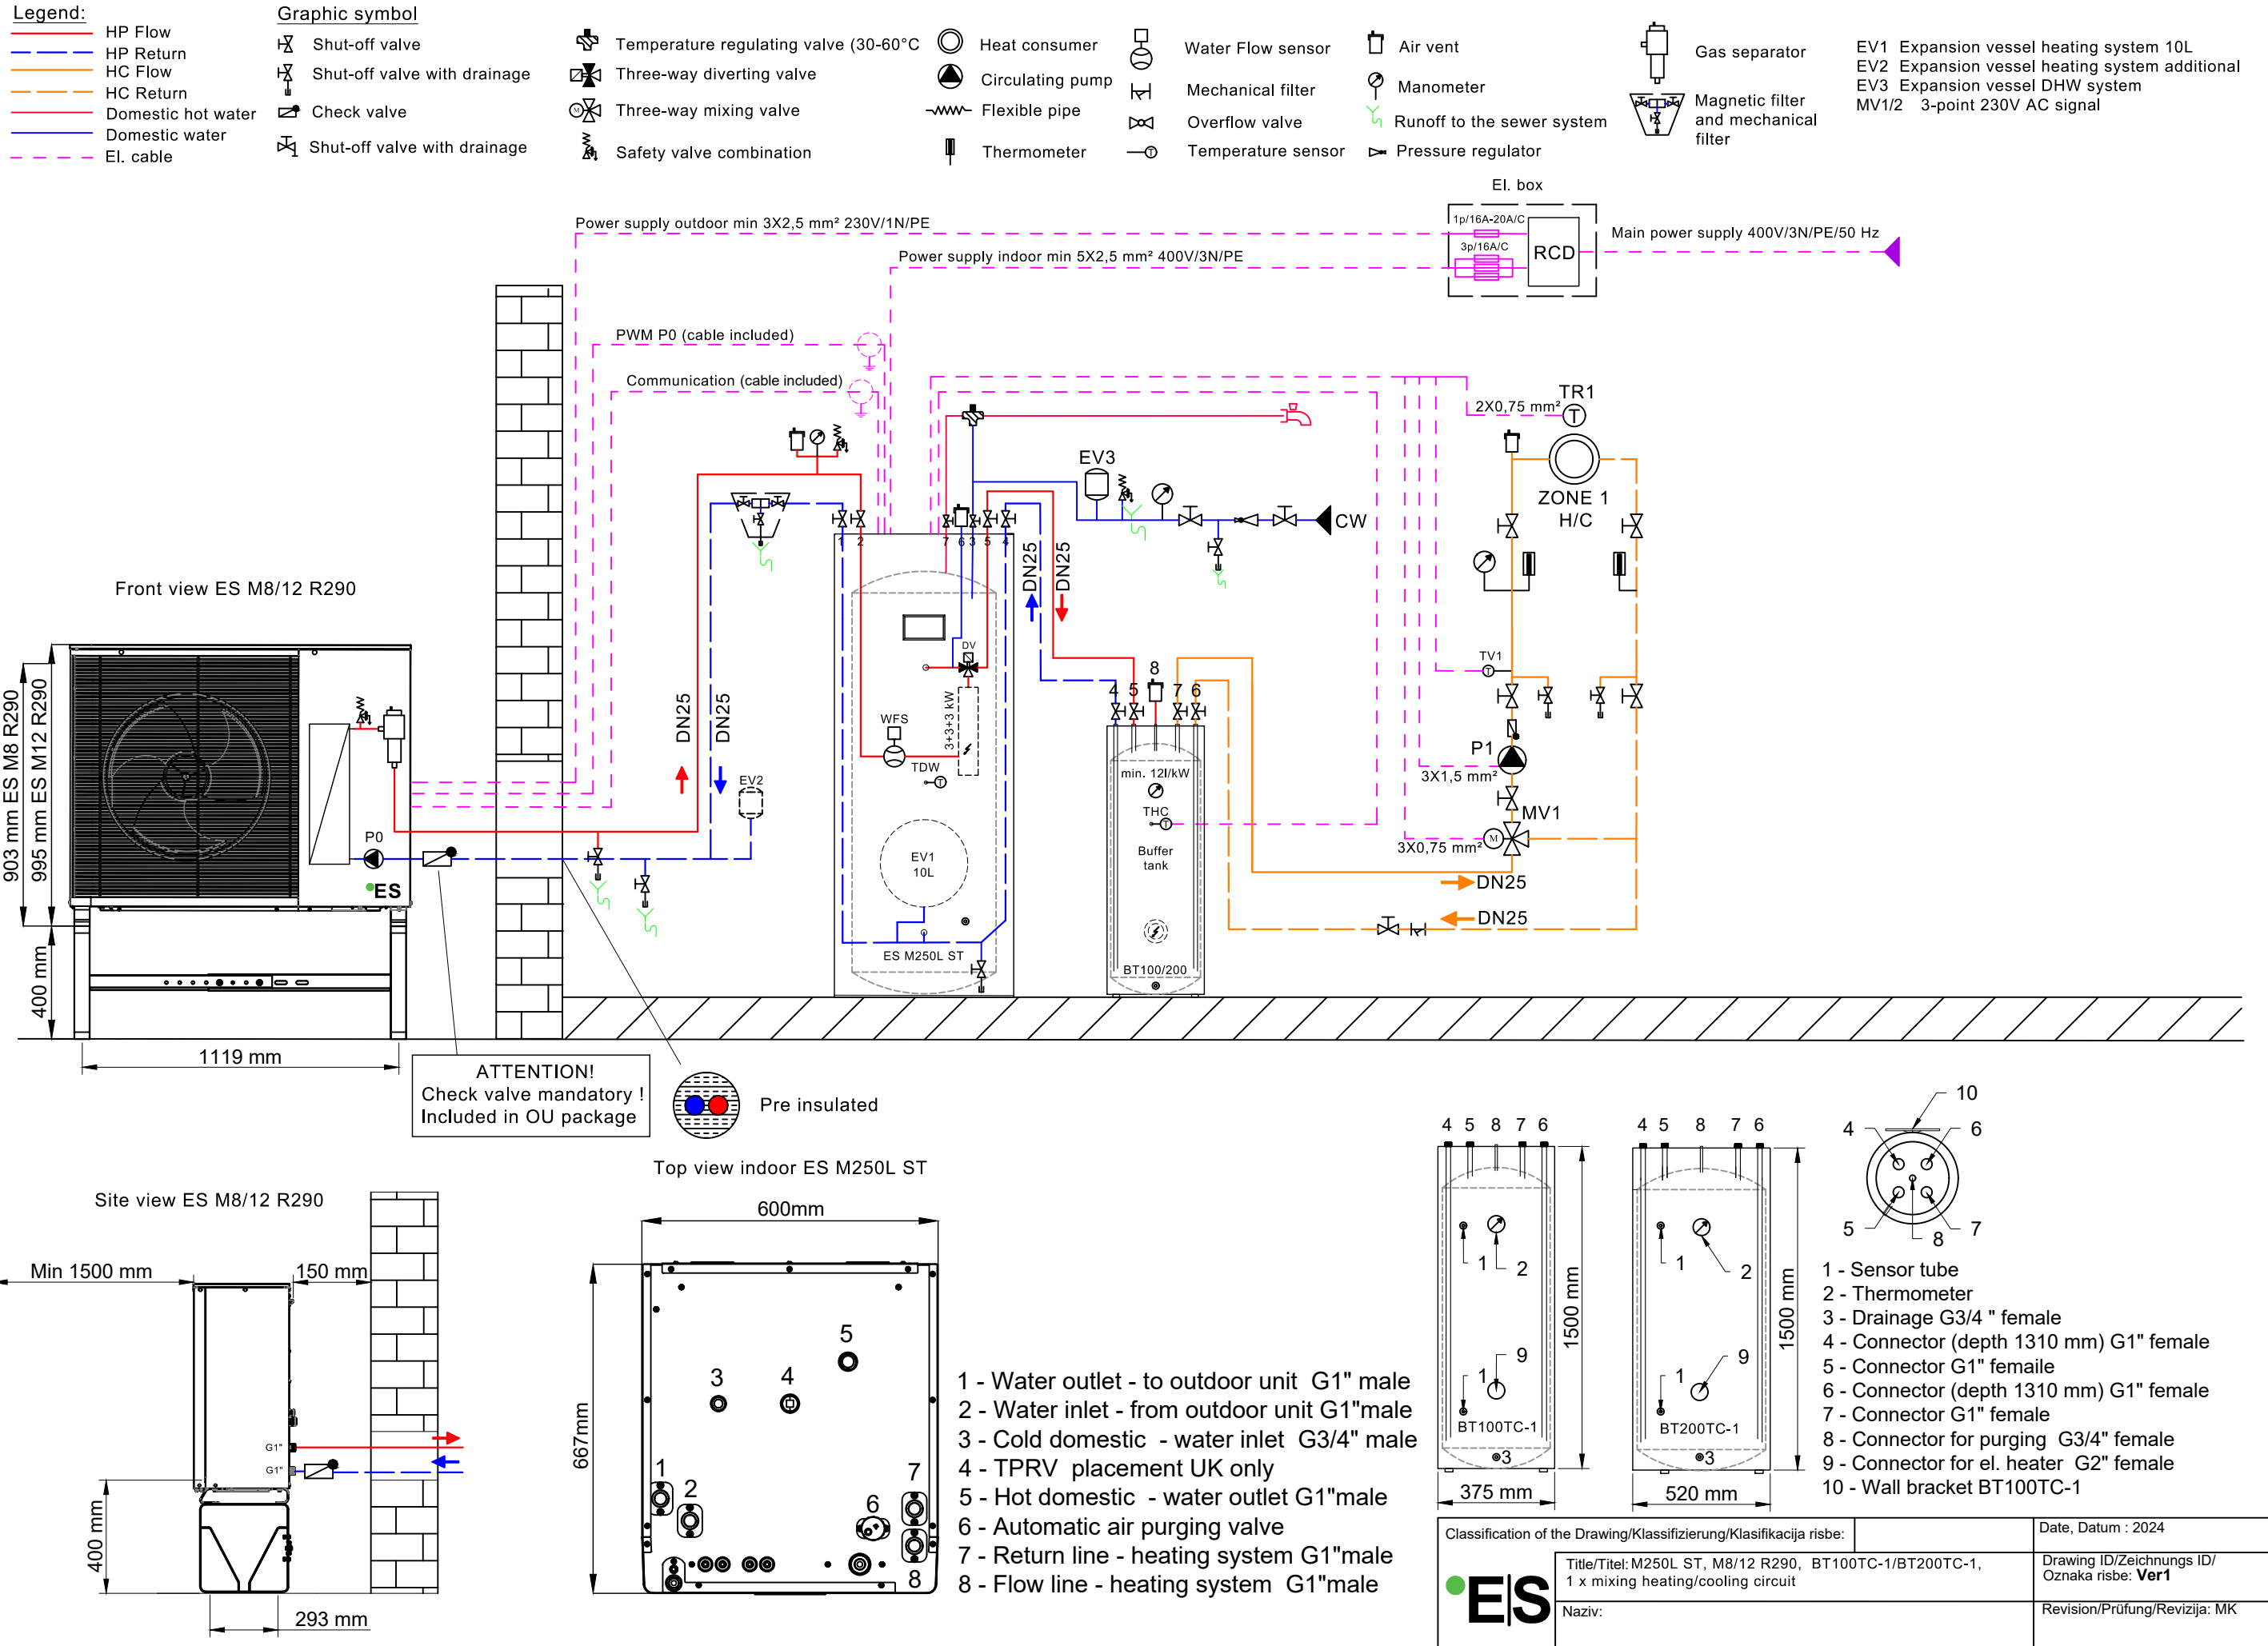


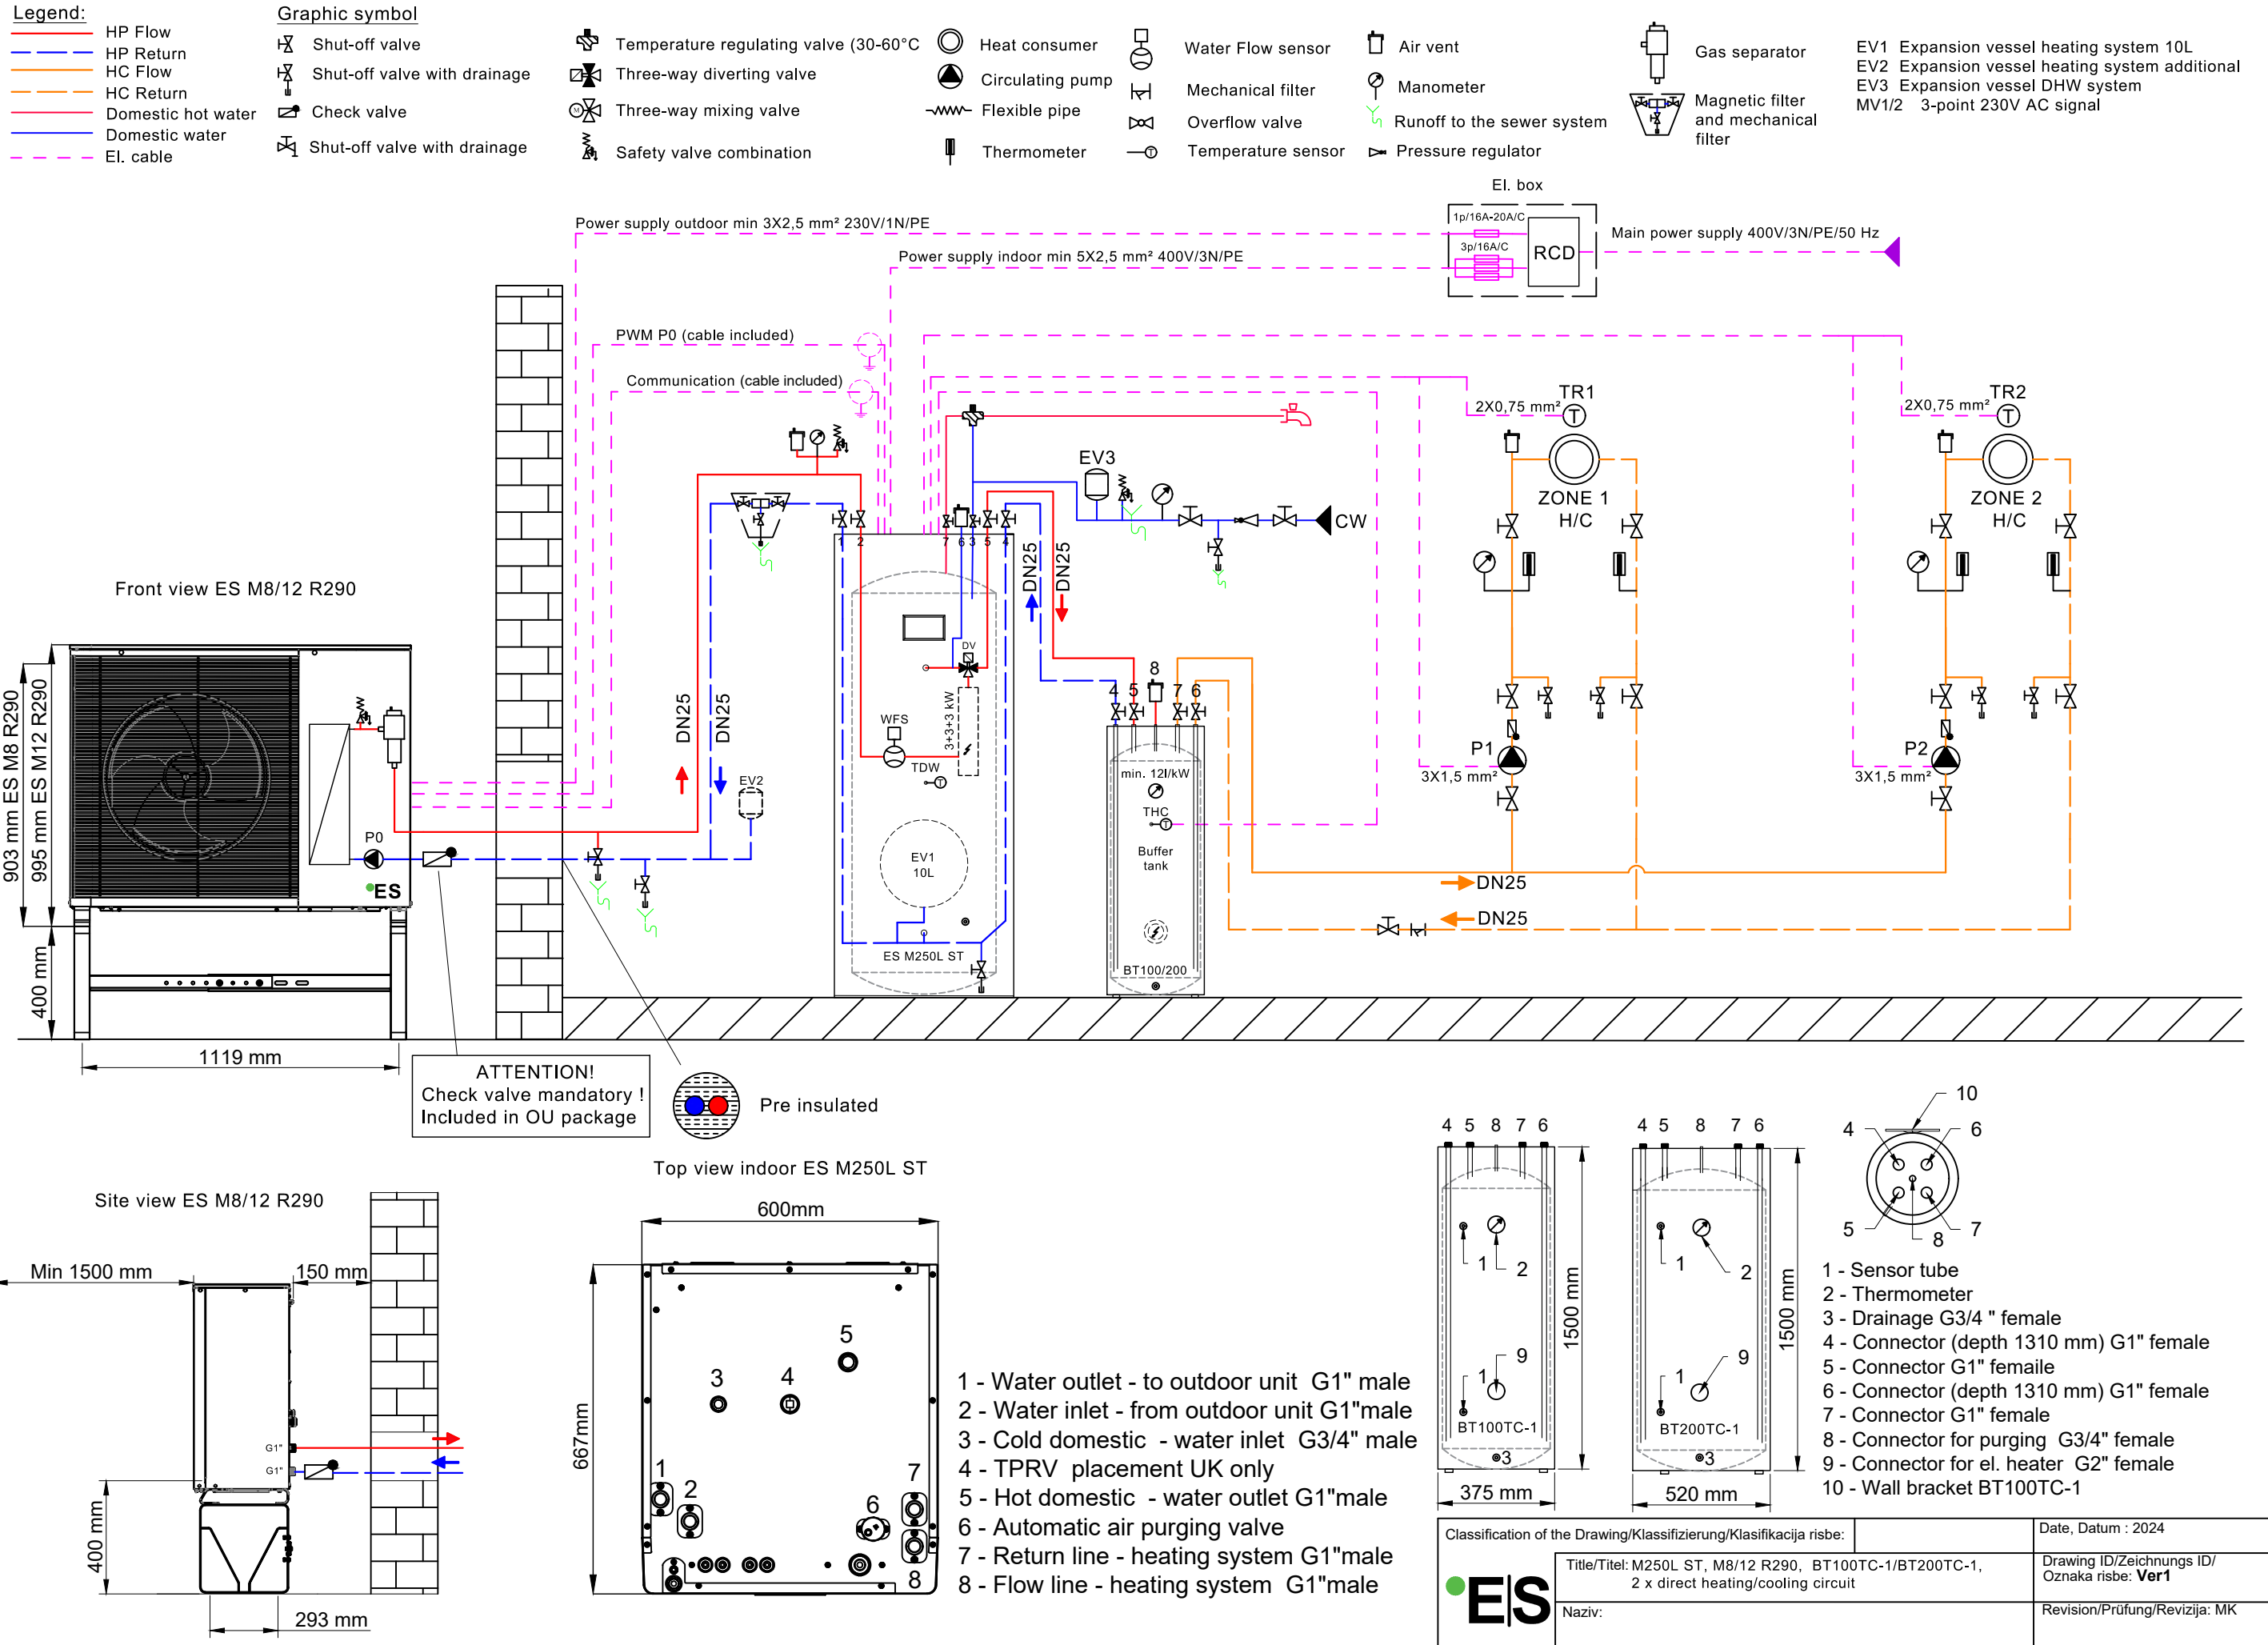



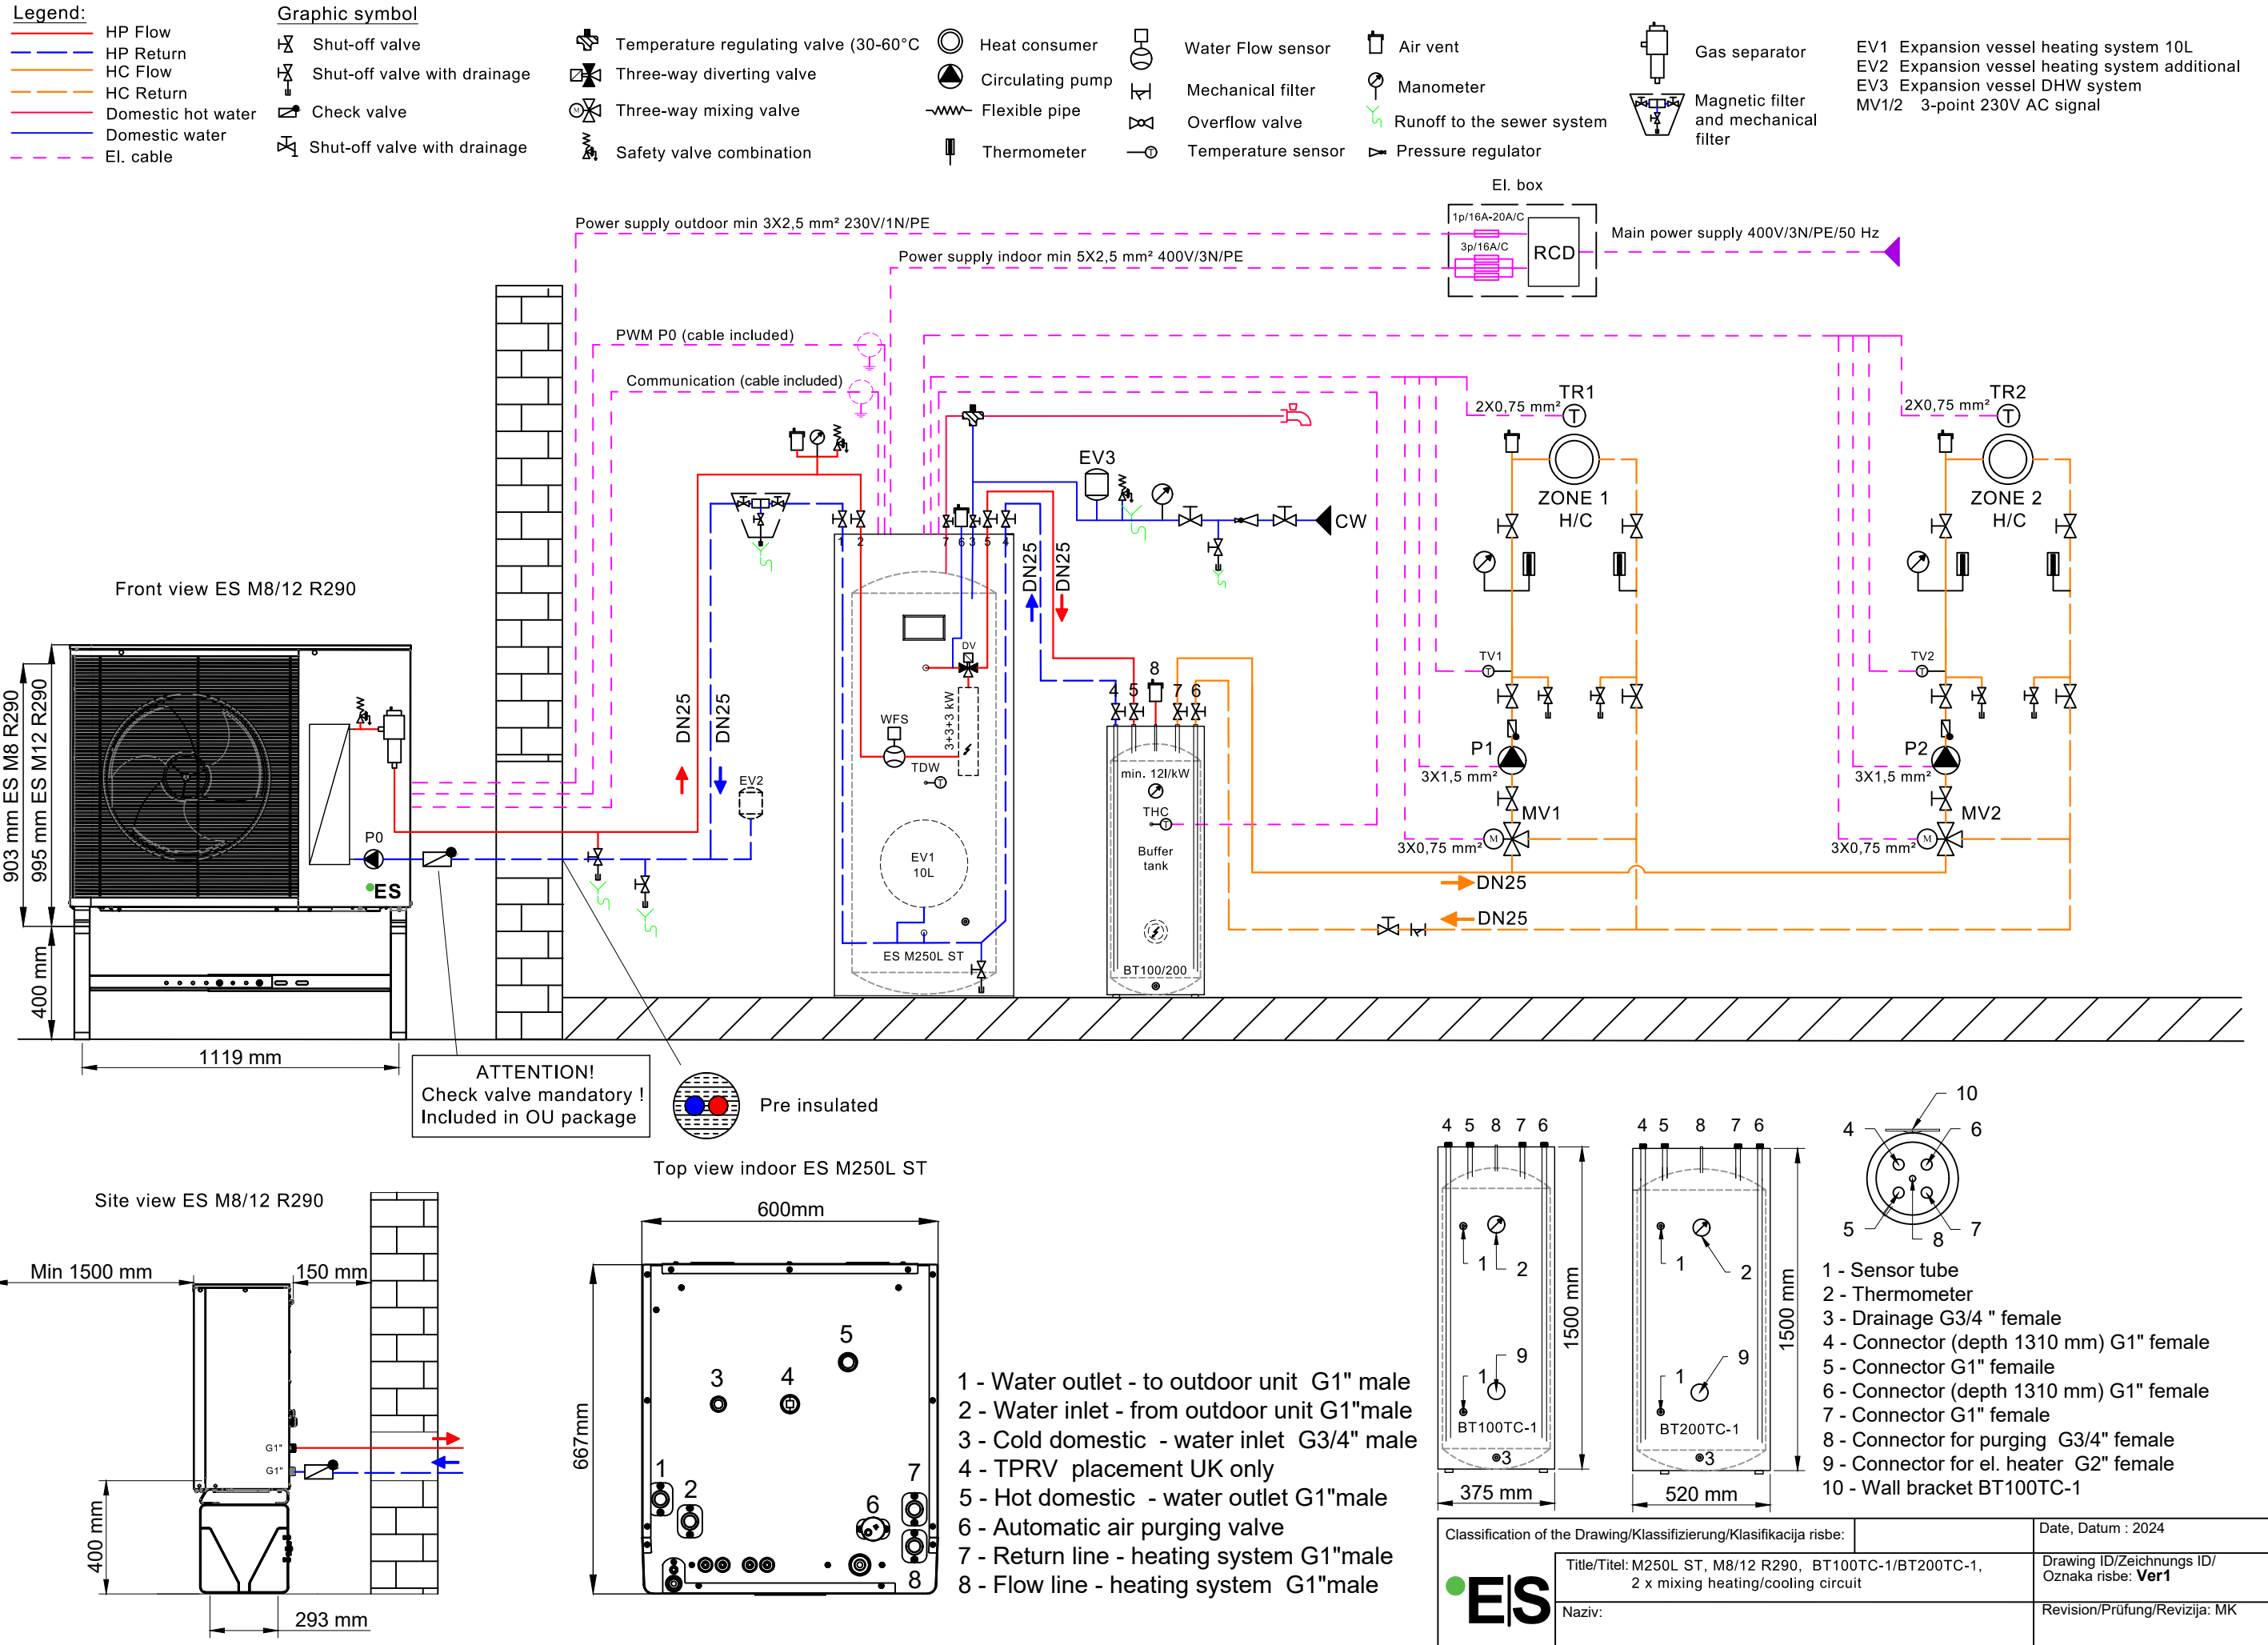


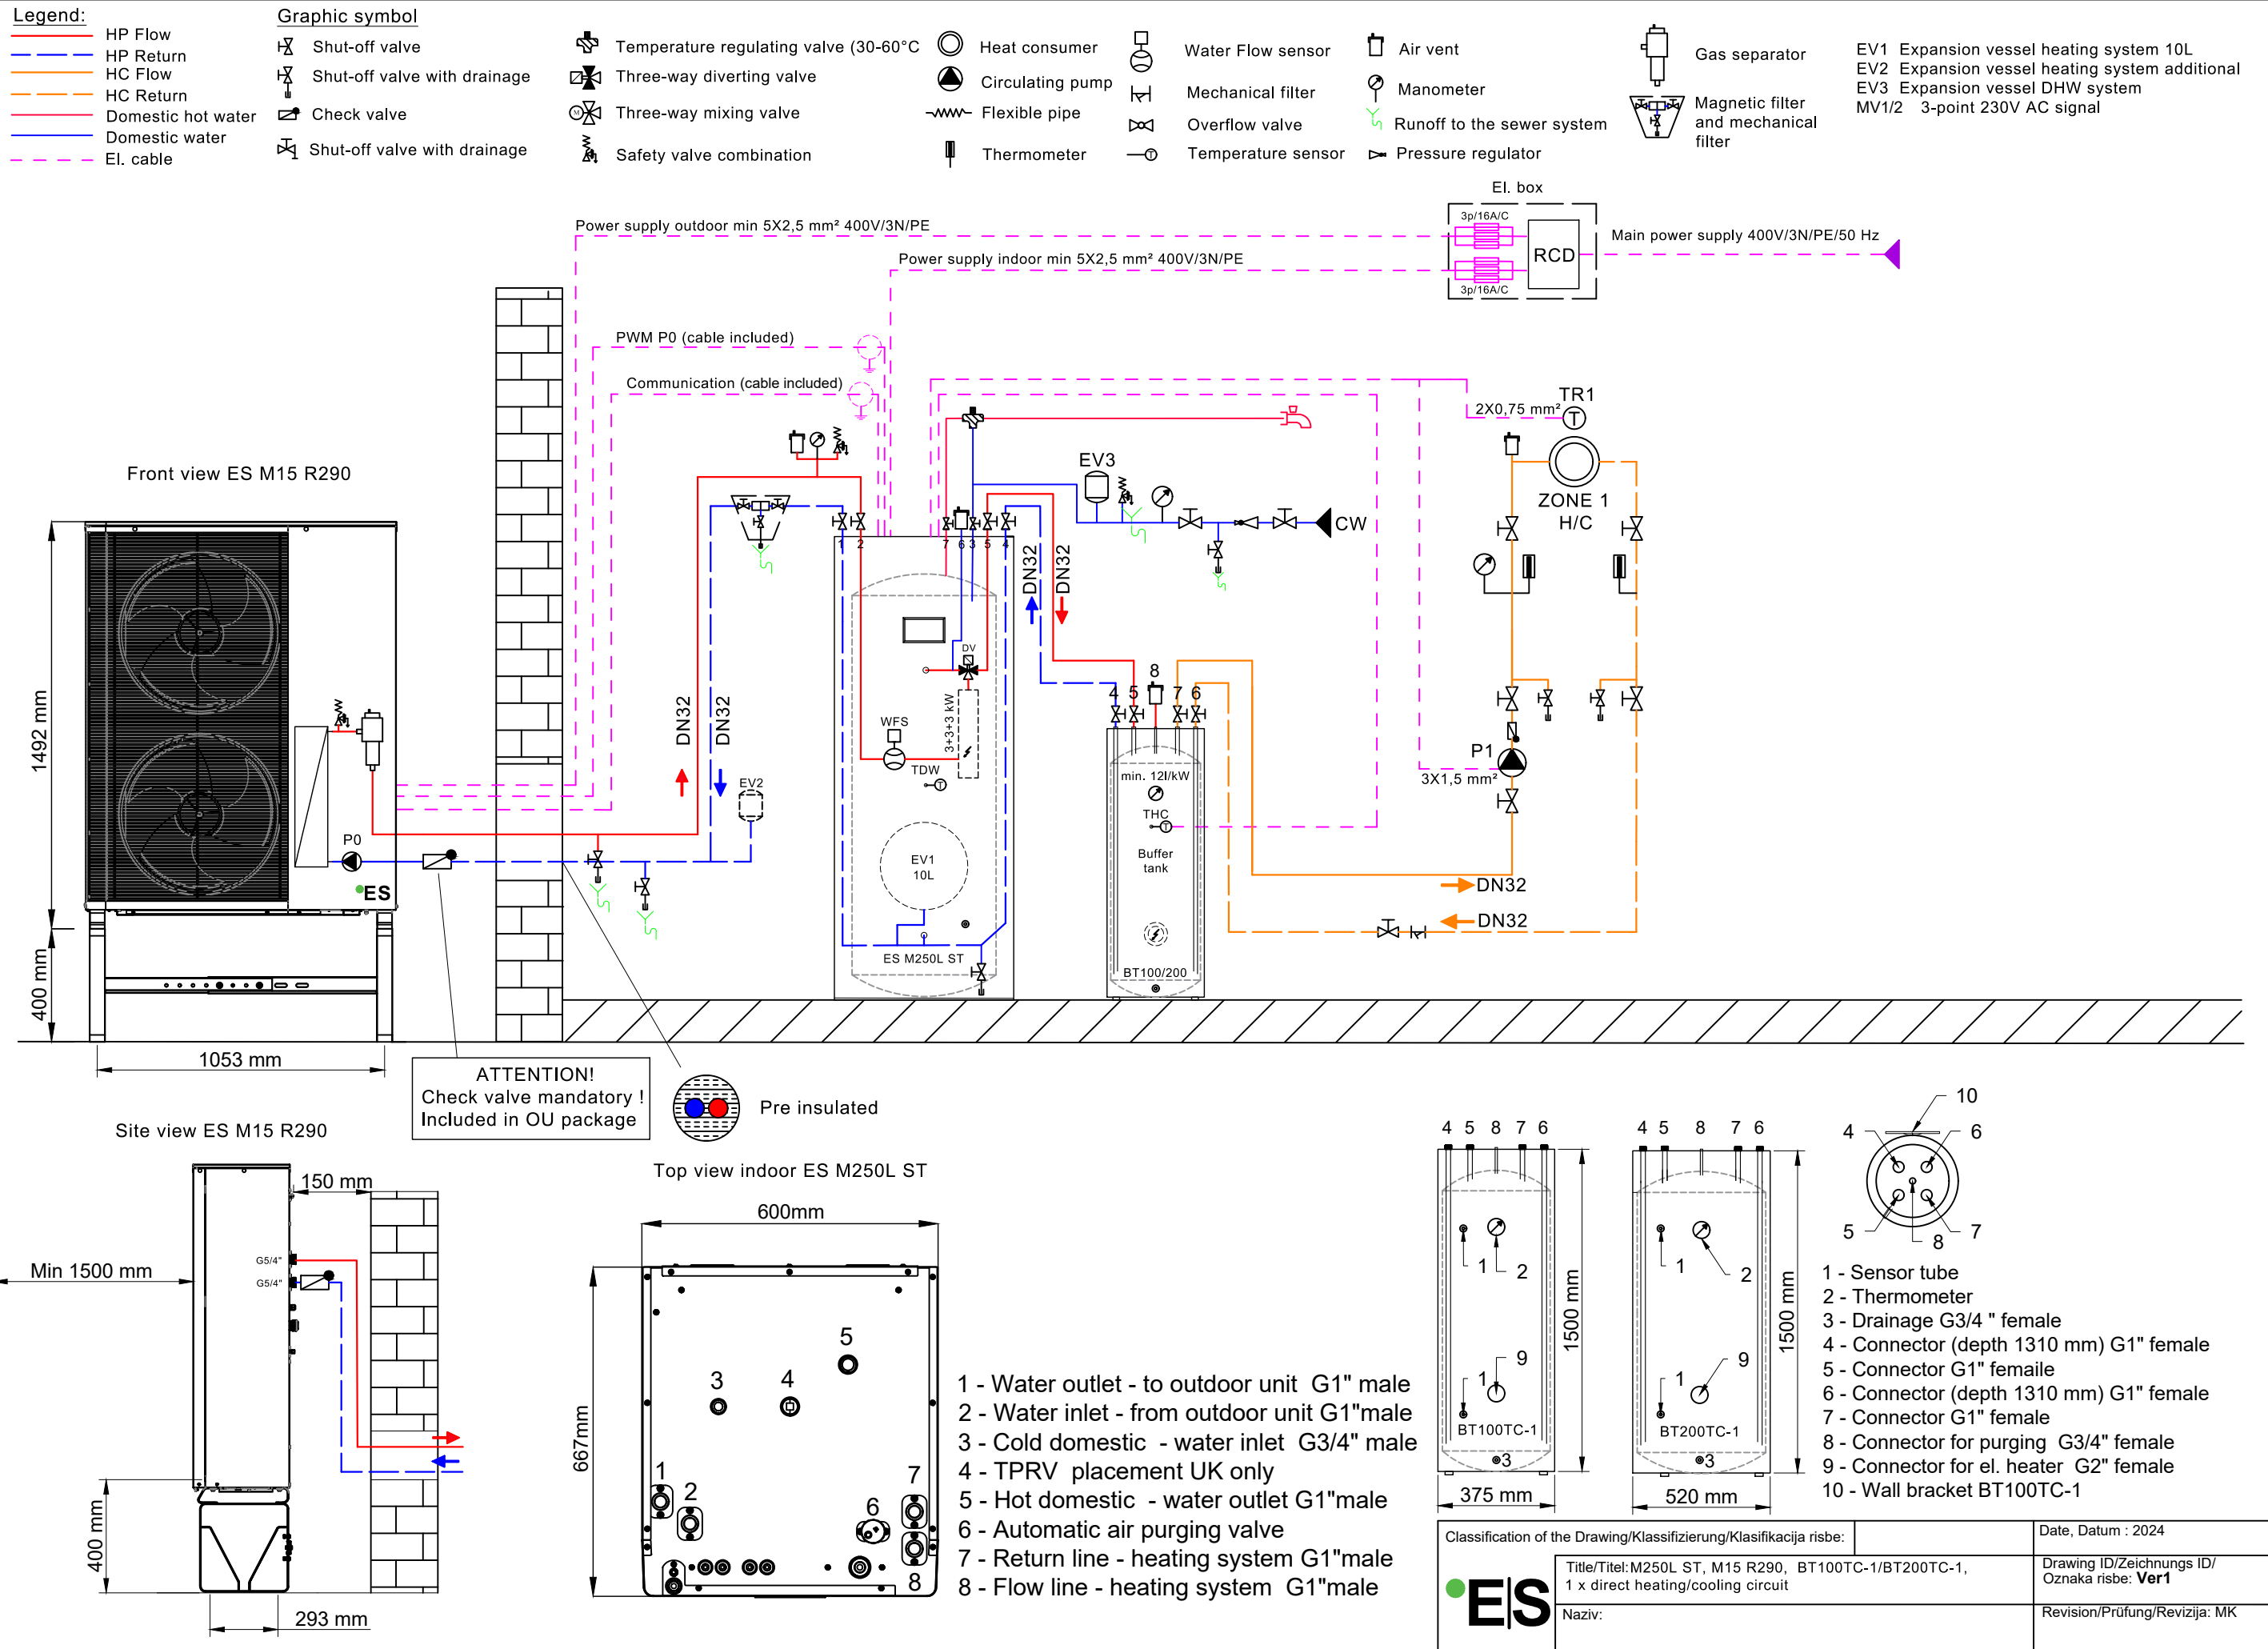

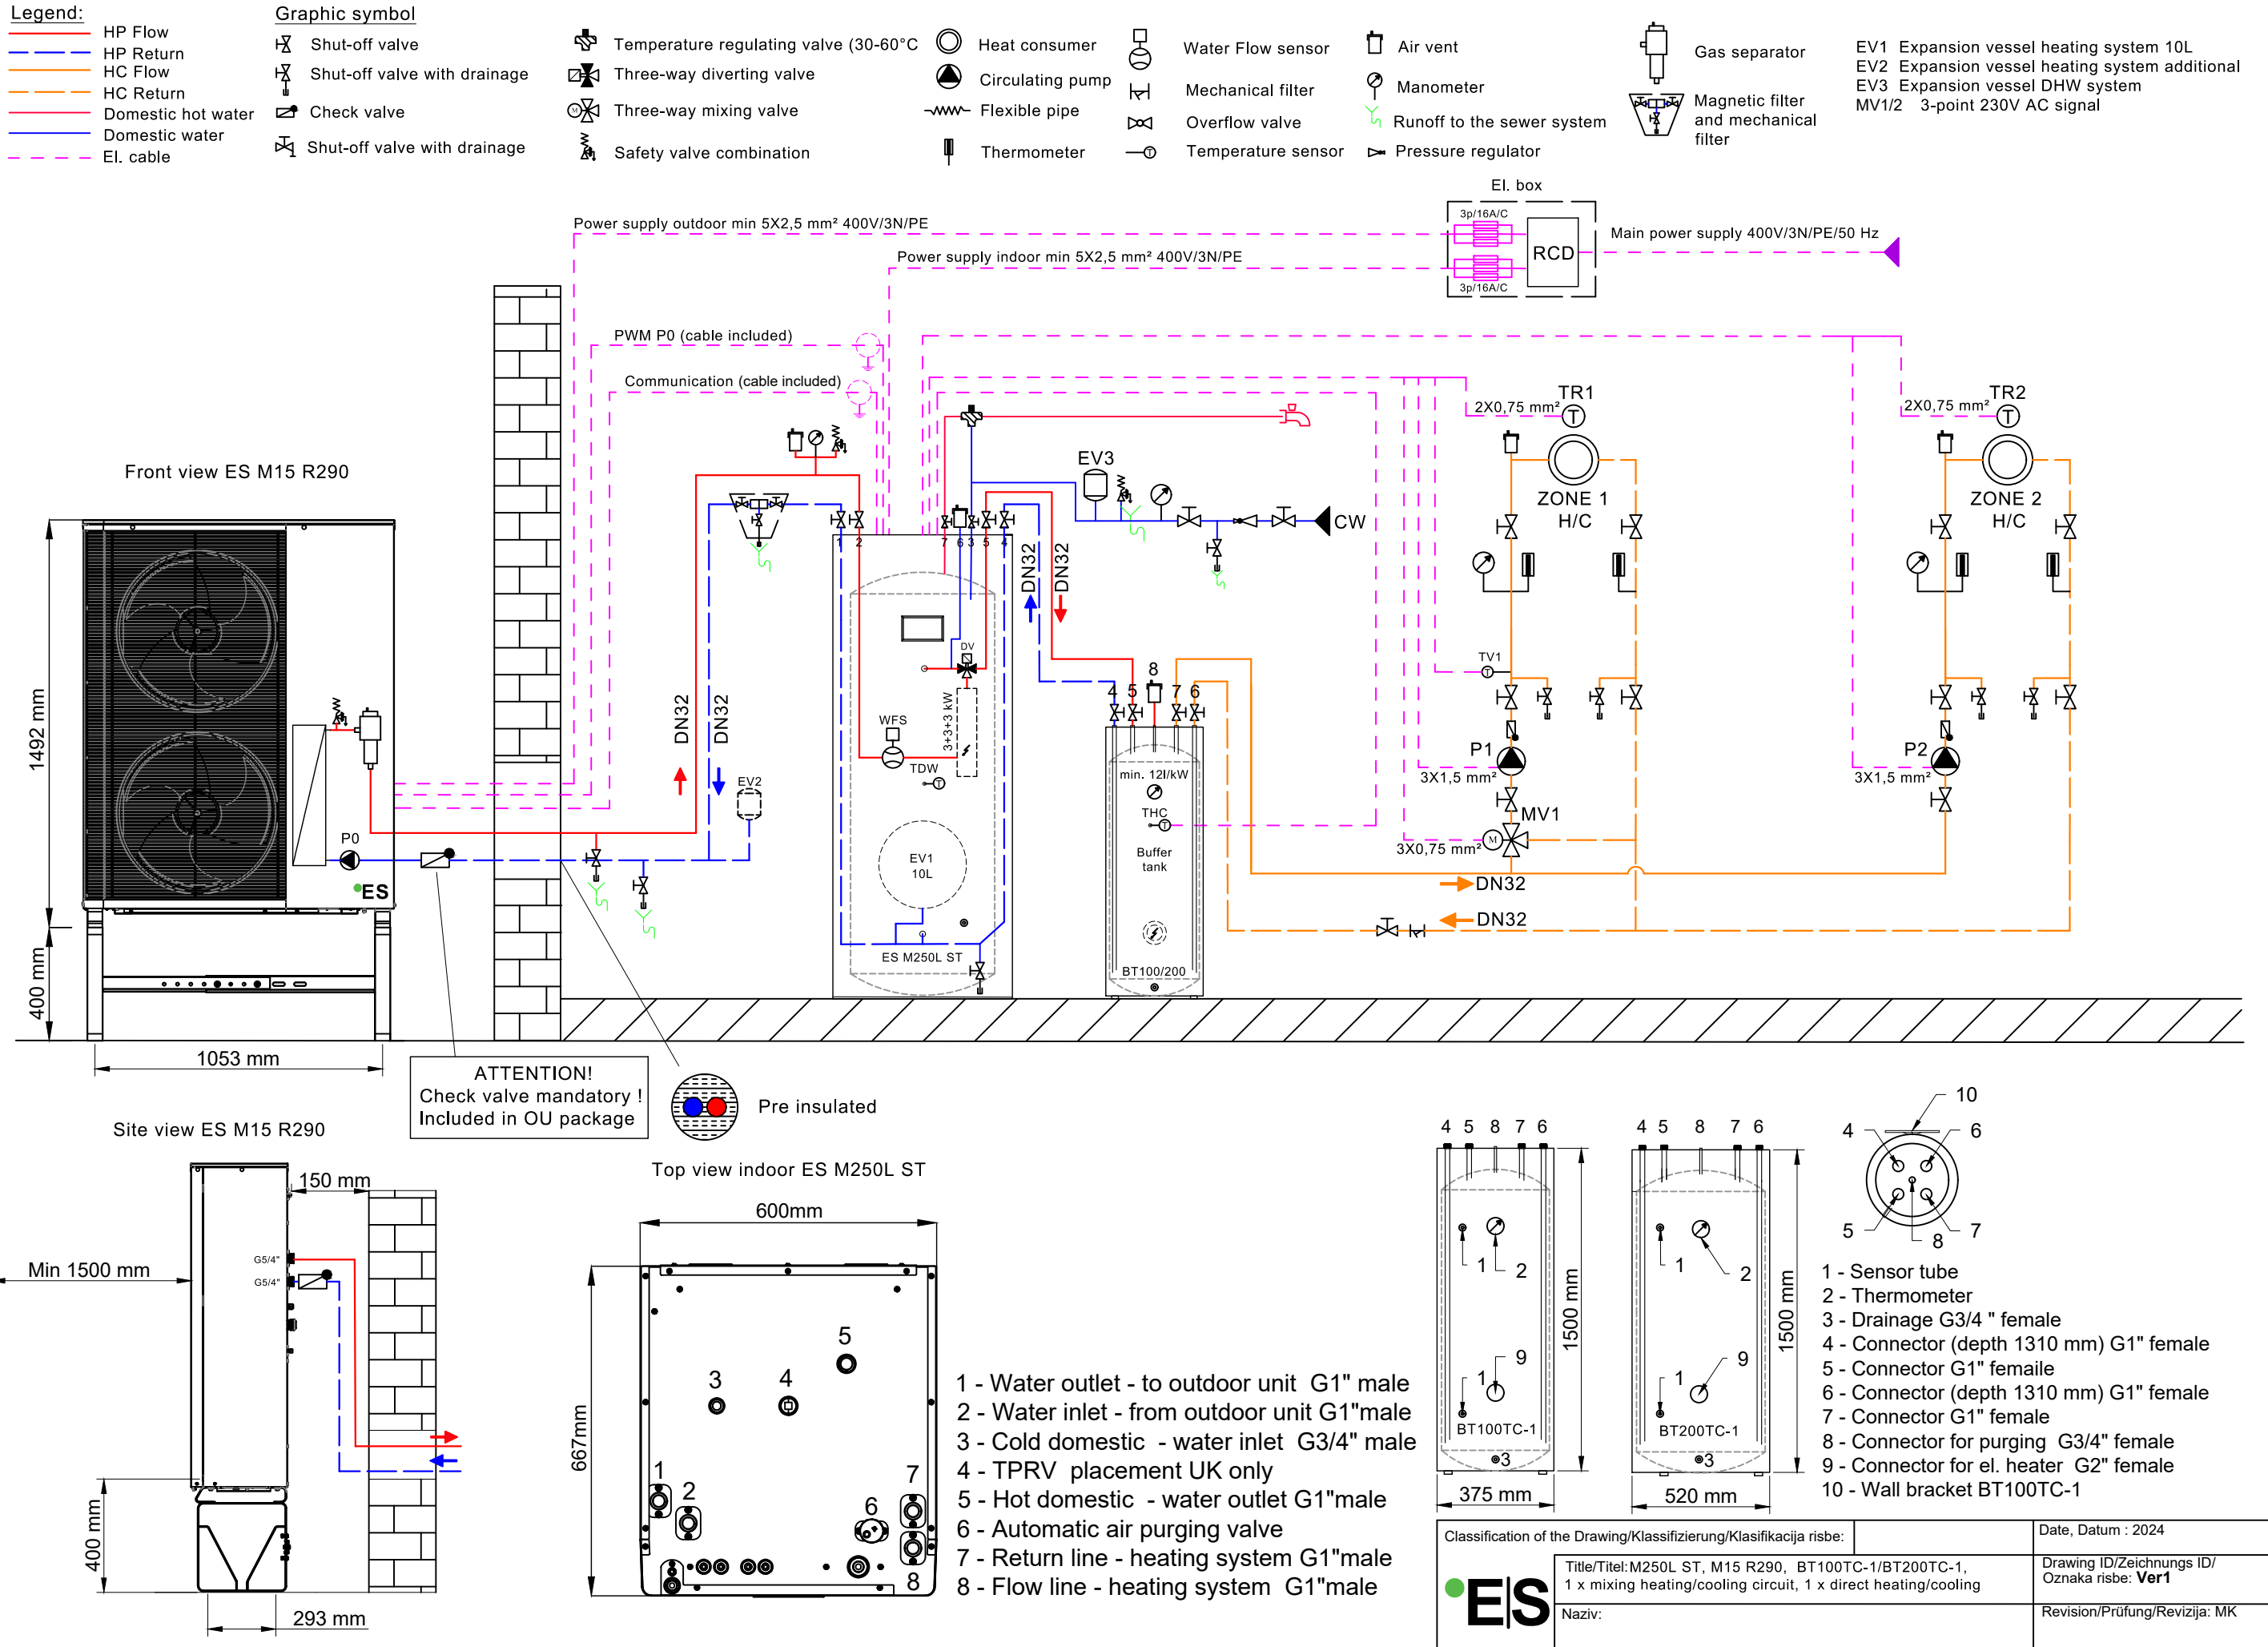


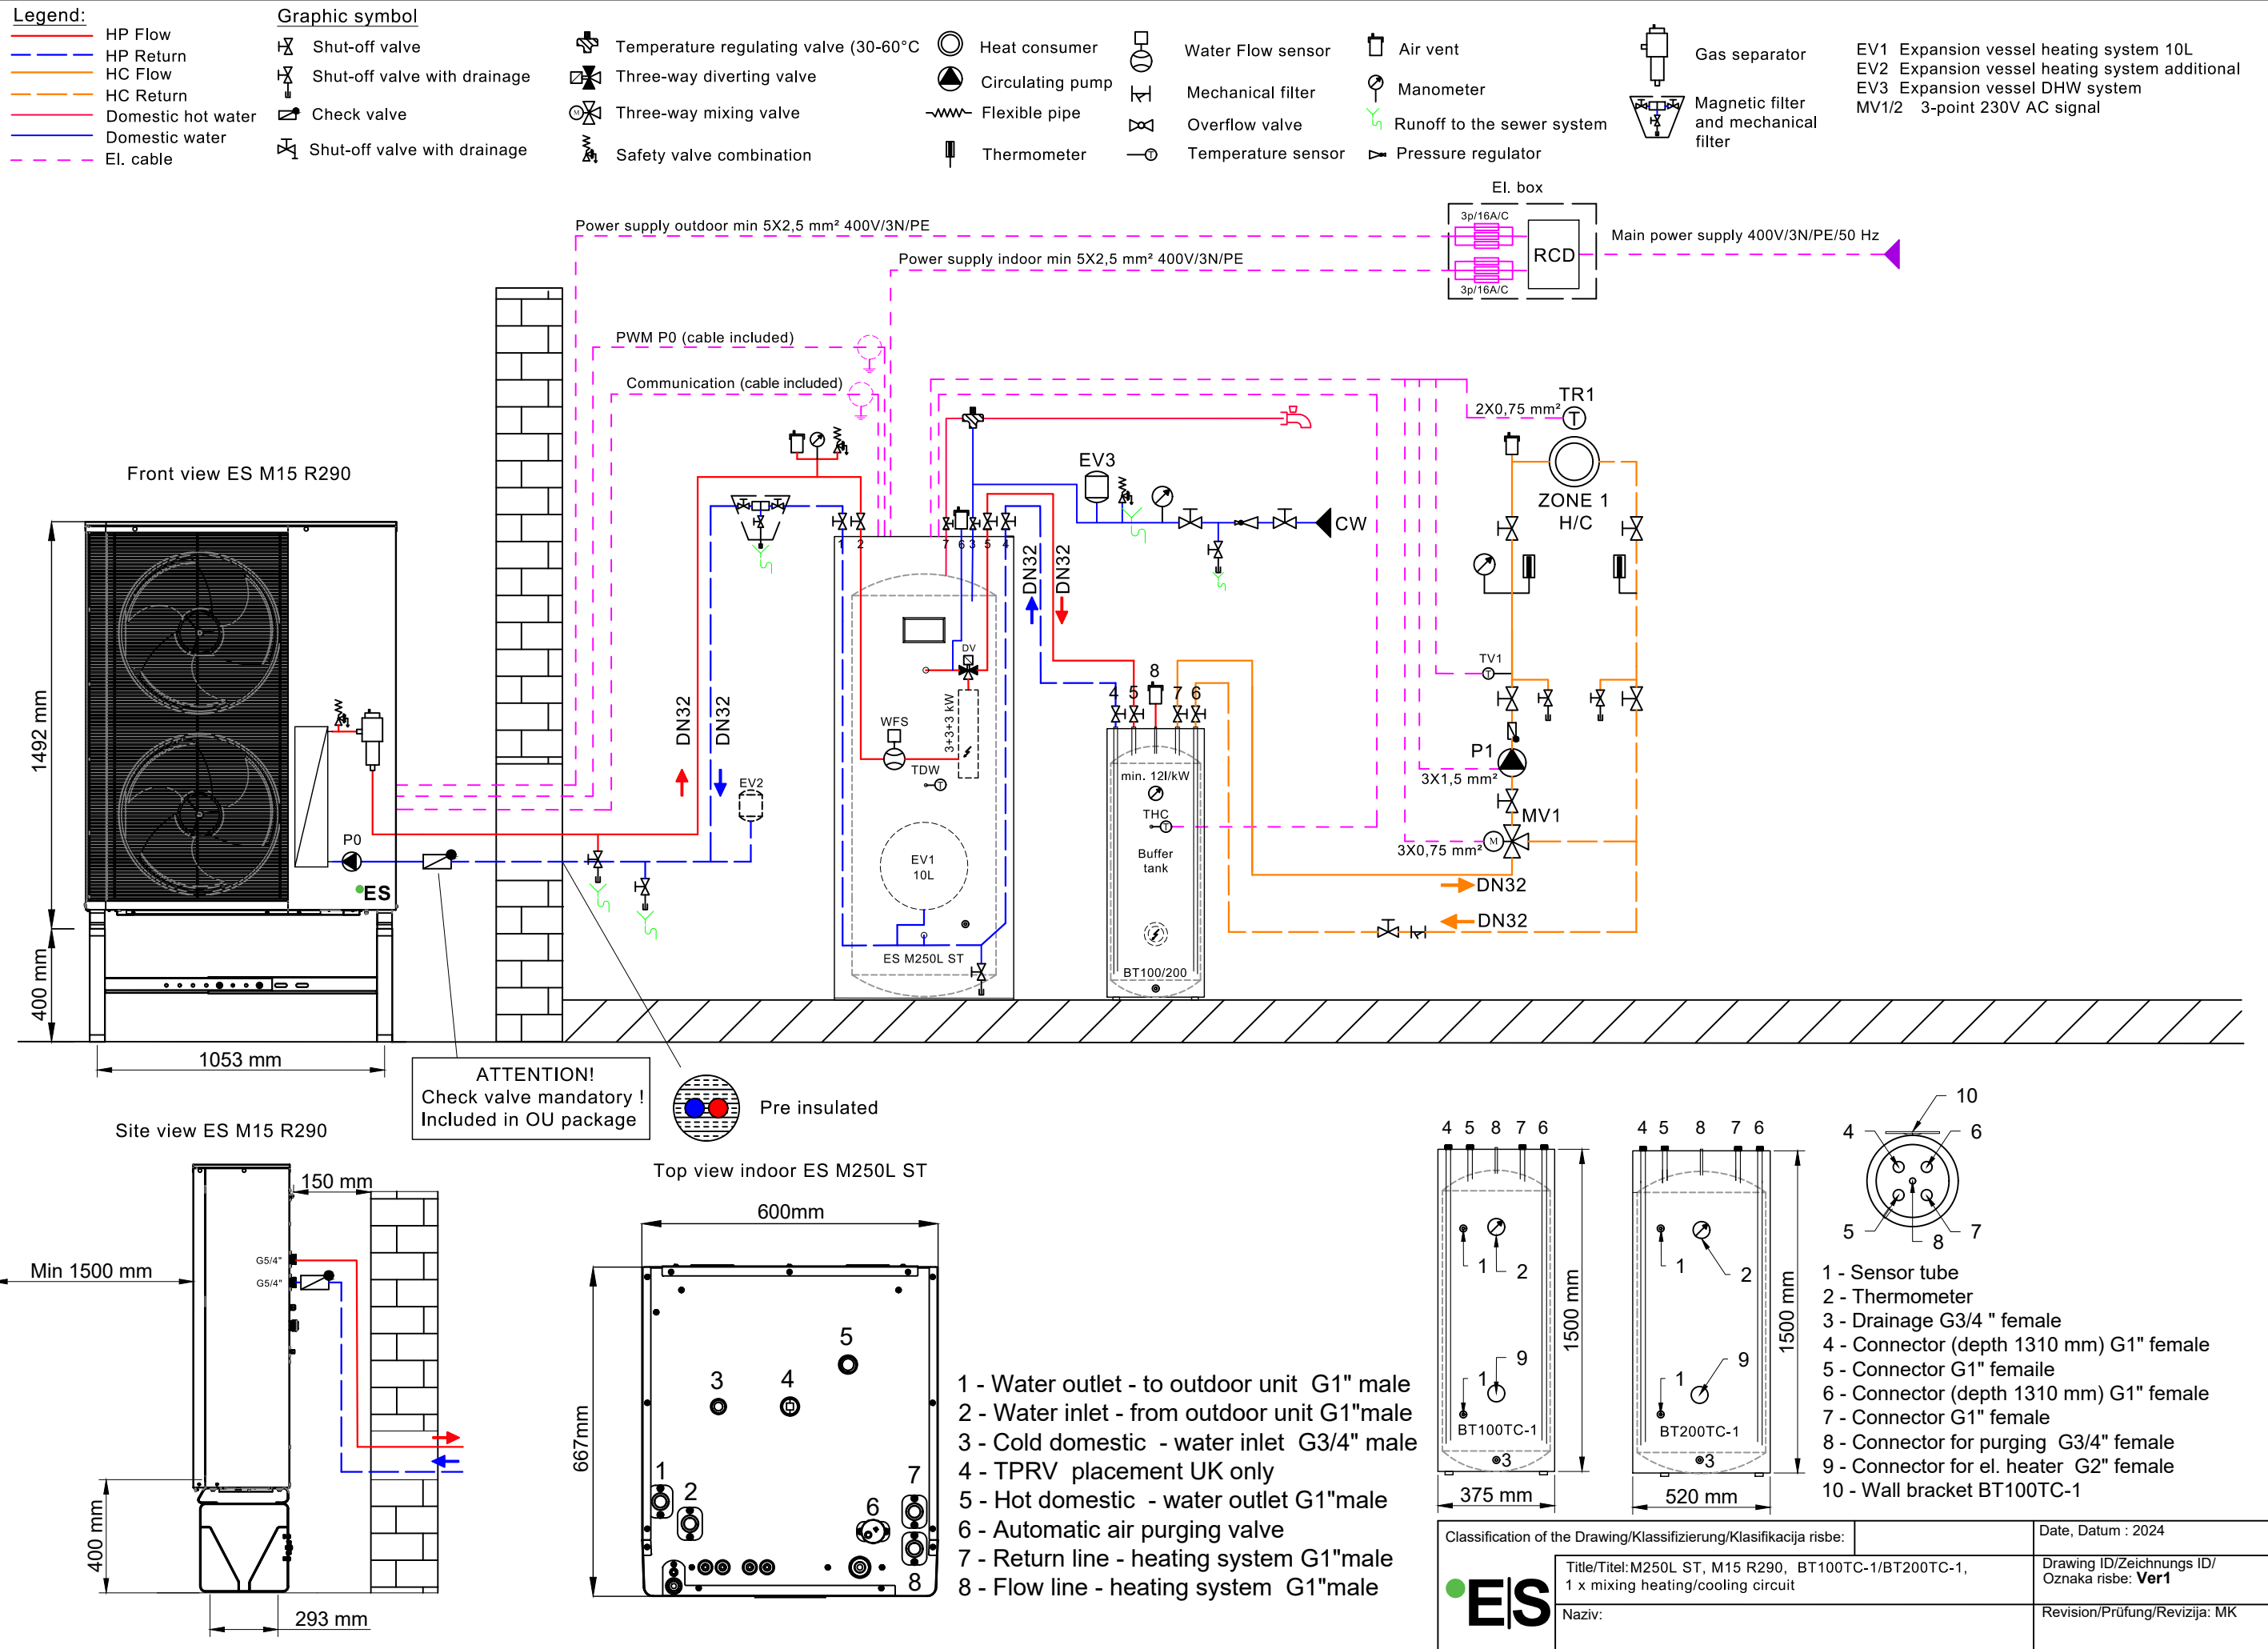


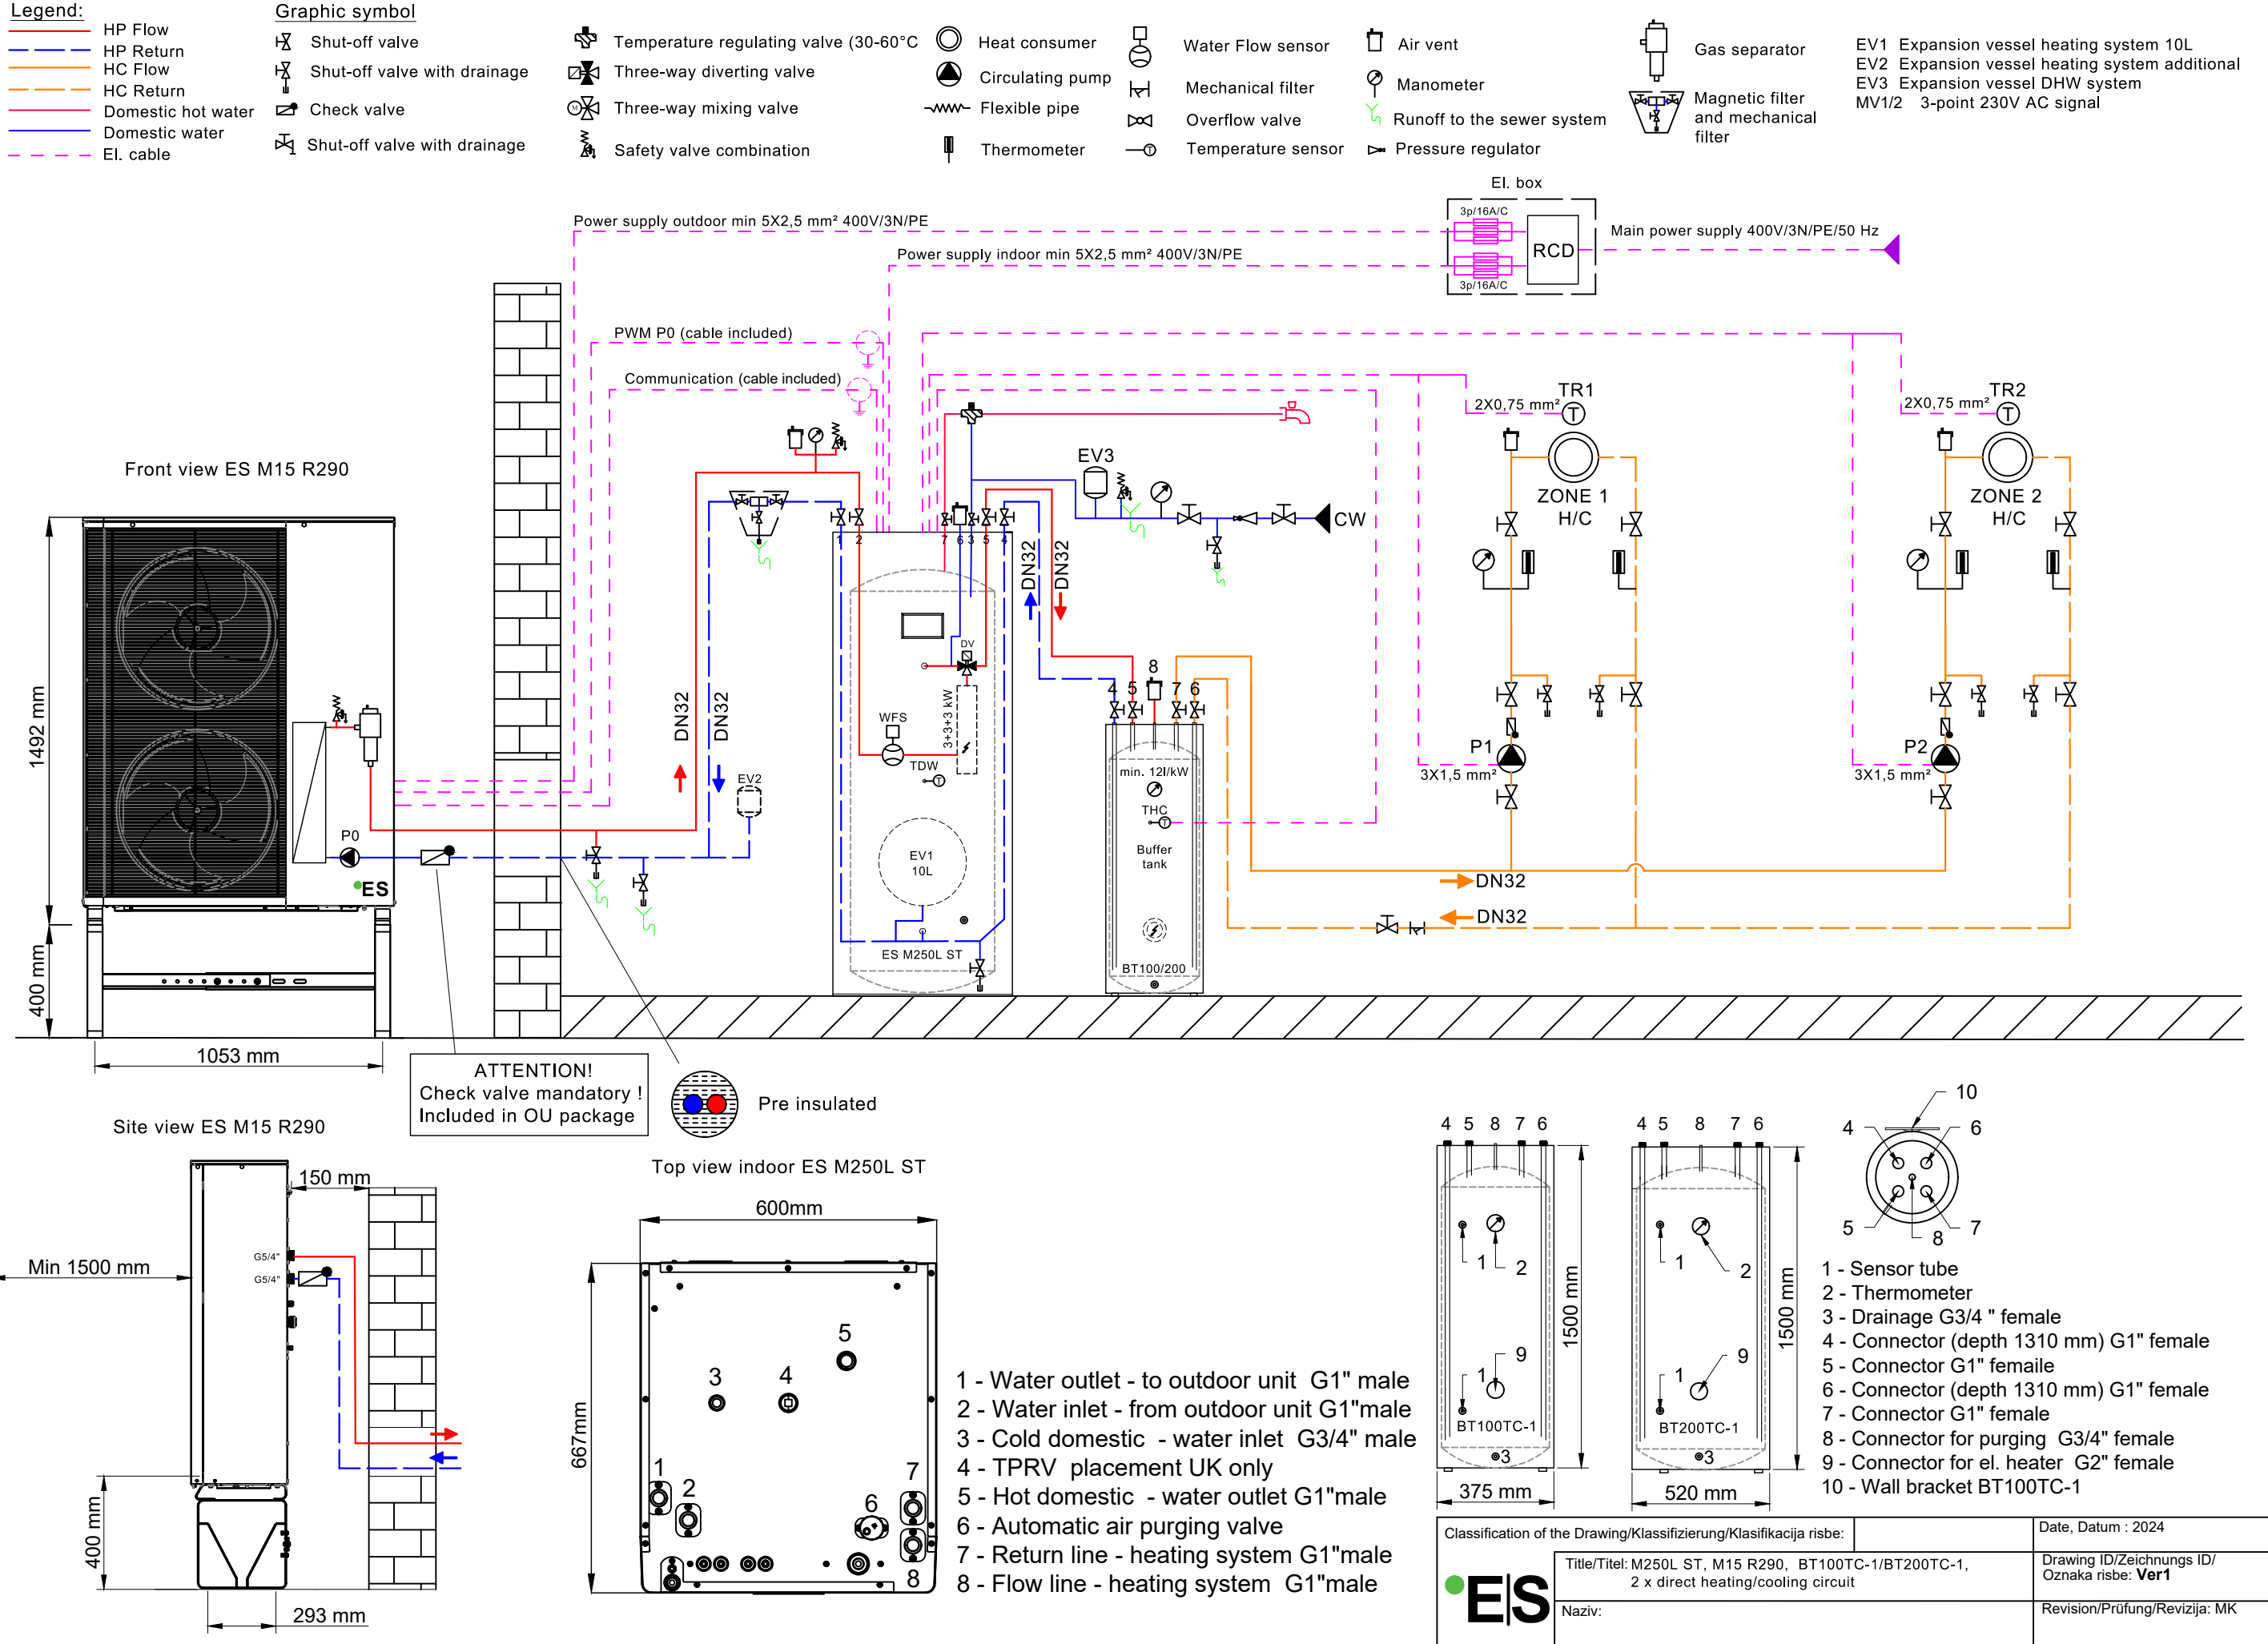


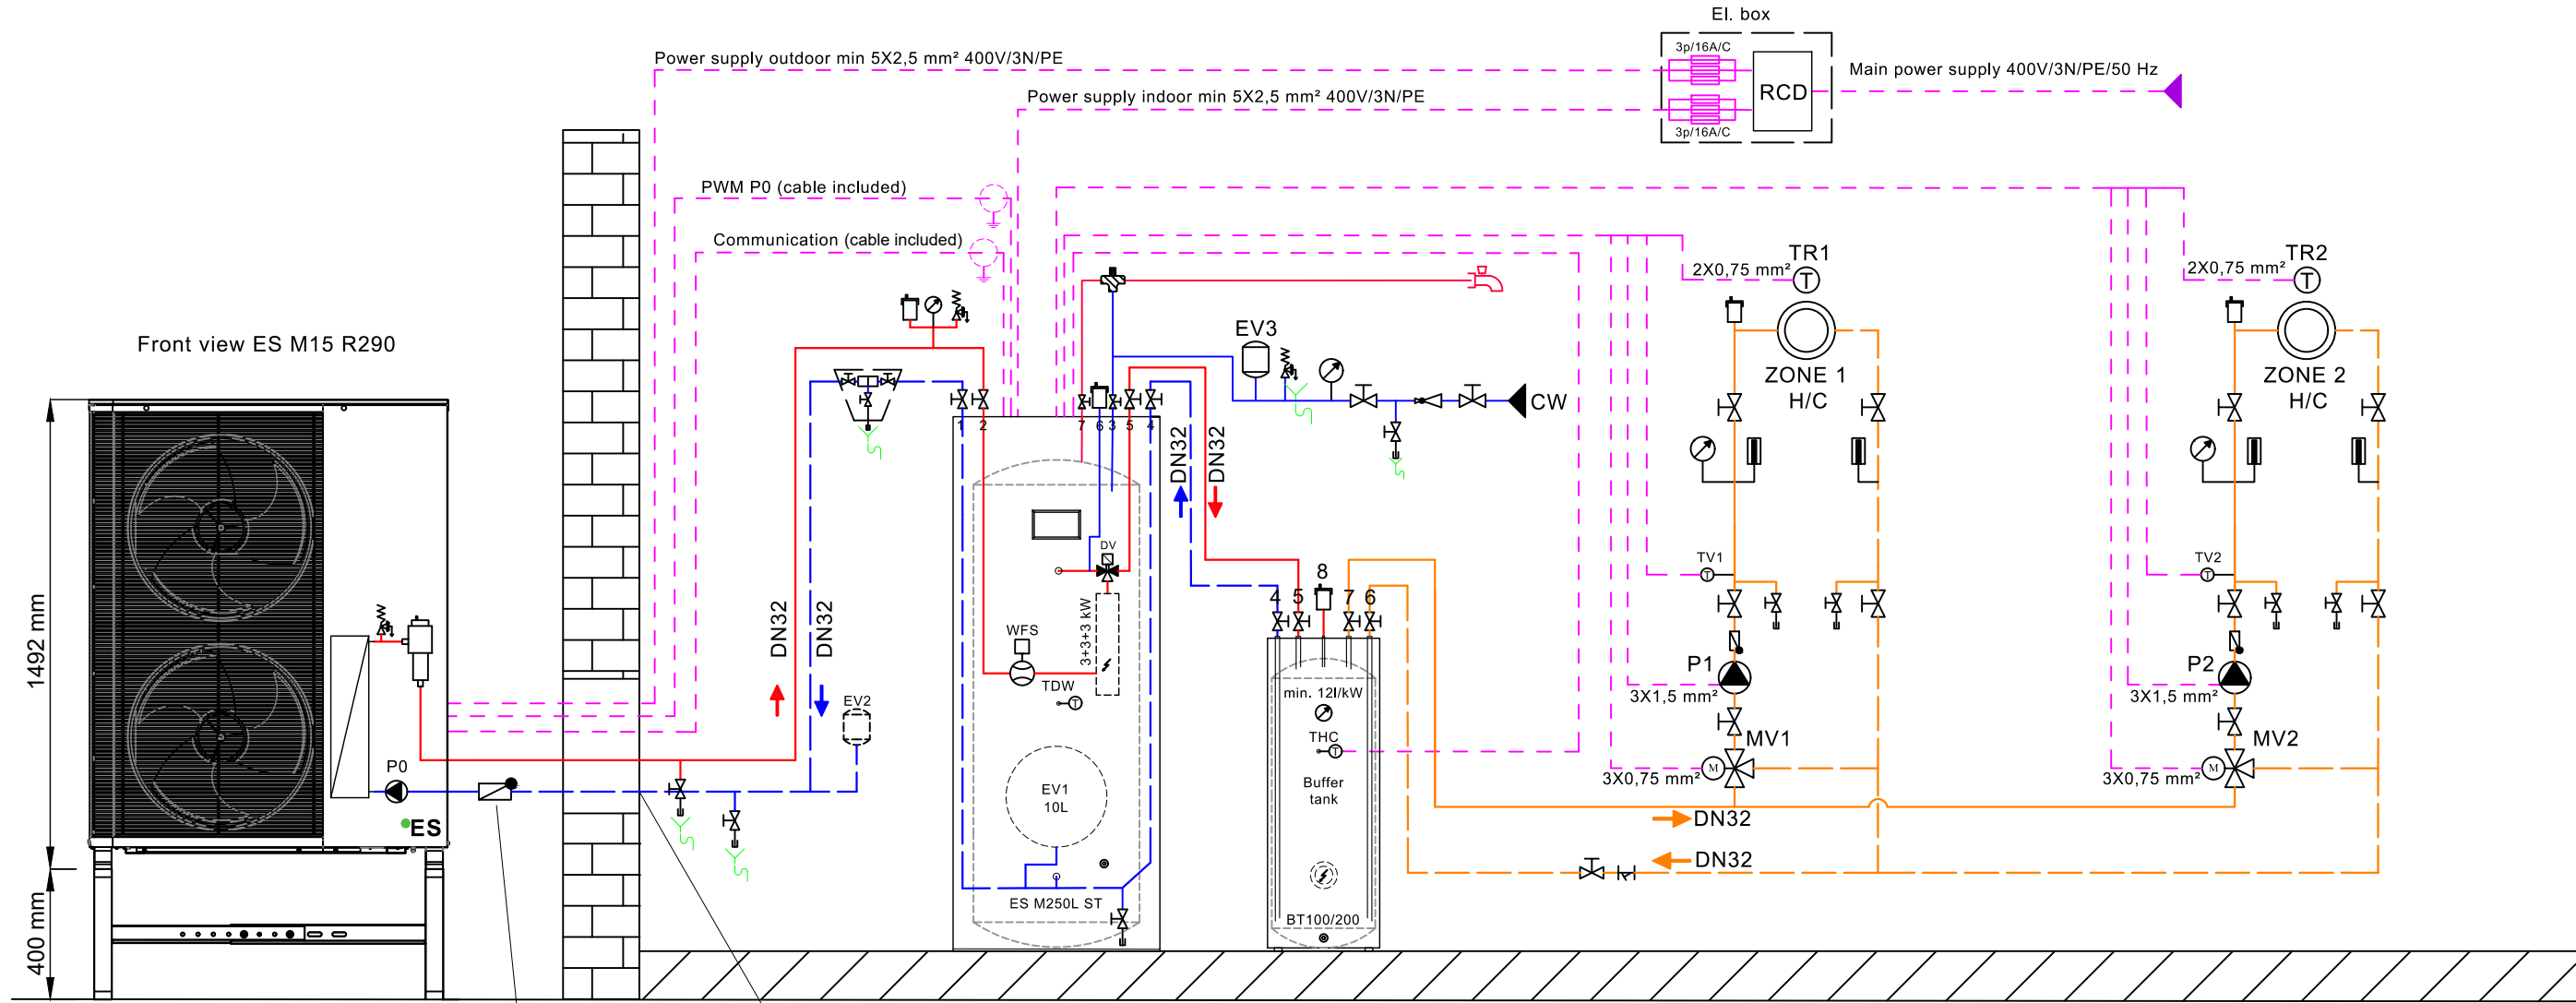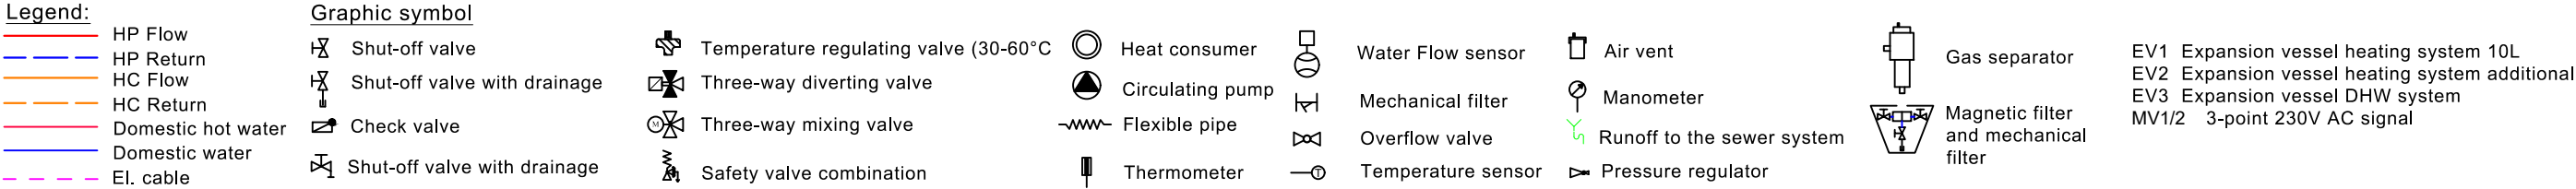


Site view ES M15 R290





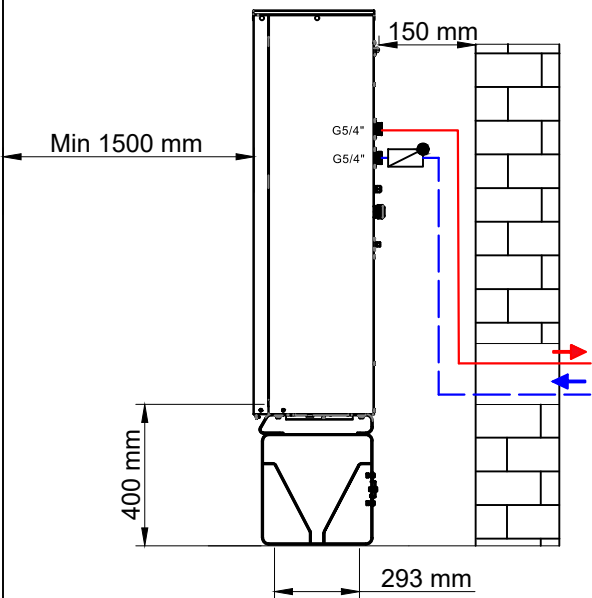


Top view indoor ES M250L ST





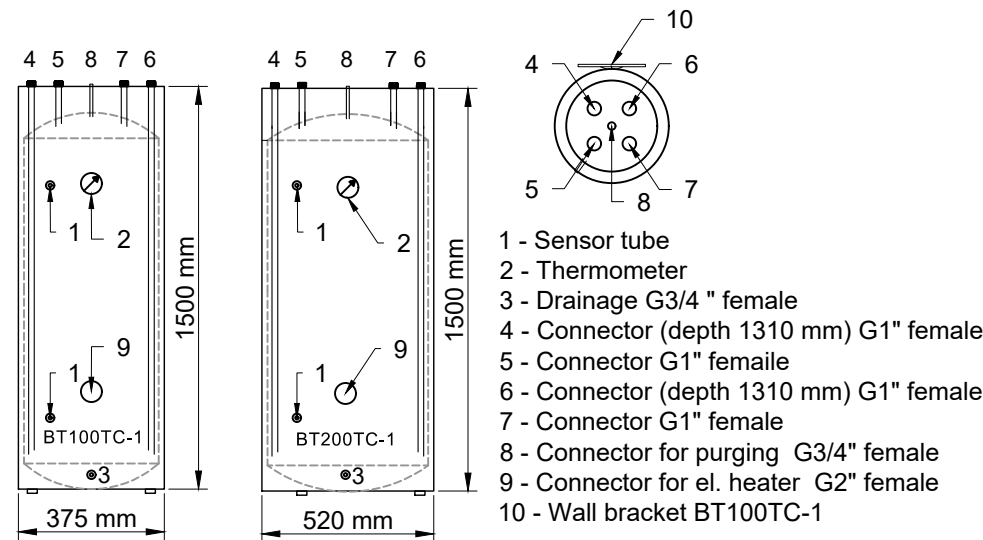
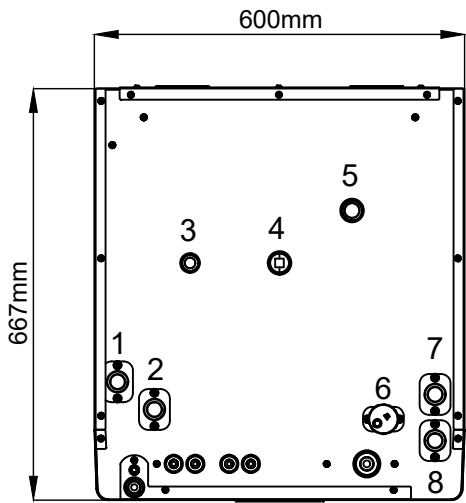


Classification of the Drawing/Klassifizierung/Klasifikacija risbe:	Date, Datum : 2024
ES	Drawing ID/Zeichnungs ID/ Oznaka risbe: Ver1
Naziv:	Revision/Prüfung/Revizija: MK


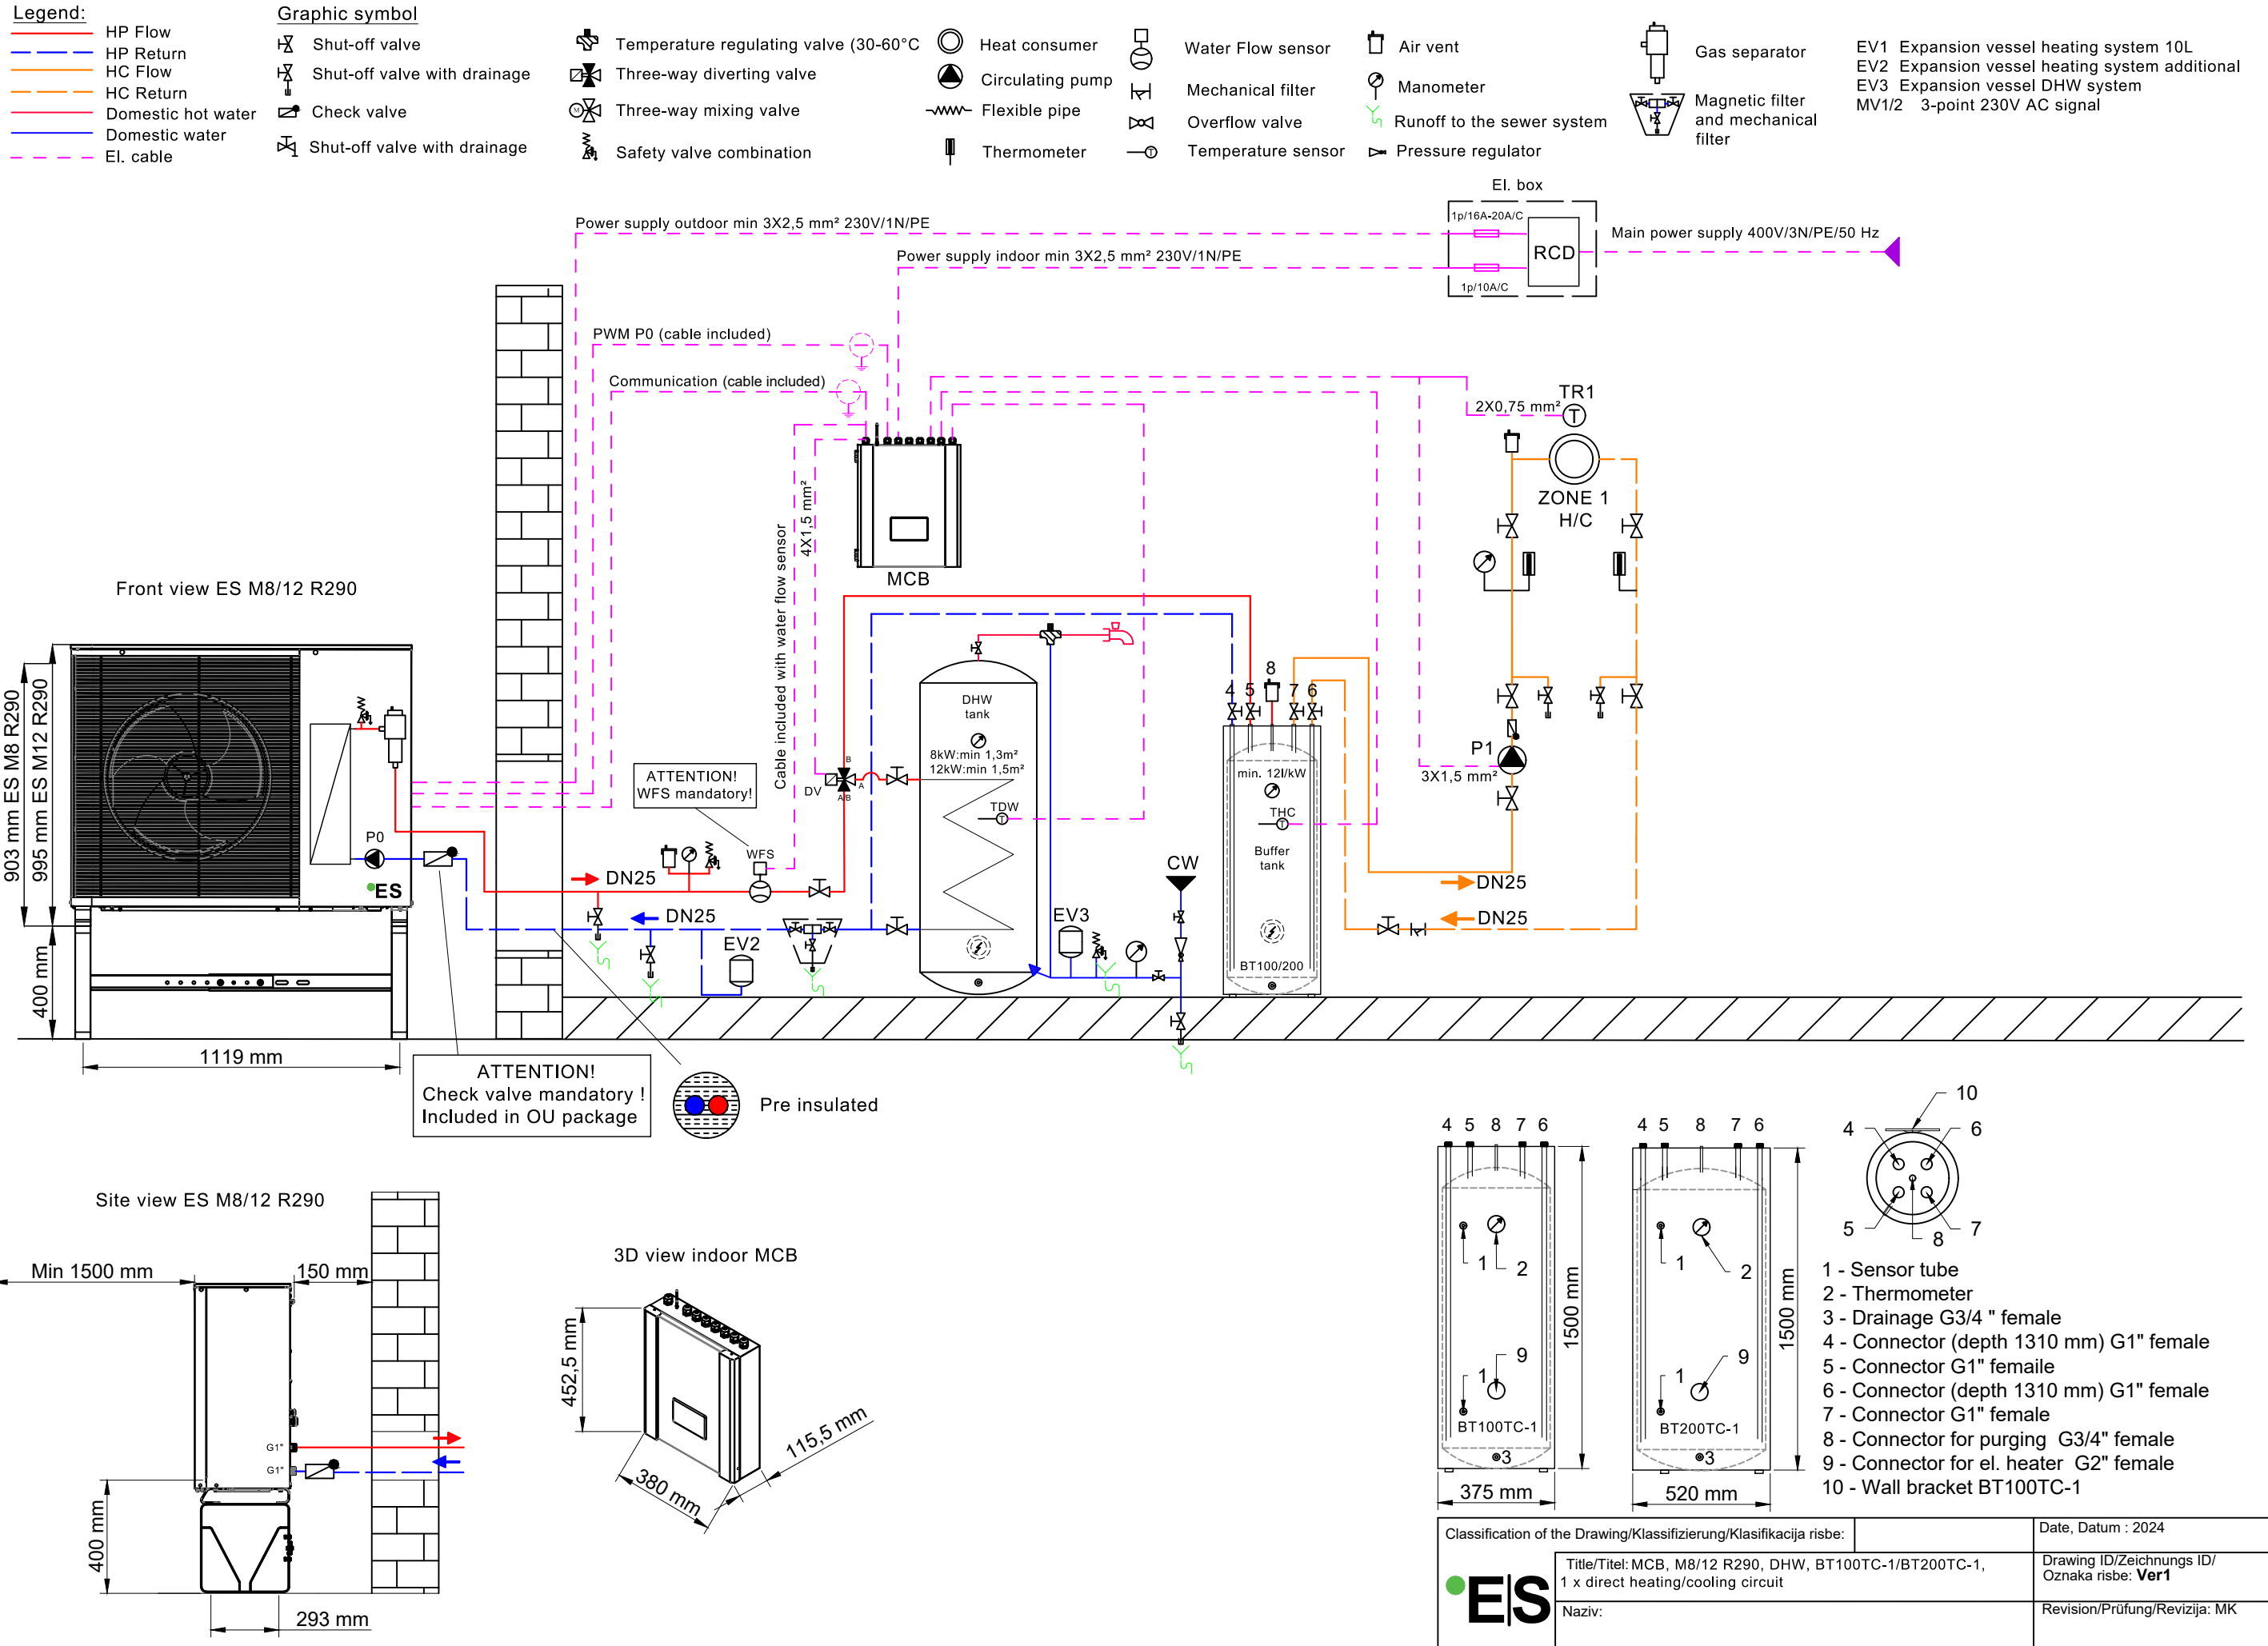


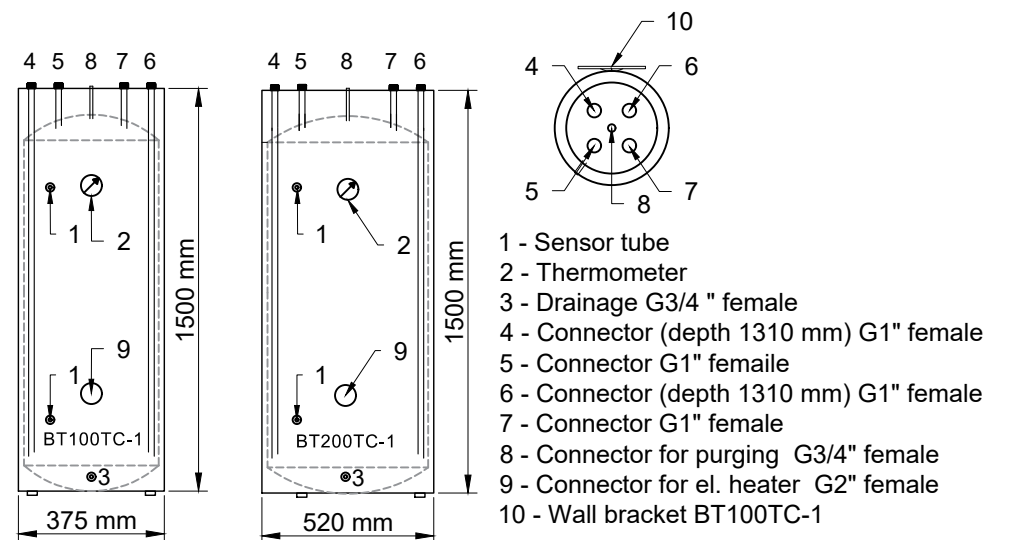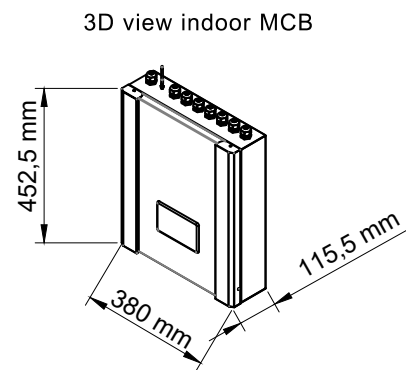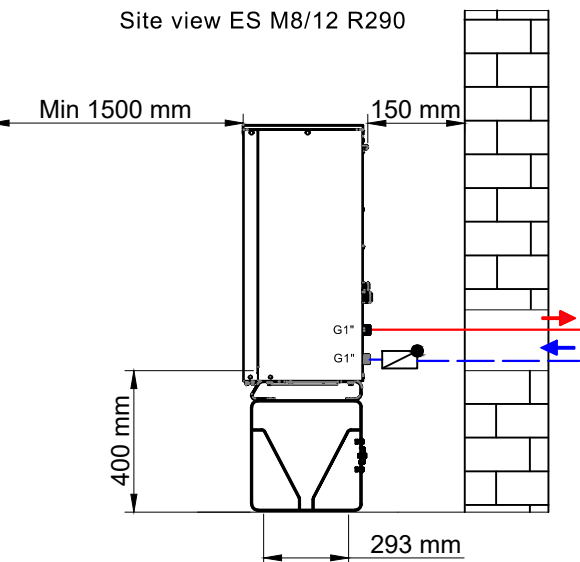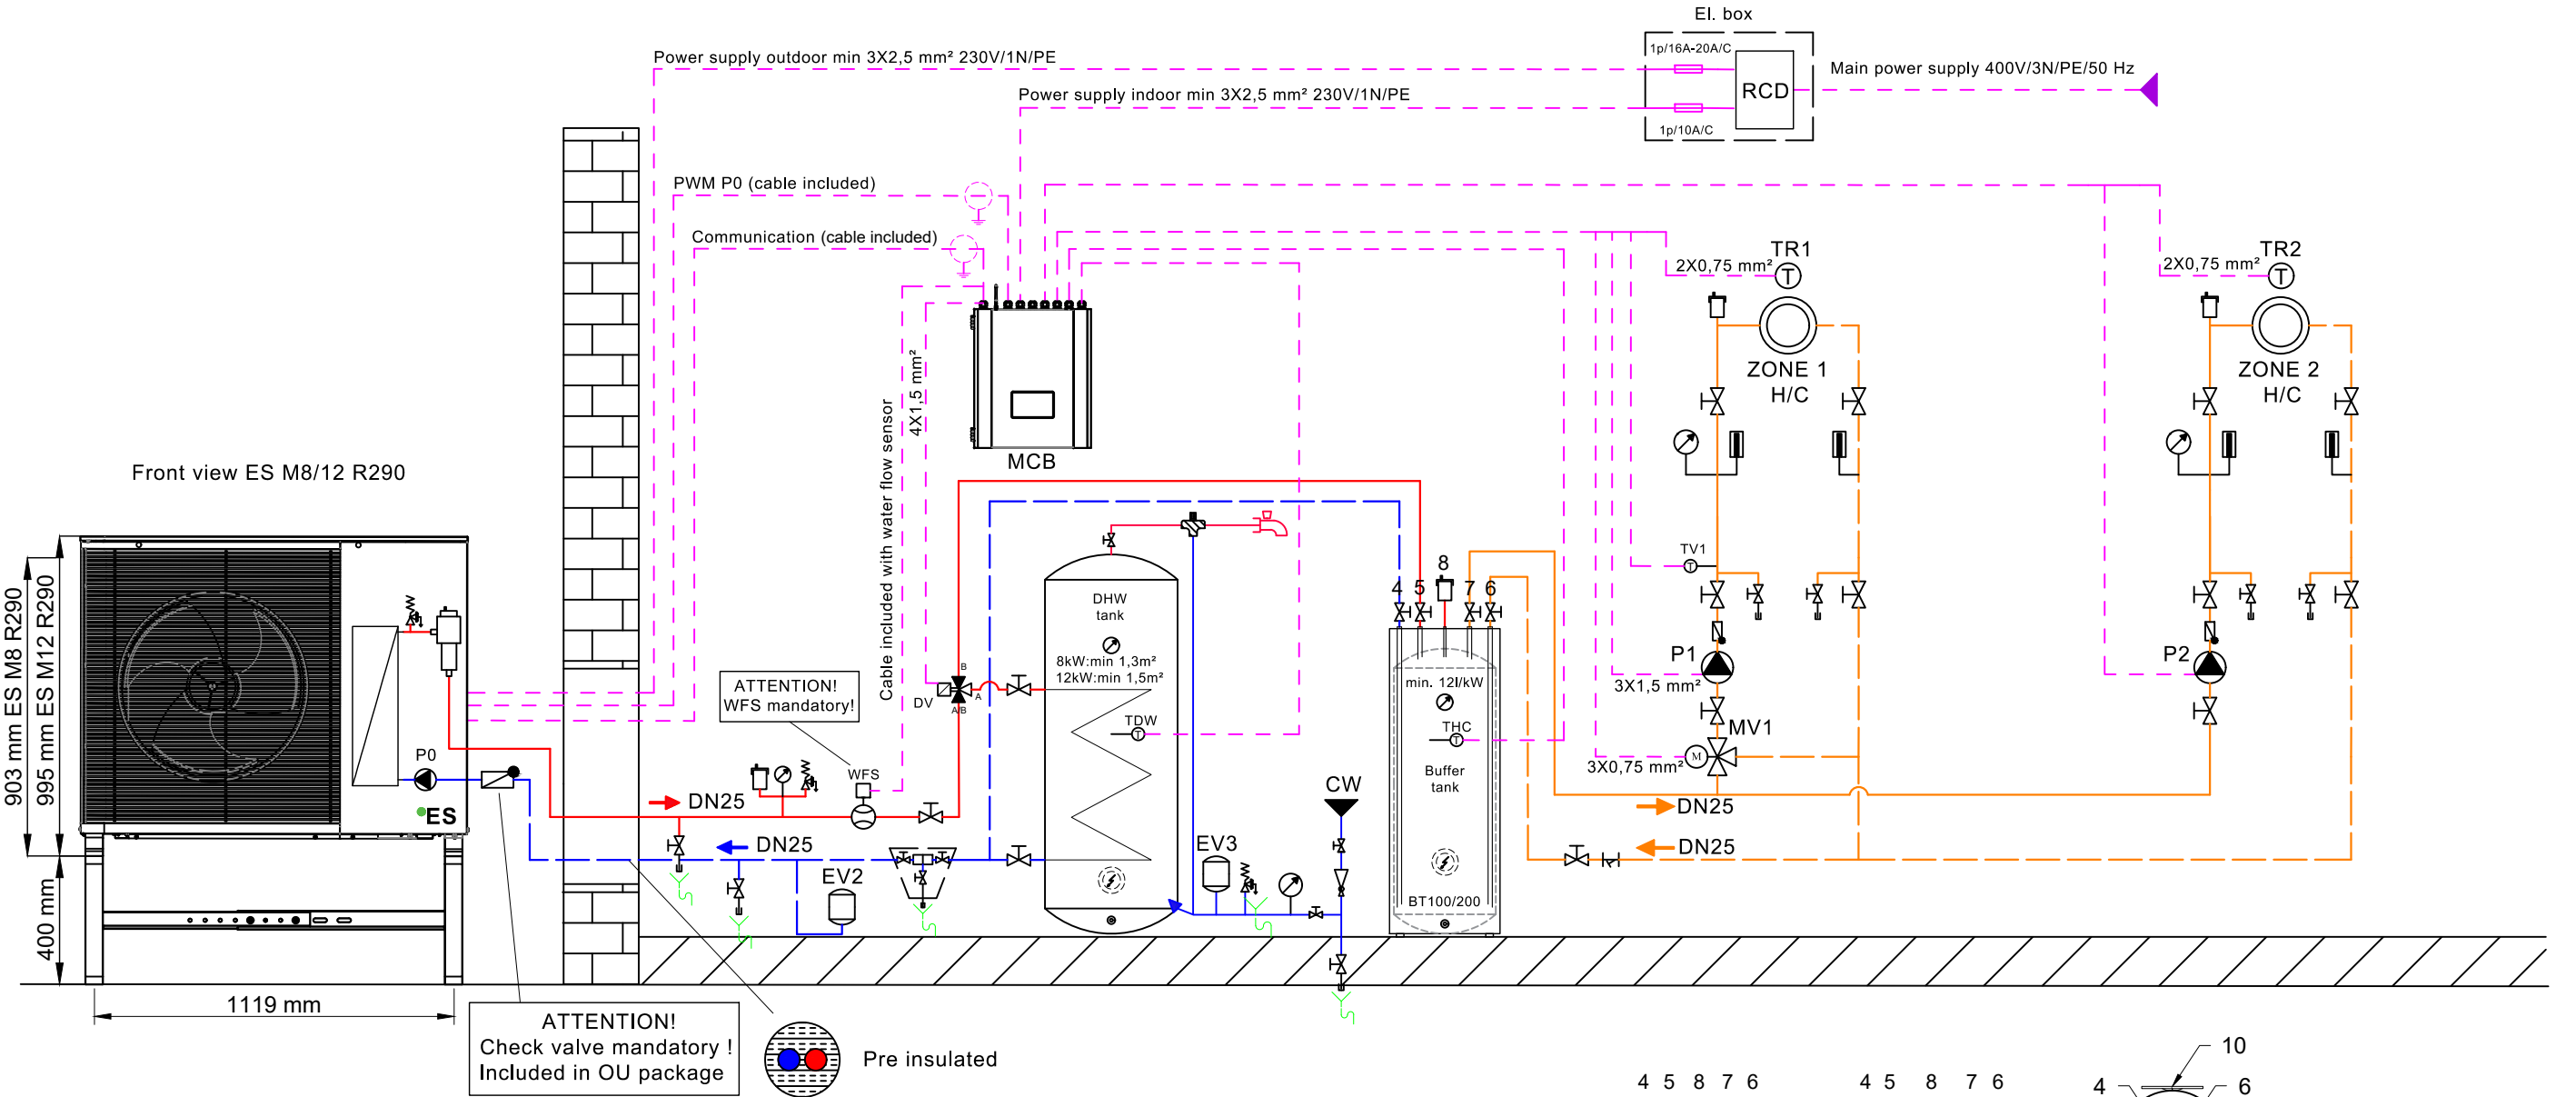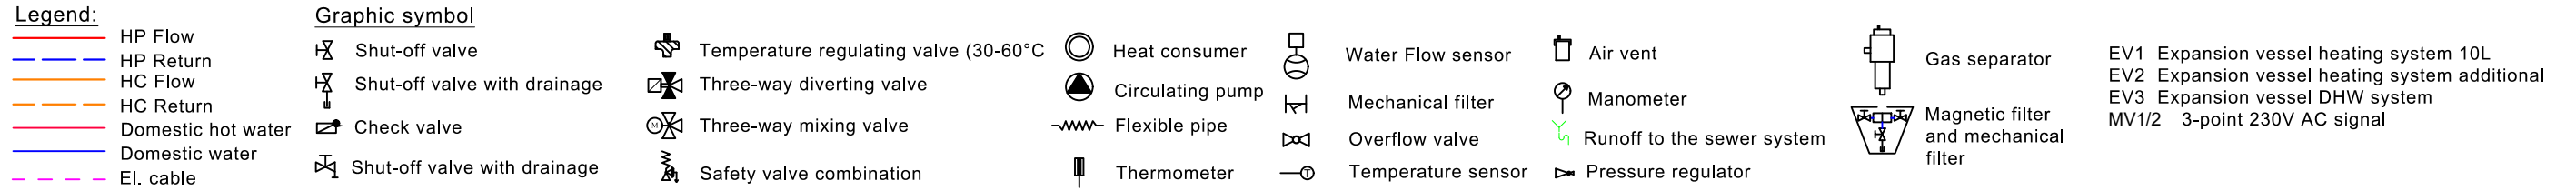


Classification of the Drawing/Klassifizierung/Klasifikacija risbe:		Date, Datum : 2024
	Title/Title: MCB, M8/12 R290, DHW, BT100TC-1/BT200TC-1, 1 x mixing heating/cooling circuit, 1 x direct heating/cooling circuit	Drawing ID/Zeichnungs ID/ Oznaka risbe: Ver1
	Naziv:	Revision/Prüfung/Revizija: MK

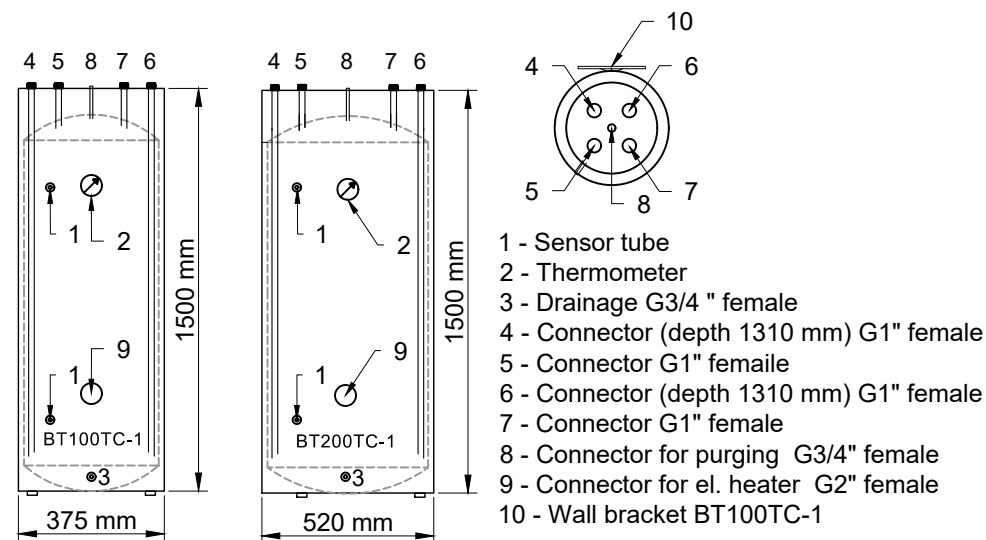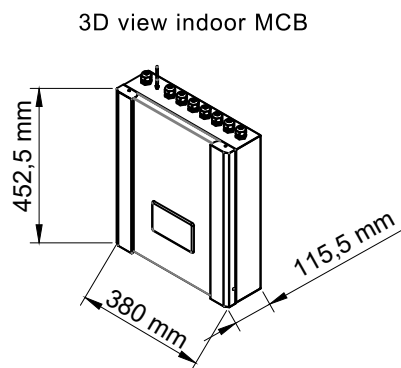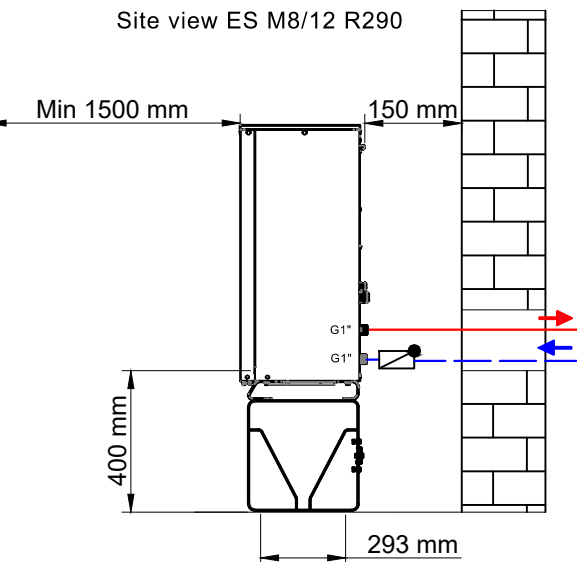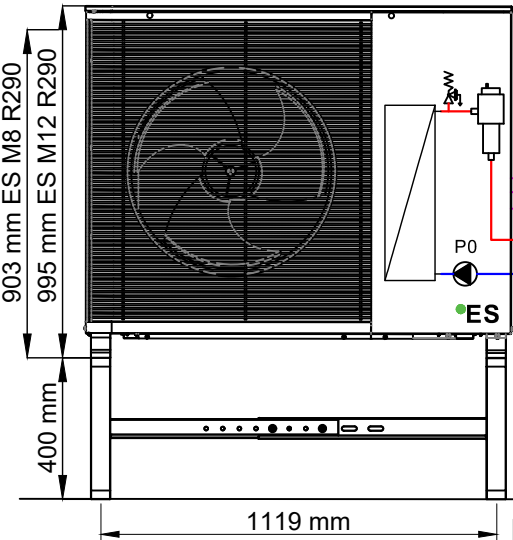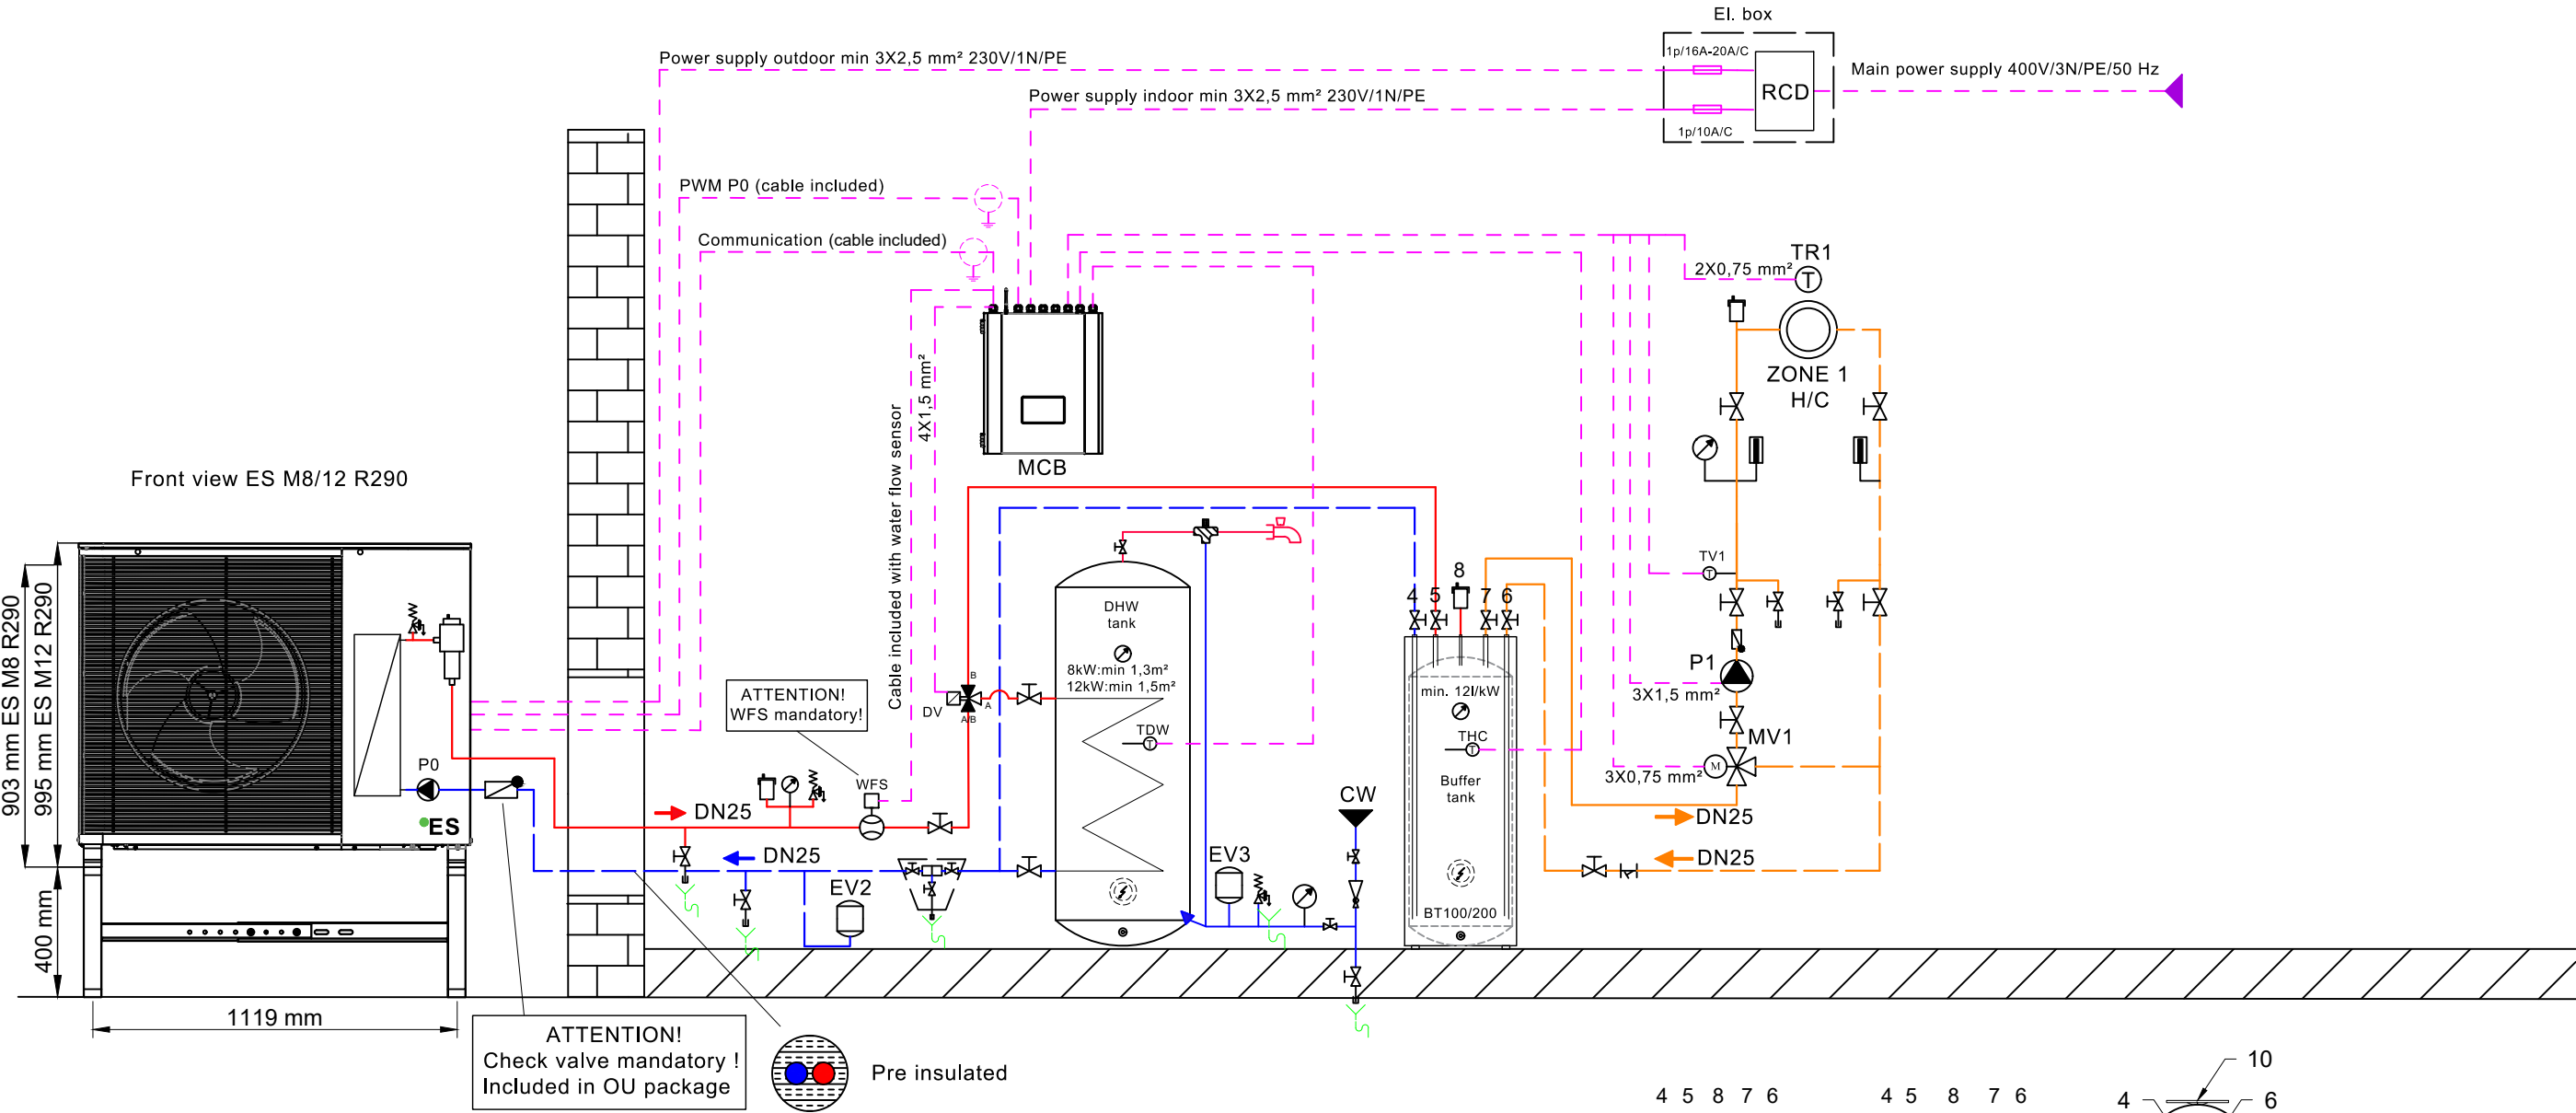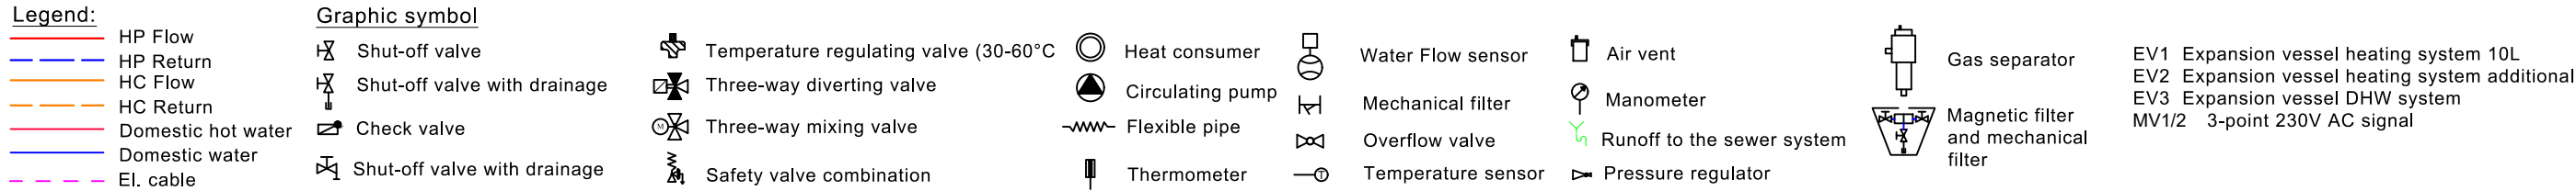


Classification of the Drawing/Klassifizierung/Klasifikacija risbe:		Date, Datum : 2024
	Title/Title: MCB, M8/12 R290, DHW, BT100TC-1/BT200TC-1, 1 x mixing heating/cooling circuit	Drawing ID/Zeichnungs ID/ Oznaka risbe: Ver1
	Naziv:	Revision/Prüfung/Revizija: MK

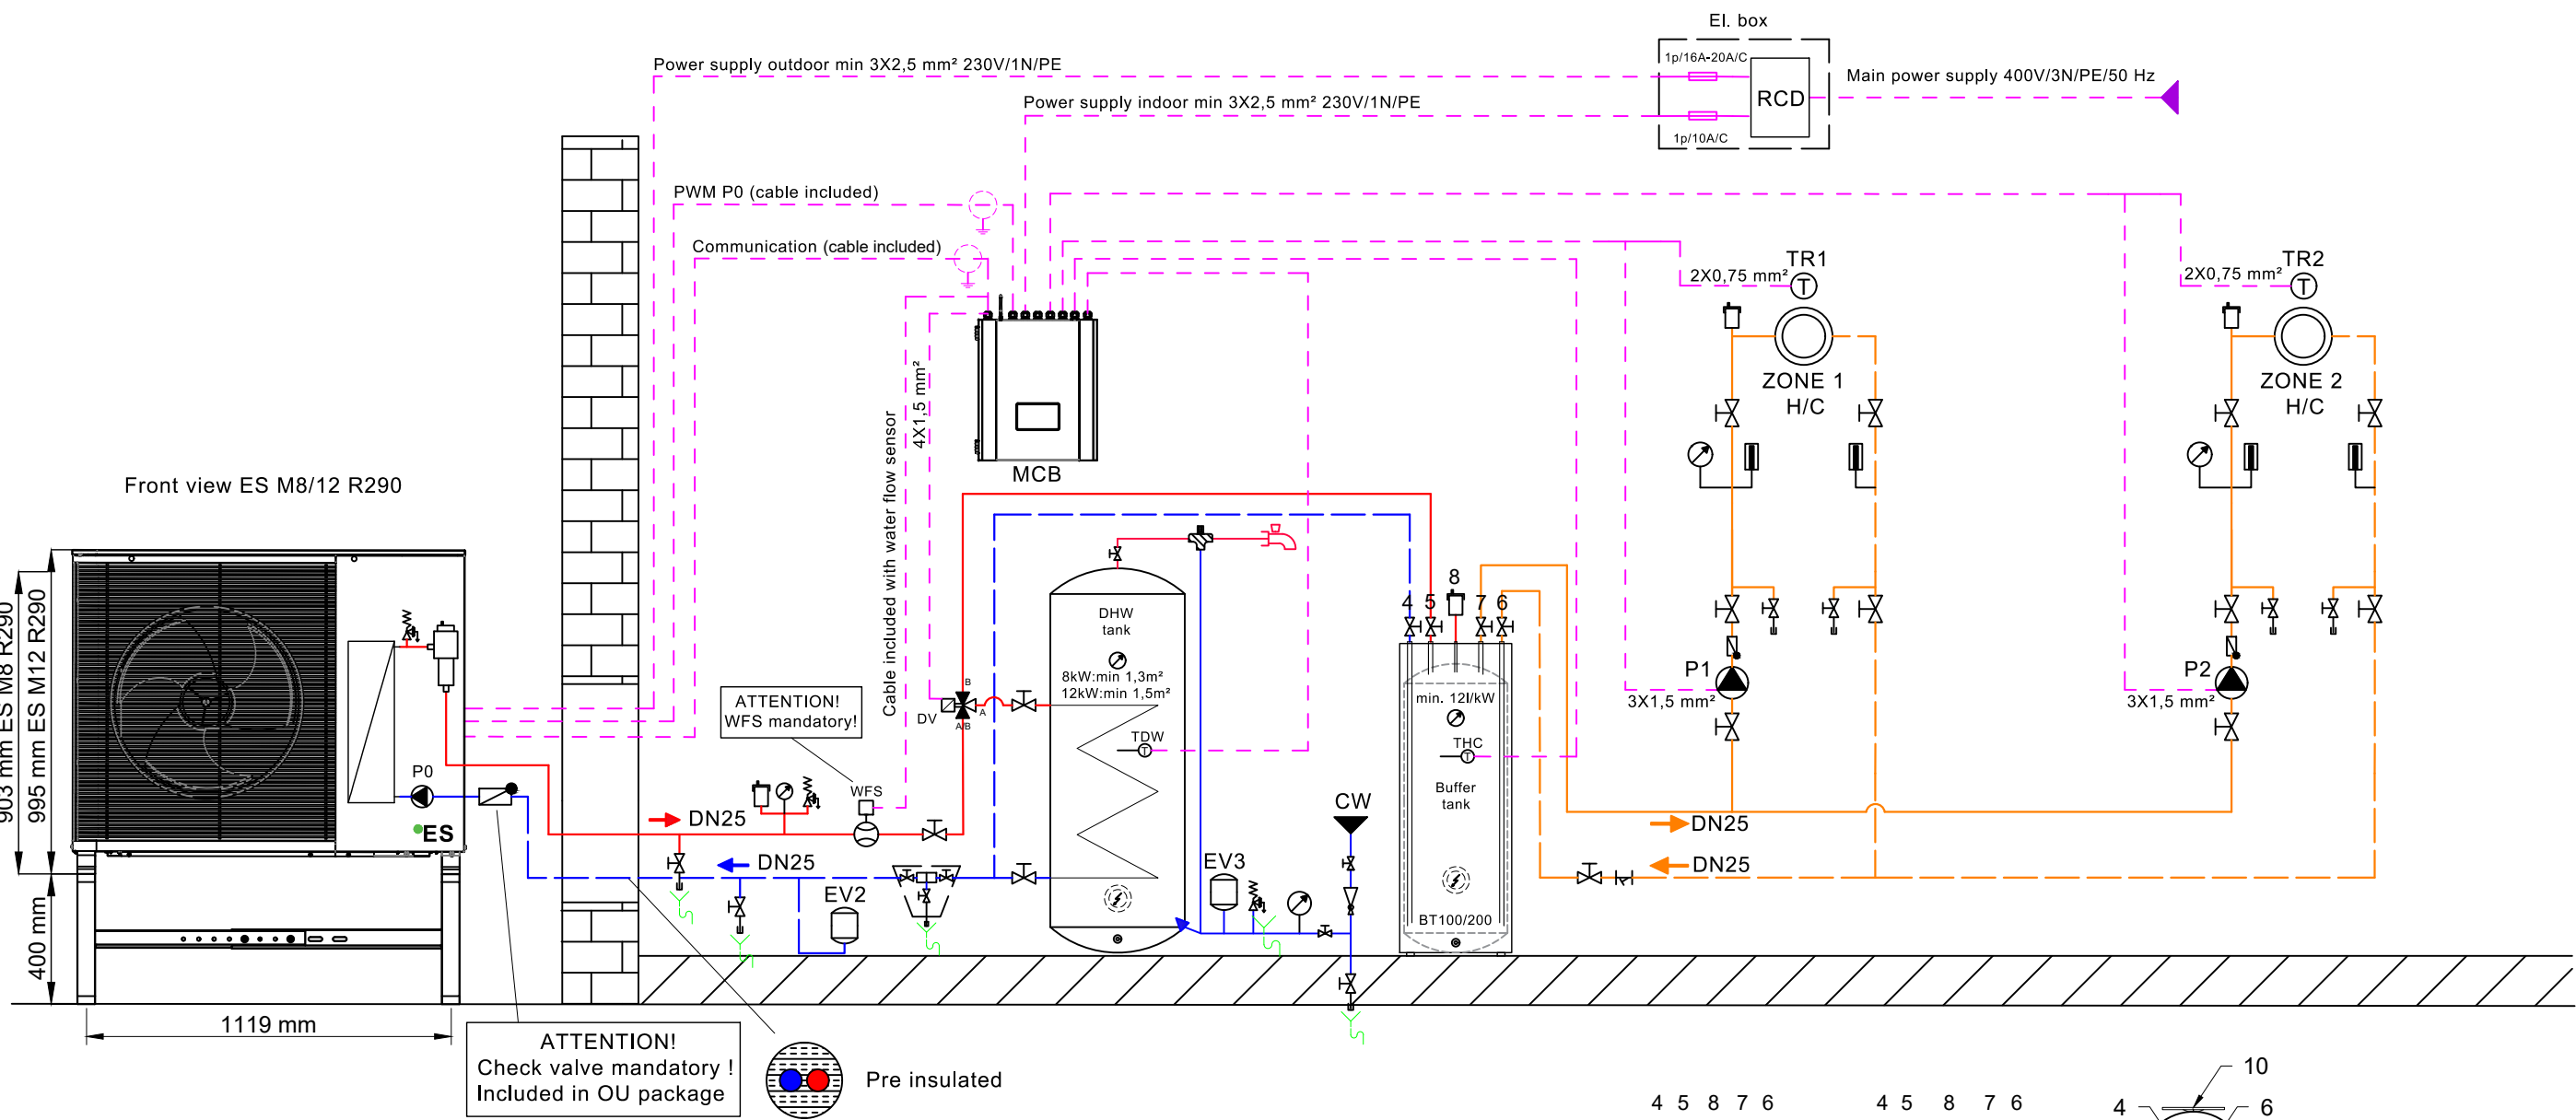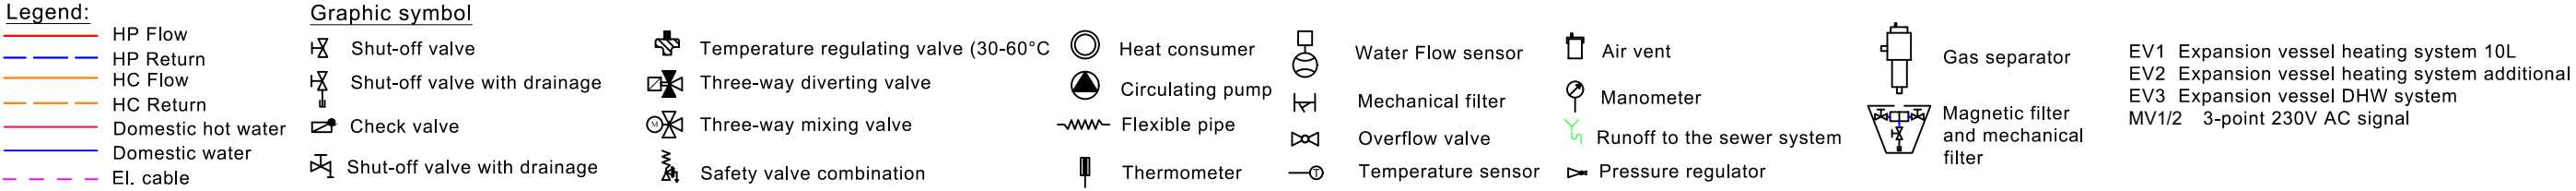



Front view ES M8/12 R290

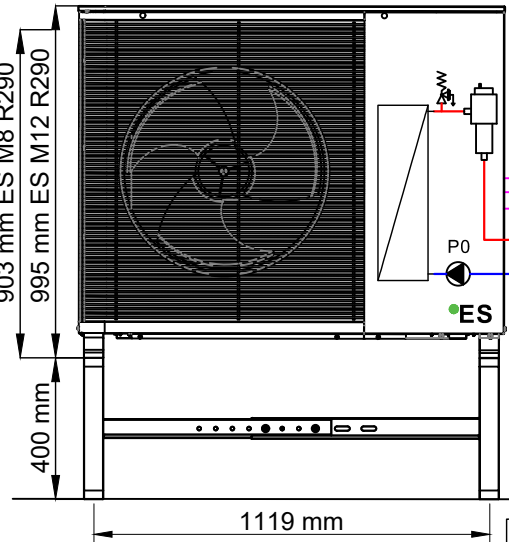


Site view ES M8/12 R290

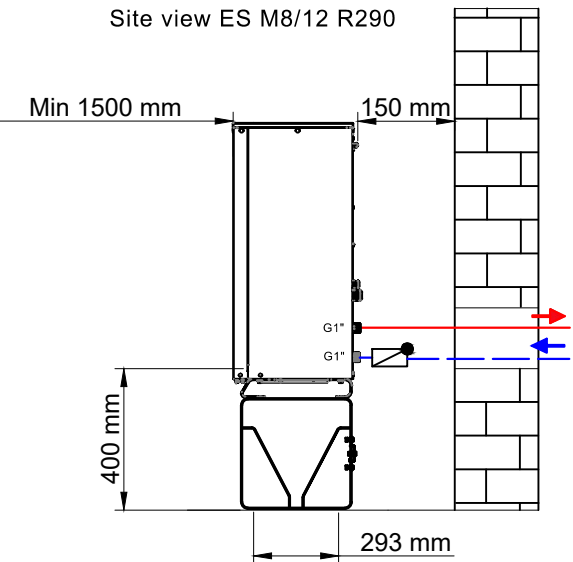




3D view indoor MCB

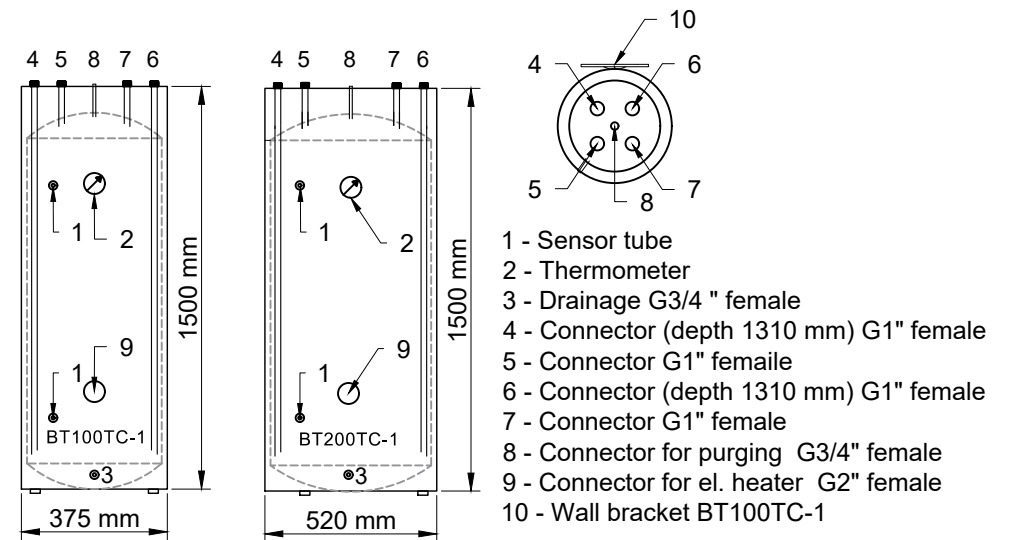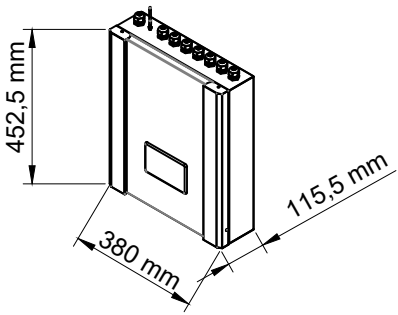

Classification of the Drawing/Klassifizierung/Klasifikacija risbe:		Date, Datum : 2024
	Title/Titel: MCB, M8/12 R290, DHW, BT100TC-1/BT200TC-1, 2 x direct heating/cooling circuit	Drawing ID/Zeichnungs ID/ Oznaka risbe: Ver1
	Naziv:	Revision/Prüfung/Revizija: MK


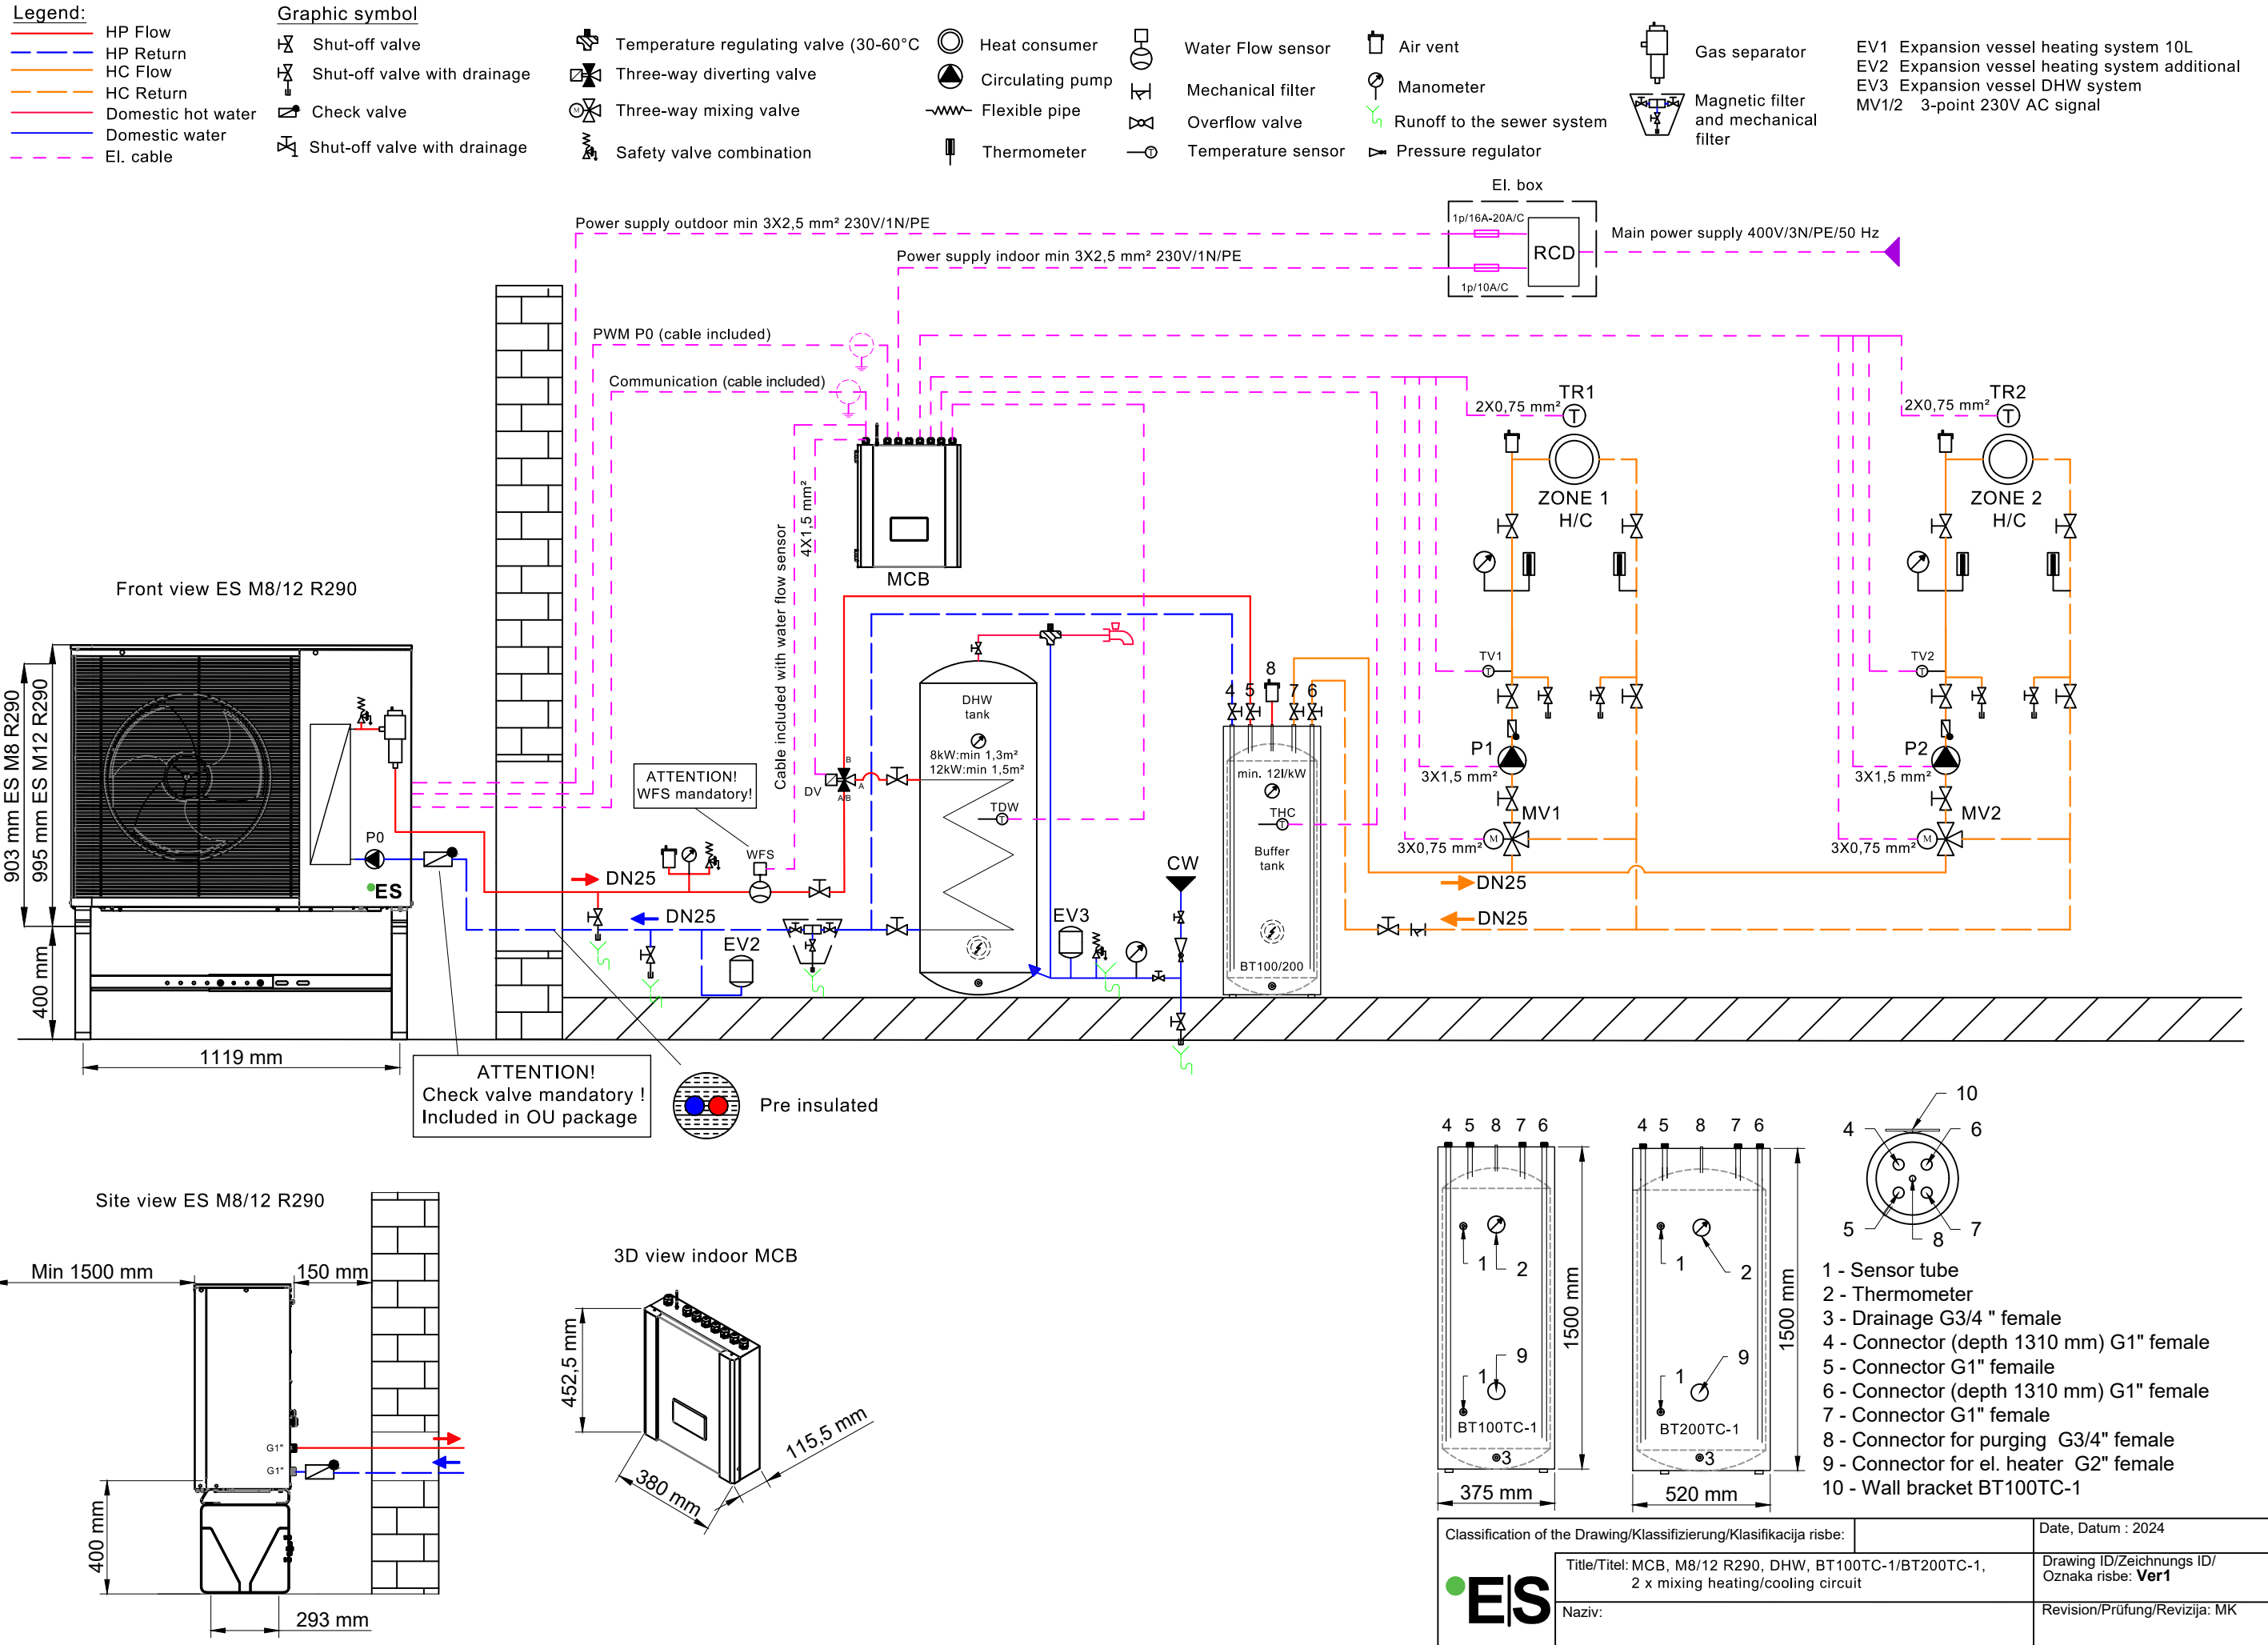


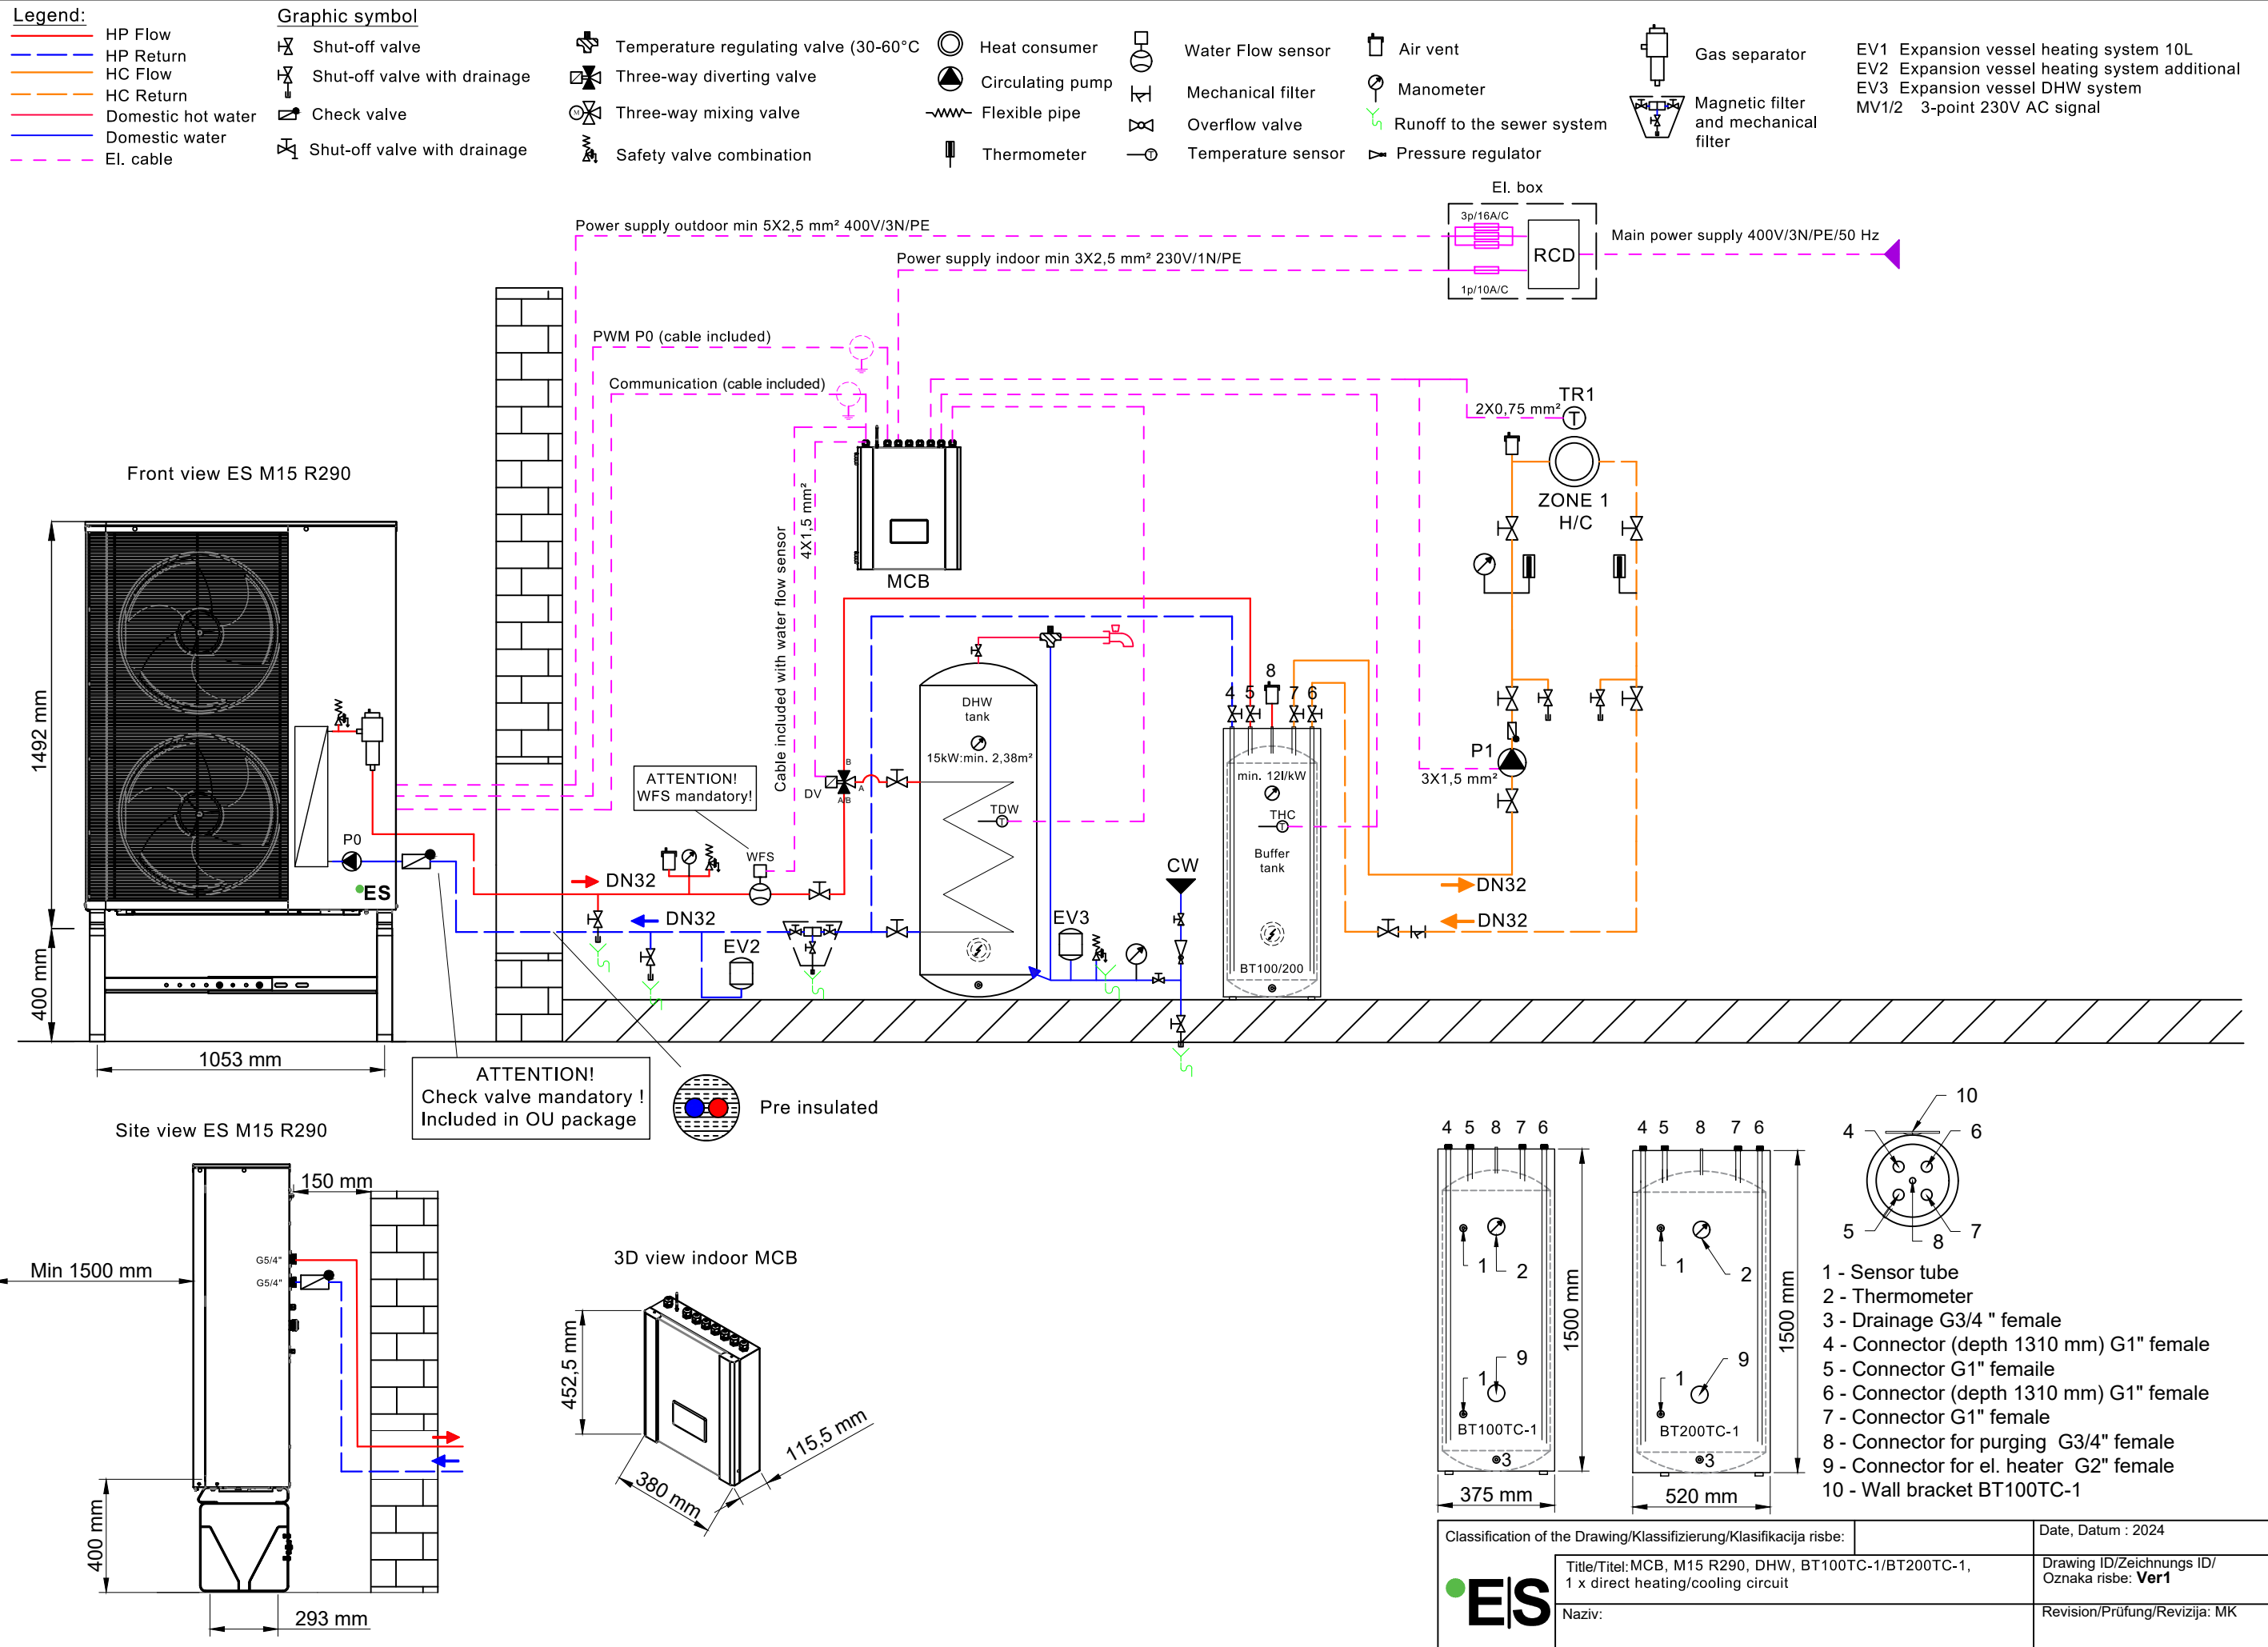

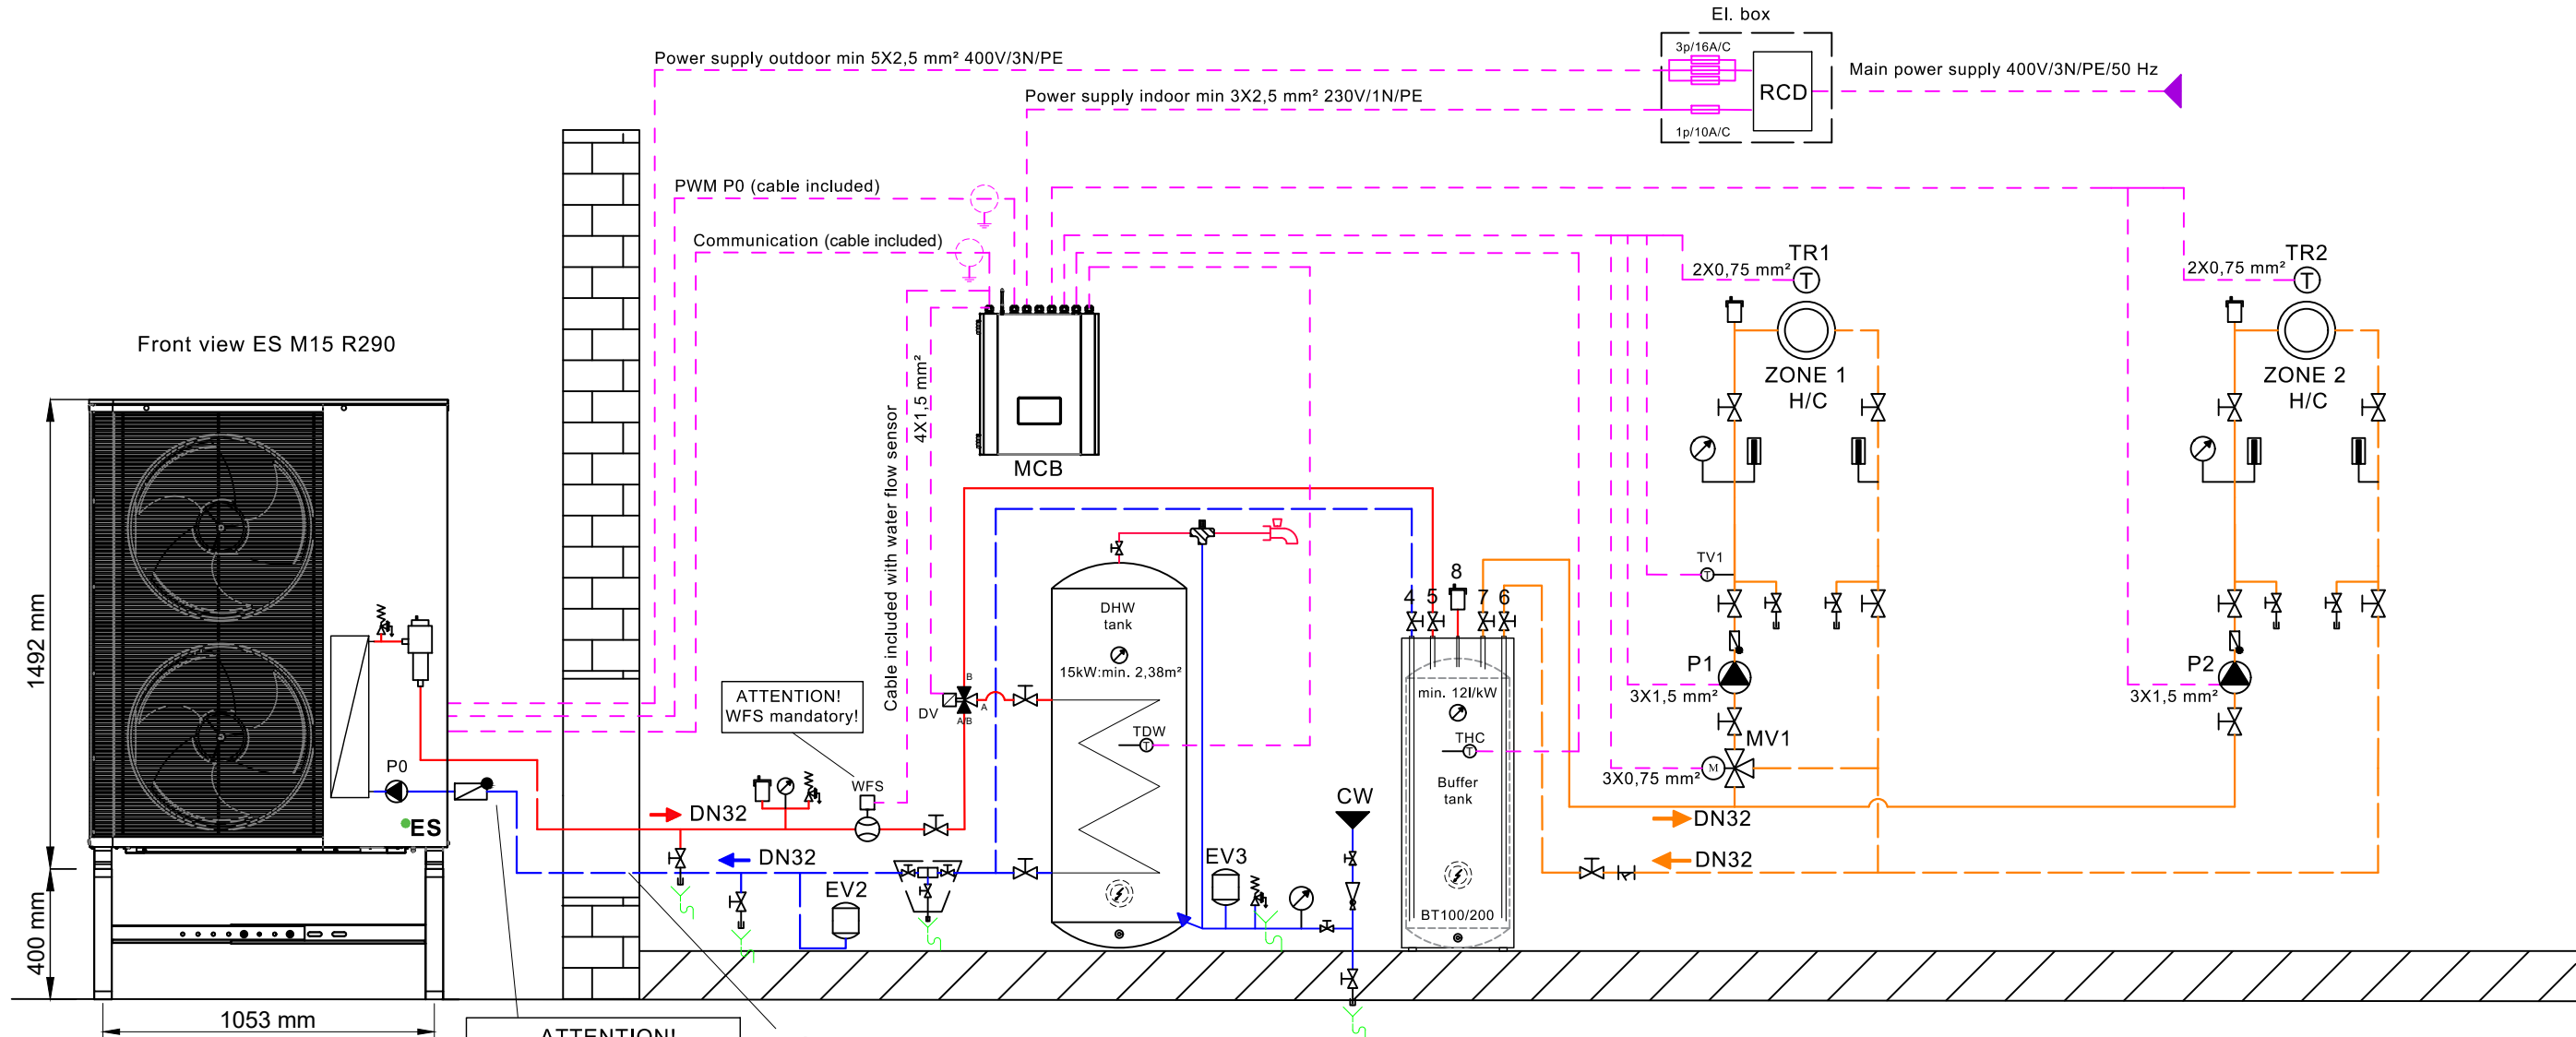
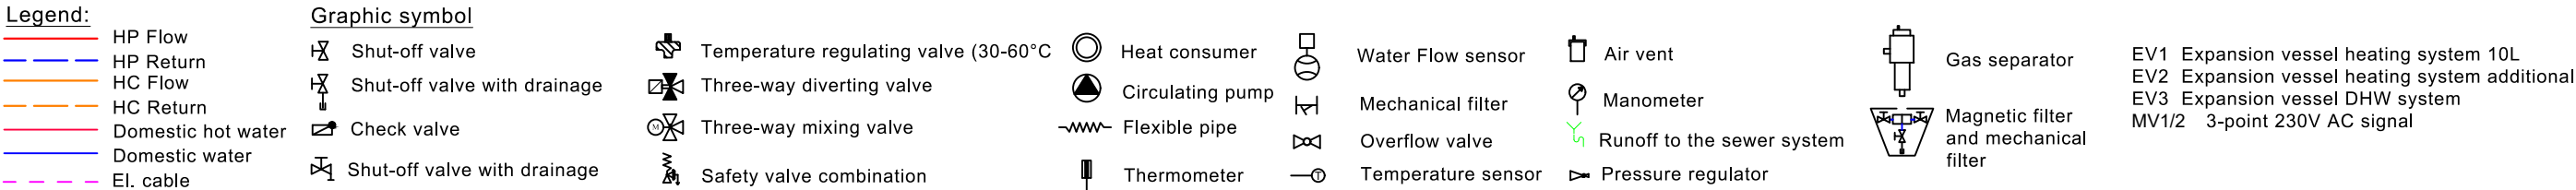


Site view ES M15 R290

ATTENTION!
Check valve mandatory!
Included in OU package

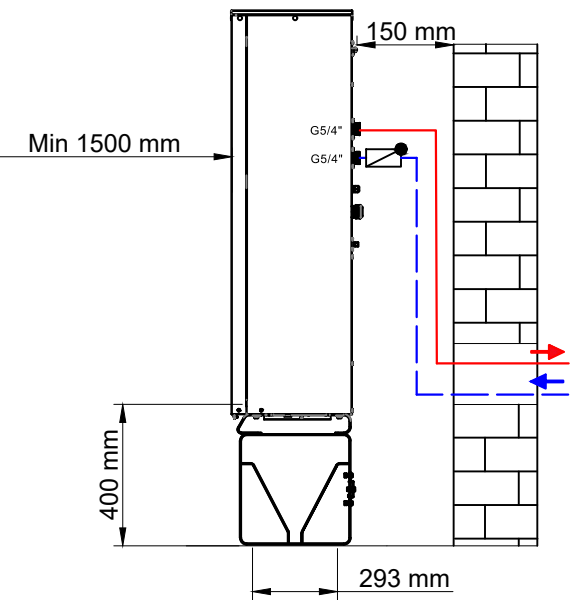

3D view indoor MCB

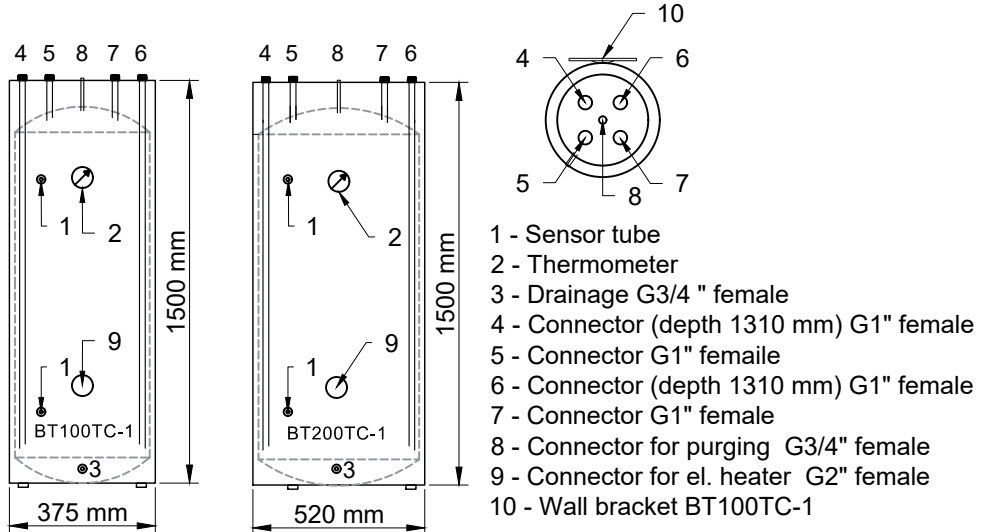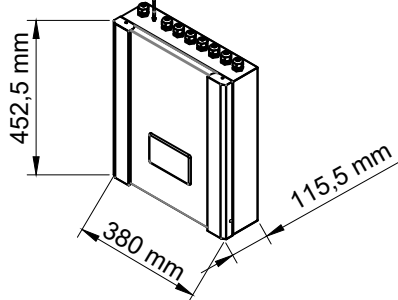

Classification of the Drawing/Klassifizierung/Klasifikacija risbe:		Date, Datum : 2024
	Title/Titel: MCB, M15 R290, DHW, BT100TC-1/BT200TC-1, 1 x mixing heating/cooling circuit, 1 direct heating/cooling circuit	Drawing ID/Zeichnungs ID/ Oznaka risbe: Ver1
	Naziv:	Revision/Prüfung/Revizija: MK

